
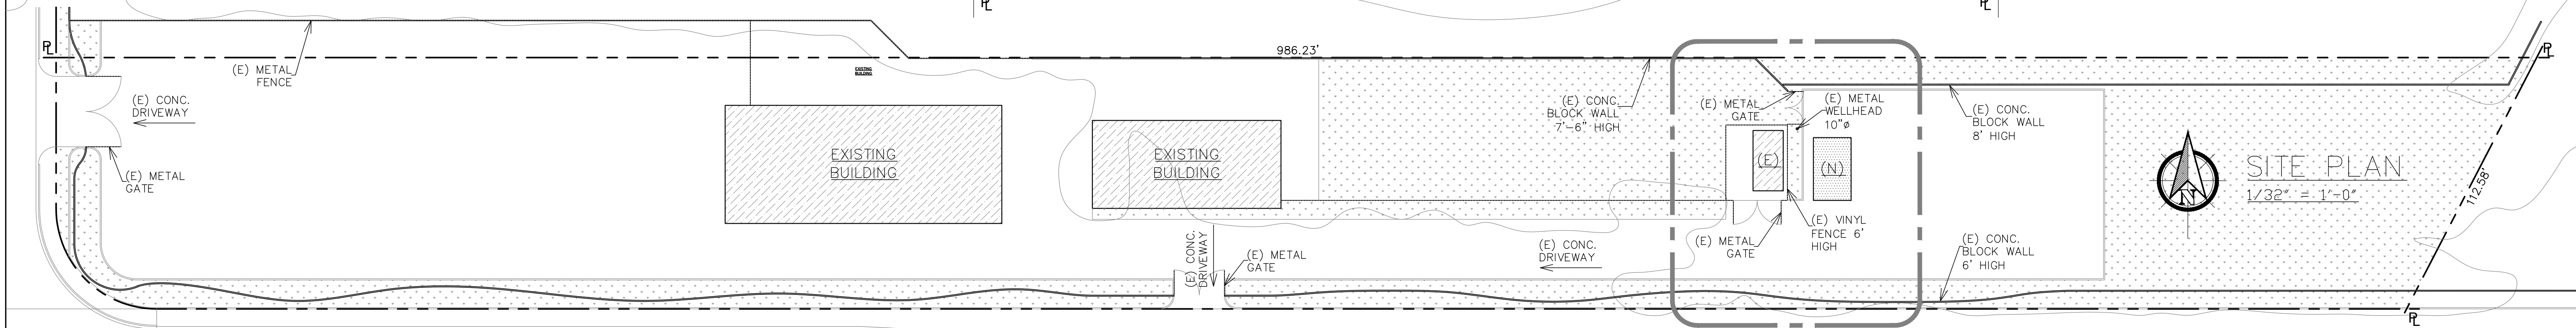
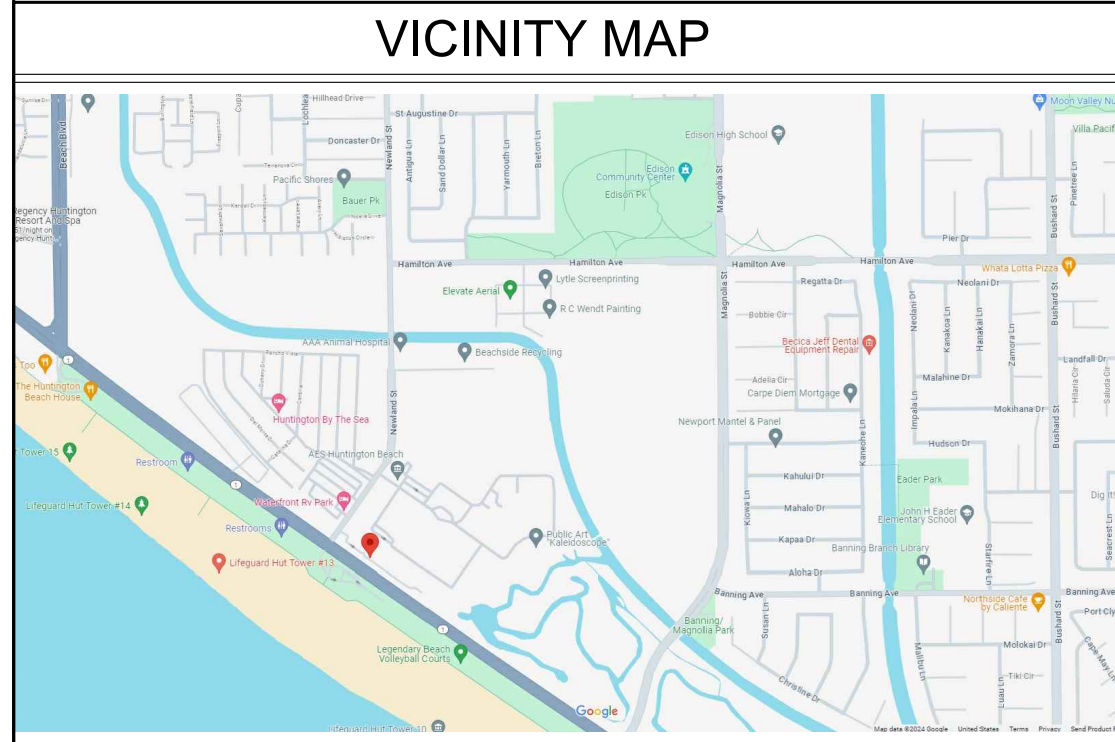


ABBREVIATIONS		LEGEND	
F.Y.S.B.	FRONT YARD SETBACK		EXISTING BUILDING
R.Y.S.B.	REAR YARD SETBACK		PROPOSED 1-CAR GARAGE
S.Y.S.B.	SIDE YARD SETBACK		(E) LANDSCAPE AREA
PL	PROPERTY LINE		
CL	CENTER LINE		
(E)	EXISTING		SLOPE DIRECTION
(N)	NEW		
TYP.	TYPICAL		
SIM.	SIMILAR		
F.F.	FINISHED FLOOR ELEVATION		
P.A.	PLANTING AREA		
M.H.	MAN HOLE		
P.P	POWER POLE		

THE APPROVAL OF PLANS AND SPECIFICATIONS DOES NOT PERMIT THE VIOLATION OF ANY SECTION OF THE BUILDING CODE OR OTHER CITY ORDINANCE OR STATE LAW.

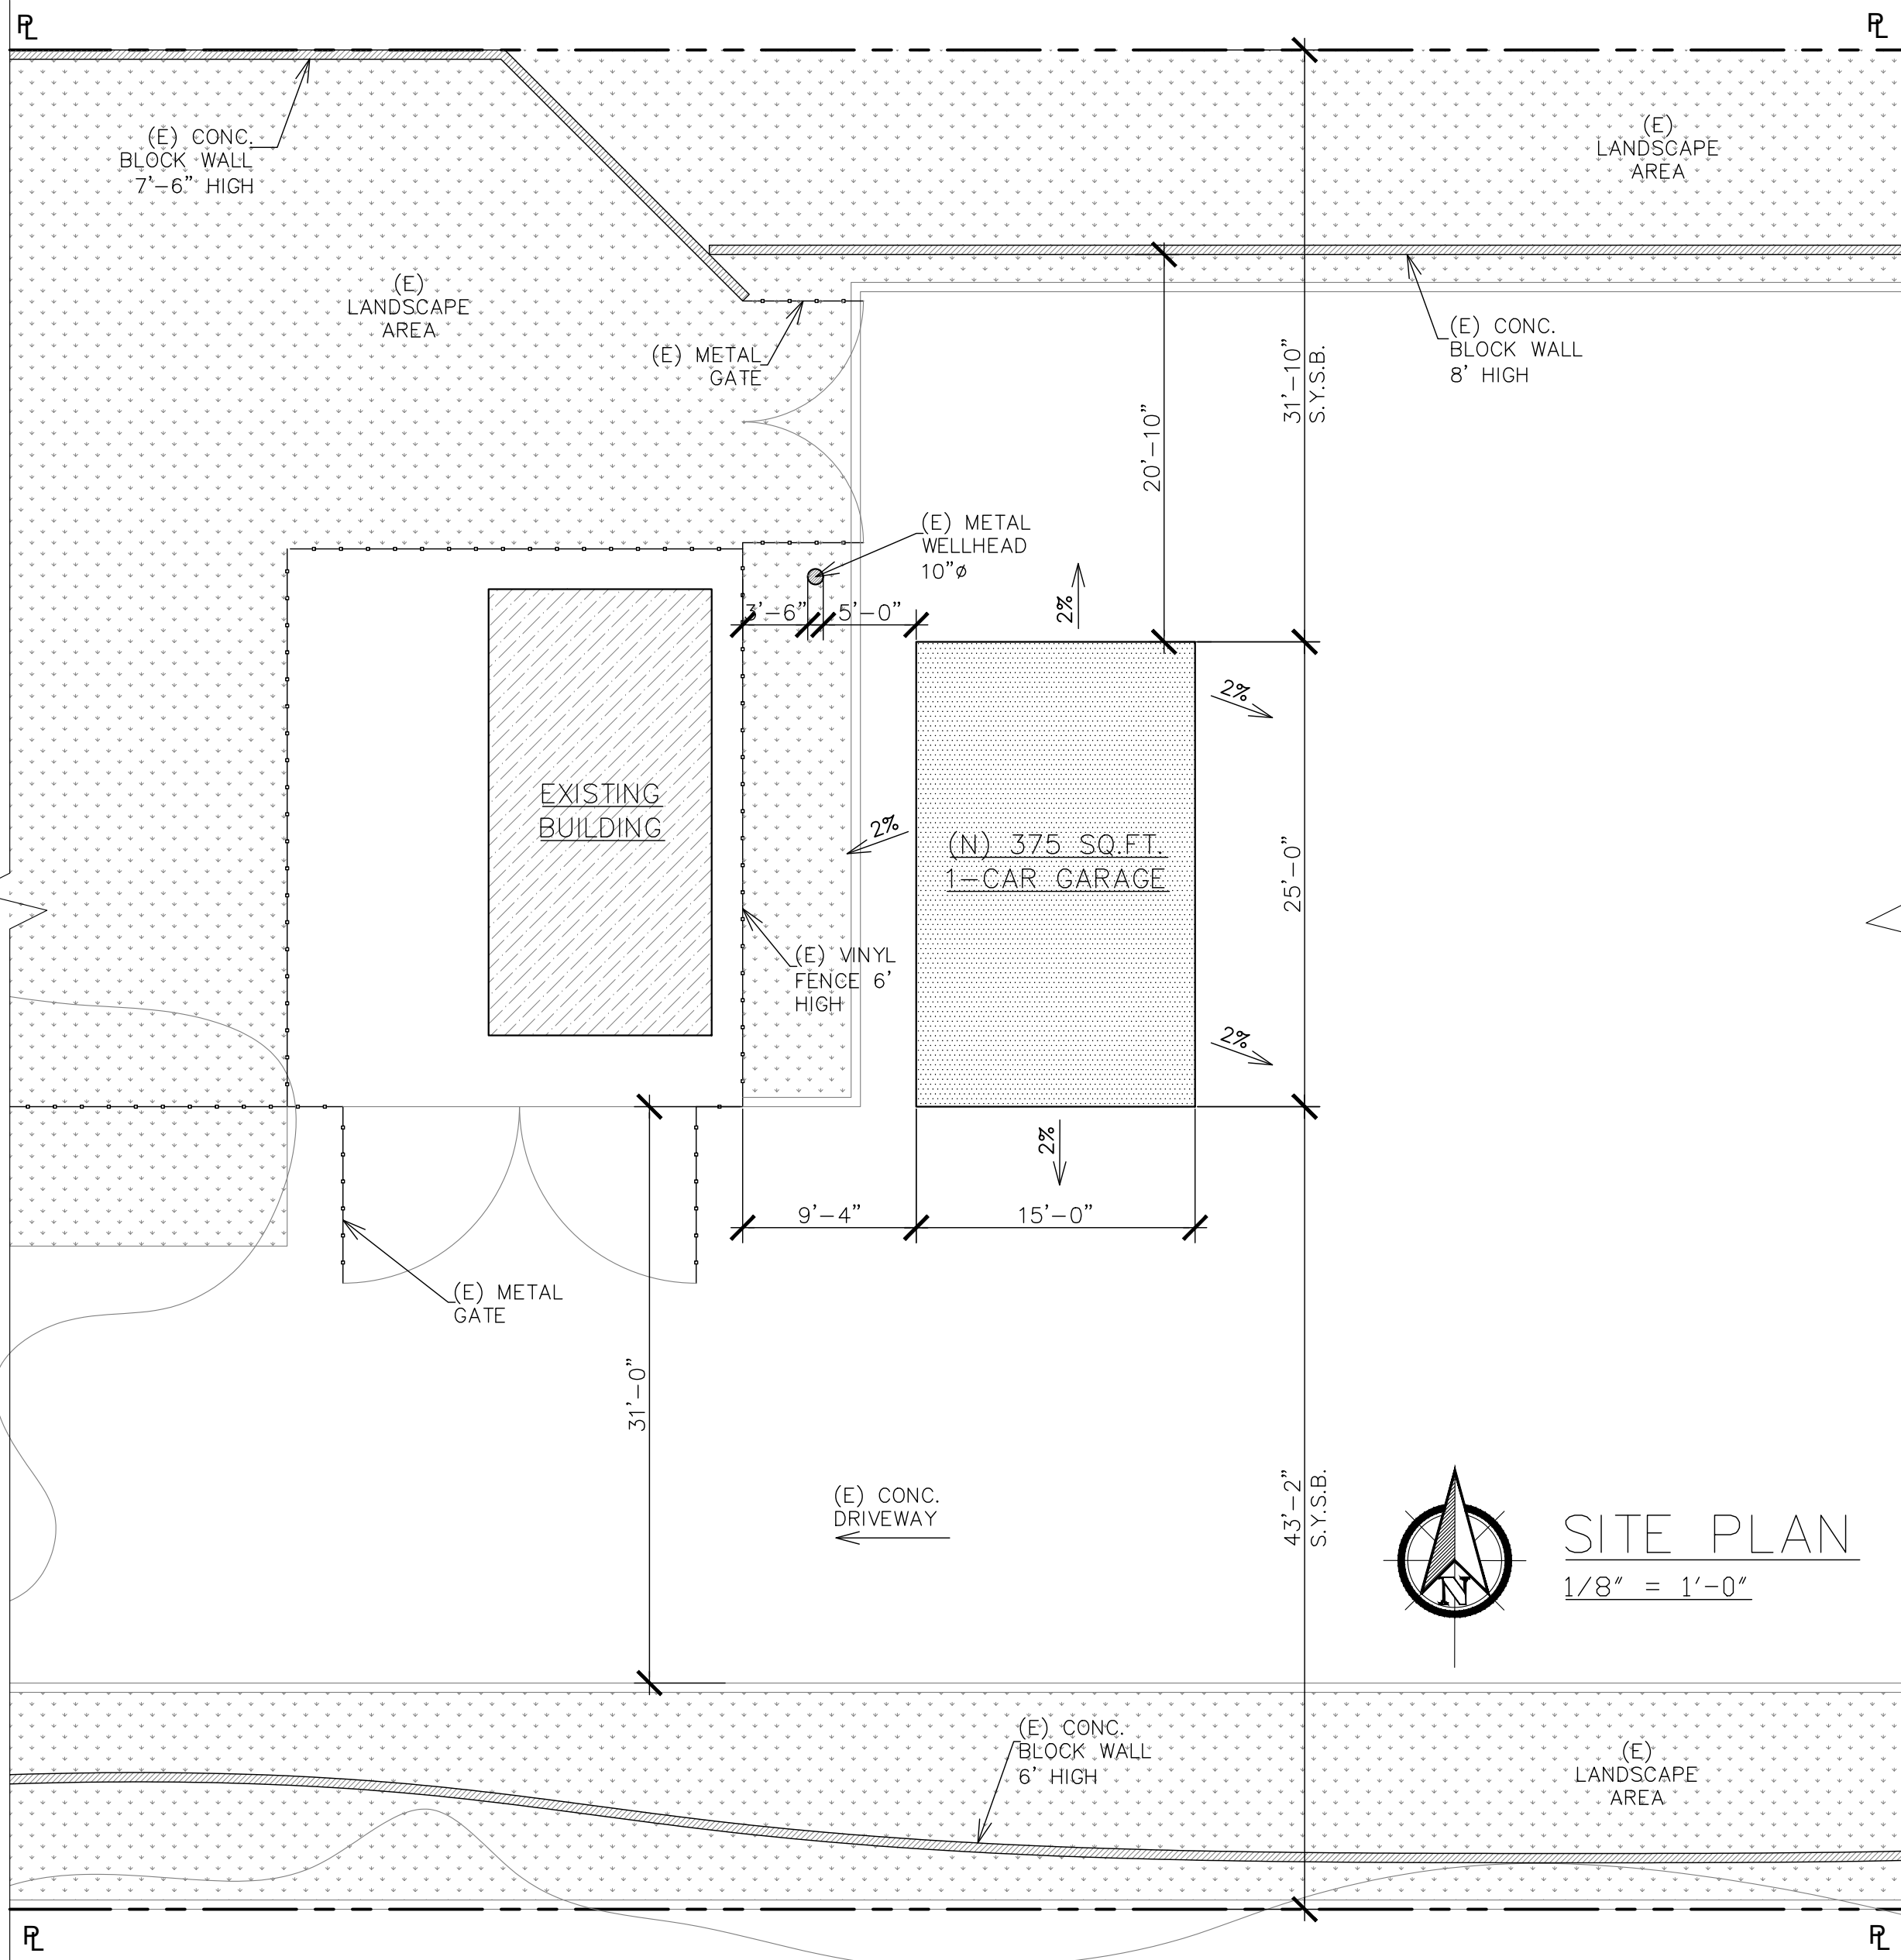

GENERAL NOTES	
1. CODE: CONSTRUCTION SHALL CONFORM TO THE CURRENT EDITION OF THE UNIFORM BUILDING CODE.	PLASTER IS APPLIED.
2. CONTRACTOR AND SUBCONTRACTORS SHALL CHECK AND VERIFY ALL DIMENSIONS, ELEVATIONS AND CONDITIONS AT THE SITE BEFORE COMMENCING ANY WORK. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION PRIOR TO COMMENCING SUCH WORK.	17. ALL WALLS ADJACENT TO SHOWERS SHALL BE CONSTRUCTED OF AN APPROVED, DENSE, NON-ABSORBENT WATERPROOF MATERIAL TO A HEIGHT OF NOT LESS THAN 6 FEET ABOVE THE FLOOR.
3. REFERENCE TO ANY DETAIL OR DRAWING IS FOR CONVENIENCE ONLY AND DOES NOT LIMIT THE APPLICATION OF SUCH DETAIL OR DRAWING.	18. WATER HEATERS WITH NON-RIGID WATER CONNECTIONS SHALL BE STRAPPED FOR LATERAL SUPPORT.
4. VERIFY LOCATION AND SIZE OF ALL OPENINGS WITH APPLICABLE DRAWINGS BEFORE POURING CONCRETE.	19. ALL OPENINGS IN EXTERIOR WALLS SHALL BE FLASHED WITH 26 GAUGE G.I. SHEET METAL OR APPROVED BUILDING PAPER.
5. VERIFY INSERTS AND EMBEDDED ITEMS WITH ALL APPLICABLE DRAWINGS BEFORE POURING CONCRETE.	20. IN NO CASE SHALL WORKING DIMENSIONS BE SCALED FROM PLAN OR DETAILS. FIGURES ON DRAWINGS GOVERN SCALED MEASUREMENTS. LARGER SCALE DRAWINGS GOVERN SMALLER SCALE DRAWINGS.
6. GLASS AND GLAZING SHALL CONFORM WITH THE CODE. GLAZED OPENINGS WITHIN 18 INCHES OF ADJACENT FLOOR, FRENCH DOOR LIGHTS GLAZING, OPERABLE OR INOPERABLE ADJACENT TO A DOOR AND WITHIN THE SAME WALL PLANE AS THE DOOR WHOSE NEAREST VERTICAL EDGE IS WITHIN 12 INCHES OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS LESS THAN 60 INCHES ABOVE THE FLOOR SHALL BE TEMPERED GLASS APPROVED FOR IMPACT HAZARD.	21. PROVIDE SMOKE DETECTORS CONFORMING TO U.B.C. STANDARD NO. 43-6. DETECTORS SHALL BE MOUNTED ON THE CEILING OR WALL AT A POINT CENTRALLY LOCATED IN THE CORRIDOR OR AREA GIVING ACCESS TO ROOMS USED FOR SLEEPING PURPOSES. ALL DETECTORS SHALL BE LOCATED IN ACCORDANCE WITH APPROVED MANUFACTURERS INSTRUCTIONS. WHEN ACTUATED, THE DETECTOR SHALL PROVIDE AN ALARM IN THE DWELLING. SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING.
7. LATHING, PLASTERING AND GYPSUM DRYWALL SHALL CONFORM WITH THE CODE. IN PLACE LATH AND GYPSUM DRYWALL FASTENERS SHALL BE INSPECTED AND APPROVED BY THE BUILDING DEPARTMENT BEFORE JOINTS ARE TAPED AND/OR	22. ALL EXHAUST FANS SHALL BE SILENT RUNNING AND SHALL HAVE A MINIMUM 8'-0" LONG DUCT BETWEEN THE RETURN AIR GRILLE AND THE FAN MOTOR. DUCT SHALL BE LINED WITH 1" THICK FIBERGLASS LINER, AND EQUIVALENT LENGTH OF GLASS FIBER FLEXIBLE DUCT IS ACCEPTABLE. DO NOT LOCATE FAN MOTOR ABOVE CEILING OF ROOM SERVED BY FAN; LOCATE MOTORS ABOVE HALL OR OPEN AREA CEILING.

GRADING NOTES	
1. IF ADVERSE CONDITIONS ARE ENCOUNTERED, A SOILS INVESTIGATION REPORT MAY BE REQUIRED	
2. ALL FOOTINGS SHALL BE FOUNDED IN UNDISTURBED NATURAL SOIL PER CODE	
3. ALL CONCENTRATED DRAINAGE INCLUDING ROOF WATER, SHALL BE CONDUCTED VIA GRAVITY, TO THE STREET OR AN APPROVED LOCATION AT A 2% MINIMUM SLOPE	
4. THE CONSTRUCTION SHALL NOT RESTRICT A FIVE FOOT CLEAR AND UNOBSTRUCTED ACCESS TO ANY WATER OR POWER DISTRIBUTION FACILITIES (POWER POLES, PULL BOXES, TRANSFORMERS, VAULTS,PUMPS, VALVES, METERS, APPURTENANCES, ETC.) OR TO THE LOCATION OF THE HOOK UP. THE CONSTRUCTION SHALL NOT BE WITHIN TEN FEET OF ANY POWER LINES-WHETHER OR NOT THE LINES ARE LOCATED ON THE PROPERTY. FAILURE TO COMPLY MAY CAUSE CONSTRUCTION DELAYS AND/OR ADDITIONAL EXPENSES.	
5. ALL GRADING SLOPES SHALL BE PLANTED AND SPRINKLERED.	
6. STANDARD 12 INCH HIGH BERM IS REQUIRED AT TOP OF ALL GRADED SLOPES	
7. MAN MADE FILL SHALL BE COMPACTED TO A MINIMUM RELATIVE COMPACTION OF 90% COHESIONLESS SOILS WITH LESS LAN 15% FINER THAN .005 MM REQUIRE 95% COMPACTION.	
8. TEMPORARY EROSION CONTROL TO BE INSTALLED BETWEEN OCTOBER 1 AND APRIL 15. OBTAIN GRADING INSPECTORS AND DEPARTMENT OF PUBLIC WORKS APPROVAL OF PROPOSED PROCEDURES.	

SHEET INDEX	
A-1.0	TITLE SHEET/SITE PLAN
A-1.1	GENERAL NOTES
A-2.0	FLOOR AND ROOF PLAN
A-3.0	ELEVATIONS AND SECTIONS
GR-1	GREEN BUILDING NOTES
GR-2	GREEN BUILDING NOTES
GR-3	GREEN BUILDING NOTES
S-1	NOTES
S-2	FOUNDATION PLAN, FRAMING PLAN, DETAILS
S-3	GENERAL DETAILS

PROJECT LEGEND	
ZONING INFORMATION:	PROJECT ADDRESS:
ZONING: INDUSTRIAL GENERAL ASSESSMENT NO. 114-152-16	21900 PACIFIC COAST HWY, HUNTINGTON BEACH, CA 92646
LEGAL DESCRIPTION:	
Legal Desc. T6S R11W SEC 13 POR OF S1/2 & T6S R11W SEC 24 POR OF N1/2 POSSESSION HELD 100% FOR THE STATE OF CALIFORNIA	
LOT: 2 DOC NO. 199700628491 MAP NO. LL 97-3 LOT AREA: 96,106 SQ.FT.	
PROJECT DATA	
BUILDING AREA:	
LOT AREA: 96,106 SQ.FT.	
PROPOSED 1-CAR GARAGE: 375 SQ.FT.	
STORIES: 1-STORY GARAGE BUILDING HEIGHT: 14'-1"	
DESCRIPTION OF WORK	
1. NEW 375 SQ.FT. 1-CAR GARAGE	

WRITTEN DIMENSIONS ON THESE SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY, AND BE RESPONSIBLE FOR, THE ACCURACY OF ALL DIMENSIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. THE ABOVE DRAWINGS AND SPECIFICATIONS AND IDEAS, DESIGNS, AND CONCEPTS ARE THE PROPERTY OF THE ENGINEER, AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY OTHER WORK DEVELOPED WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

DATE:	JUL. 12, 2024
JOB NO.	
DESIGNED BY:	NADIA DOKSHINA
REVISIONS	BY

NEW 1-CAR GARAGE

21900 PACIFIC COAST HWY,  
HUNTINGTON BEACH, CA 92646

PROJECT CONSULTANTS	
ARCHITECTURAL:	STRUCTURAL ENGINEER:
NADIA DOKSHINA TEL: (213) 453-1897 n.dokshina@gmail.com	ANDRANIK PAPAZYAN TEL: (818) 500-0333 apexstructuralengineering@gmail.com
APPLICABLE CODES	
ALL WORK SHALL COMPLY WITH THE FOLLOWING CODES INCLUDING LOCAL AMENDMENTS	
2022 CALIFORNIA BUILDING CODE (CBC) 2022 CALIFORNIA RESIDENTIAL CODE 2022 CALIFORNIA ELECTRICAL CODE (CEC) 2022 CALIFORNIA MECHANICAL CODE (CMC) 2022 CALIFORNIA PLUMBING CODE (CPC) 2022 CALIFORNIA ENERGY CODE (TITLE 24, PART 6) 2022 CALIFORNIA HISTORICAL BUILDING CODE 2022 CALIFORNIA FIRE CODE (CFC) 2022 CALIFORNIA EXISTING BUILDING CODE 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE (CGBC)	

SITE PLAN	
SHEET NUMBER:	
A-1.0	
SHEET 1 OF 7	



NOTES	STRUCTURAL GENERAL NOTES
<div><div>1. FIELD WELDING TO BE DONE BY WELDERS MUST BE CERTIFIED BY THE L. A. CITY BUILDING DEPARTMENT. FOR STRUCTURAL STEEL, CONTINUOUS INSPECTION BY A DEPUTY INSPECTOR IS REQUIRED.</div><div>2. LICENSED FABRICATOR IS REQUIRED FOR STRUCTURAL STEEL.</div><div>3. SOLID BLOCKING SHALL BE PROVIDED AT ALL HORIZONTAL JOINTS OCCURRING IN BRACED WALL PANELS.</div><div>4. PLATE WASHERS ARE REQUIRED FOR ALL HOLD DOWNS.</div><div>5. PROVIDE RAIN GUTTERS AND CONVEY RAIN WATER TO THE STREET OR ALLEY.</div><div>6. FOUNDATION SILLS SHALL BE NATURALLY DURABLE OR PRESERVATIVE--TREATED WOOD.</div><div>7. ALL BOLT HOLES SHALL BE DRILLED 1/32" TO 1/16" OVERSIZED.</div><div>8. ALL DIAPHRAGM AND SHEAR WALL NAILING SHALL UTILIZE COMMON OR GALVANIZED BOX NAILS.</div><div>9. CONTRACTORS RESPONSIBLE FOR THE CONSTRUCTION OF A WIND OR SEISMIC FORCE RESISTING SYSTEM/COMPONENT LISTED IN THE "STATEMENT OF SPECIAL INSPECTION" SHALL SUBMIT A WRITTEN STATEMENT OF RESPONSIBILITY TO THE LADBS INSPECTORS AND THE OWNER PRIOR TO THE COMMENCEMENT OF WORK ON SUCH A SYSTEM OR COMPONENT PER SEC. 1706.1</div><div>10. EVERY SPACE INTENDED FOR HUMAN OCCUPANCY SHALL BE PROVIDED WITH NATURAL LIGHT BY MEANS OF EXTERIOR GLAZED OPENINGS IN ACCORDANCE WITH SECTION 1205.2 OR SHALL BE PROVIDED WITH ARTIFICIAL LIGHT THAT IS ADEQUATE TO PROVIDE AN AVERAGE ILLUMINATION OF 10MFOOT CANDLES OVER THE AREA OF THE ROOM AT A HEIGHT OF 30 INCHES ABOVE THE FLOOR.</div><div>11. HOLD--DOWN CONNECTOR BOLTS INTO WOOD FRAMING REQUIRE APPROVED PLATE WASHERS AND HOLD--DOWNS SHALL BE TIGHTENED JUST PRIOR TO COVERING THE WALL FRAMING. CONNECTOR BOLTS INTO WOOD FRAMING REQUIRE STEEL PLATE WASHERS IN ACCORDANCE WITH TABLE 2306.5 OF THE LA BUILDING CODE</div><div>12. ROOF NAILING TO BE INSPECTED BEFORE COVERING. FACE GRAIN PLYWOOD SHALL BE PERPENDICULAR TO SUPPORTS. FLOOR SHALL HAVE TONGUE AND GROOVE OR BLOCKED PANEL EDGES. PLYWOOD SPANS SHALL CONFORM TO TABLE 2304.7</div><div>13. HOLD--DOWN HARDWARE MUST BE SECURED IN PLACE PRIOR TO FOUNDATION INSPECTION.</div><div>14. A COPY OF THE EVALUATION REPORT AND/OR CONDITIONS OF LISTING SHALL BE MADE AVAILABLE AT THE JOB SITE.</div><div>15. CONTINUOUS SPECIAL INSPECTION BY A REGISTERED DEPUTY INSPECTOR IS REQUIRED FOR FIELD WELDING, CONCRETE OVER 2500 PSI, HIGH STRENGTH BOLTING, SPRAY ON FIREPROOFING, ENGINEERED MASONRY, HIGH LIFT GROUTING, PRE--STRESSED CONCRETE, HIGH LOAD DIAPHRAGMS AND SPECIAL MOMENT RESISTING CONCRETE FRAMES.</div><div>16. GLUE LAM BEAMS MUST BE FABRICATED IN A LADBS LICENSED SHOP. IDENTIFY GRADE SYMBOL AND LAMINATION SPECIES PER T 5--A, 2005 NDS SUPP.</div><div>17. PROVIDE LEAD HOLE 40% TO 70% OF THREADED SHANK DIA. AND FULL DIA. FOR SMOOTH SHANK PORTION.</div><div>18. PERIODIC SPECIAL INSPECTION IS REQUIRED FOR WOOD SHEAR WALLS AND DIAPHRAGMS, INCLUDING NAILING, BOLTING, ANCHORING AND OTHER FASTENING TO COMPONENTS OF THE SEISMIC FORCE RESISTING SYSTEM. SPECIAL INSPECTION BY A DEPUTY INSPECTOR IS REQUIRED WHERE THE FASTENER SPACING OF THE SHEATHING IS 4 INCHES ON CENTER OR LESS.</div><div>19. PLUMBING FIXTURES ARE REQUIRED TO BE CONNECTED TO A SANITARY SEWER OR TO AN APPROVED SEWAGE DISPOSAL SYSTEM.</div><div>20. KITCHEN SINKS, LAVATORIES, BATHTUBS, SHOWERS, BIDETS, LAUNDRY TUBS AND WASHING MACHINE OUTLETS SHALL BE SUPPLIED WITH HOT AND COLD WATER AND CONNECTED TO AN APPROVED WATER SUPPLY.</div><div>21. PROVIDE (70) (72) INCH HIGH NON--ABSORBENT WALL ADJACENT TO SHOWER AND APPROVED SHATTER--RESISTANT MATERIALS FOR SHOWER ENCLOSURE.Ø (1210.2.3, 2406.4.5, R307.2, R308.4)</div><div>22. BATHTUB AND SHOWER FLOORS, WALLS ABOVE BATHTUBS WITH A SHOWER HEAD, AND SHOWER COMPARTMENTS SHALL BE FINISHED WITH A NON ABSORBENT SURFACE. SUCH WALL SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FEET ABOVE THE FLOOR(R307.2).</div><div>23. WHERE A PERMIT IS REQUIRED FOR ALTERATIONS, REPAIRS OR ADDITIONS EXCEEDING ONE THOUSAND DOLLARS (\$1000) EXISTING DWELLINGS OR SLEEPING UNITS THAT HAVE ATTACHED GARAGES OR SLEEPING UNITS THAT HAVE ATTACHED GARAGES OR FUL BURNING APPLIANCES SHALL BE PROVIDED WITH A CARBON MONOXIDE ALARM IN ACCORDANCE WITH SECTION R315.1. CARBON MONOXIDE ALARMS SHALL ONLY BE REQUIRED IN THE SPECIFIC DWELLING UNIT OR SLEEPING UNIT FOR WITH THE PERMIT WAS OBTAINED.</div><div>24. IN COMBUSTIBLE CONSTRUCTION, FIRE BLOCKING SHALL BE PROVIDED TO CUT OFF ALL CONCEALED DRAFT OPENINGS (BOTH VERTICAL AND HORIZONTAL) AND FORM AN EFFECTIVE FIRE BARRIER BETWEEN STORIES, AND BETWEEN A TOP STORY AND THE ROOF STRUCTURE.</div><div>25. SPRINKLER SYSTEM MUST BE APPROVED BY THE MECHANICAL DIVISION PRIOR TO INSTALLATION.</div><div>26. A FIRE ALARM (VISUAL AND AUDIBLE) SYSTEM IS REQUIRED. THE ALARM SYSTEM MUST BE APPROVED BY THE FIRE DEPARTMENT AND ELECTRICAL PLAN CHECK PRIOR TO INSTALLATION. (LAMC 57.122)</div><div>27. CARBON MONOXIDE ALARM IS REQUIRED PER (SEC.420.6, R315)</div><div>28. VEHICULAR ACCESS DOORS SHALL COMPLY WITH SECTION R612.4</div></div> <div><div>SECURITY NOTES</div><div>ALL OPENINGS MARKED * ARE SECURITY OPENINGS AND THE FOLLOWING NOTES SHALL APPLY:<div><div>1. SWINGING DOORS</div><div>a. DOOR STOPS OF IN--SWINGING DOOR SHALL BE ON ONE PIECE CONSTRUCTIONS WITH THE JAMB OR JOINED BY RABBIT TO JAMB. WOOD PLUSH TYPE DOORS SHALL BE 1--3/8" THICK MIN. W/SOLID CORE CONSTRUCTION.</div><div>b. THE STRIKE PLATE FOR LATCHES AND THE HOLDING DEVICE FOR PROJECTING DEAD BOLTS IN WOOD CONSTRUCTION SHALL BE SECURED TO HE JAMB AND THE WALL FRAMING WITH SCREWS NOT LESS THAN 2--1/2 IN LENGTH.</div><div>c. DEAD BOLTS ON EXIT DOORS SHALL BE OPERABLE FROM THE INSIDE WITHOUT A KEY OR ANY SPECIAL KNOWLEDGE OR EFFORT BY MEANS OF A LEVER OR LARGE THUMB TURN.</div><div>d. MANUALLY OPERATED DEAD BOLTS, SURFACE MOUNTED FLUSH BOLTS AND SURFACE BOLTS ARE PROHIBITED.</div><div>e. DEAD BOLTS SHALL BE MOUNTED WITHIN 48" ABOVE THE FINISH DOOR.</div><div>f. DEAD BOLTS SHALL CONTAIN HARDENED INSERTS.</div><div>g. DEAD BOLTS SHALL HAVE A MINIMUM THROW OF 1" AND AN EMBEDMENT OF NOT LESS THAN 5/8".</div><div>h. WHERE HINGE PINS ARE OUTSIDE THE SECURED AREA USE NON--REMOVABLE PINS AND 1/4" DIA.STL. JAMB STUDS WITH 1/4" PROJECTION.</div><div>2. CYLINDER GUARDS SHALL BE INSTALLED ON ALL CYLINDER LOCKS WHEREVER THE CYLINDER PROJECTS BEYOND THE FACE OF THE DOOR OR IS OTHERWISE ACCESSIBLE TO GRIPPING TOOLS.</div><div>3. SLIDING GLASS DOORS AND WINDOWS SHALL BE EQUIPPED WITH LOCKING DEVICES AND SHALL BE SO CONSTRUCTED AND INSTALLED THAT THEY REMAIN INTACT AND ENGAGED WHEN SUBJECTED TO THE TESTS SPECIFIED IN SECTION 6706.</div><div>4. SLIDING DOOR AND WINDOWS SHALL BE PROVIDED WITH A DEVICE IN THE UPPER CHANNEL OF THE MOVING PANEL TO PROHIBIT RAISING AND REMOVING OF THE MOVING PANEL IN THE CLOSED OR PARTIALLY OPEN POSITION.</div><div>5. ALL OTHER WINDOWS SHALL BE EQUIPPED WITH LOCKING DEVICES AND SHALL BE SO CONSTRUCTED AND INSTALLED THAT THEY REMAIN INTACT AND ENGAGED WHEN SUBJECTED TO THE TESTS SPECIFIED IN 6707.</div><div>6. GLAZED OPENINGS WITHIN 40 INCHES OF THE REQUIRED LOCKING DEVICES OF SWINGING DOOR, WHEN SAID DOOR IS IN THE CLOSED AND LOCKED POSITION SHALL BE FULLY TEMPERED GLASS, CONFORMING TO THE PROVISIONS OF CHAPTER 54 OF THE CODE.</div></div></div></div> <div><div>GENERAL</div><div><div>1. ALL CONSTRUCTIONS SHALL CONFORM TO THE CURRENT UNIFORM BUILDING CODE UNLESS MORE STRINGENT REQUIREMENTS ARE REQUIRED IN THE PLANS AND SPECIFICATIONS.</div><div>2. THE CONTRACTORS SHALL VERIFY IN THE FIELD ALL CONDITIONS, ELEVATIONS AND DIMENSIONS BEFORE STARTING WORK. THE ARCHITECT AND STRUCTURAL ENGINEER SHALL BE NOTIFIED IMMEDIATELY IF ANY DISCREPANCIES ARE FOUND.</div><div>3. THE CONTRACTOR SHALL INFORM THE ARCHITECT IN WRITING OF ANY DISCREPANCIES OR OMISSIONS NOTED ON THE DRAWINGS OR IN THE SPECIFICATIONS, OR OF ANY VARIATIONS NEEDED IN ORDER TO CONFORM TO CODES, RULES AND REGULATIONS. UPON RECEIPT OF SUCH INFORMATION, THE ENGINEER WILL SEND WRITTEN INSTRUCTIONS TO ALL CONCERNED, AND WORK SHALL BE PERFORMED IN A MANNER AS DIRECTED BY THE ENGINEER. ANY SUCH DISCREPANCY, OMISSION OR VARIATION NOT REPORTED, SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.</div><div>4. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO PROVIDE TEMPORARY BRACES, SHORES AND GUYS, WHEREVER NECESSARY TO SUPPORT ALL LOADS TO WHICH THE STRUCTURE MAY BE SUBJECTED DURING CONSTRUCTION, INCLUDING ERECTION EQUIPMENT AND ITS OPERATION. THIS TEMPORARY SUPPORT SYSTEM SHALL HOLD ALL ELEMENTS AND PERMANENT BRACING ELEMENTS.</div><div>5. THE TYPICAL NOTES AND DETAILS SHALL APPLY IN ALL CASES UNLESS SPECIFIC DETAILS OCCUR ELSEWHERE. WHERE NO DETAIL IS SHOWN, CONSTRUCTION SHALL BE AS FOR SIMILAR WORK.</div><div>6. REFER TO ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS OF LOCATION OF OPENINGS OR SUPPORTS FOR THEIR RESPECTIVE ITEMS. NOTIFY ARCHITECT PRIOR TO CONSTRUCTION OF ANY INTERFERENCE OR INCOMPATIBILITY.</div></div><div><div>CONCRETE</div><div><div>1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH IN 28 DAYS EQUAL TO: 2500 P.S.I. FOR SLAB AND FOOTINGS AND 3000 P.S.I. FOR GRADE BEAMS. CONTINUOUS INSPECTION REQUIRED FOR ALL CONCRETE DESIGNED W/ F'C GREATER THAN 2500 P.S.I.</div><div>2. ALL CONCRETE SHALL BE NORMAL WEIGHT (145 PCF)</div><div>3. PORTLAND CEMENT: ASTM C150</div><div>C. REINFORCING STEEL FOR CONCRETE</div><div><div>1. REINFORCING BARS ASTM A615 GRADE 40.</div><div>2. WELDED WIRE FABRIC: ASTM A285</div><div>3. MINIMUM SPLICE LENGTHS, UNLESS DETAILED OTHERWISE.</div></div><div>a. CONCRETE -- 36 DIAMETERS</div><div>b. WELDED WIRE FABRIC SHALL BE SPLICED WITH A MINIMUM LAP OF 12 INCHES.</div></div><div><div>LUMBER</div><div><div>1. ALL LUMBER SHALL BE DOUGLAS FIR, NORTH REGIONS, UNLESS NOTED OTHERWISE.</div><div>2. ALL FRAMING LUMBER SHALL BE S4S AND STRESS GRADED AS SHOWN BELOW UNLESS NOTED OTHERWISE.</div></div><div>a. JOISTS AND RAFTERS #2 GRADE</div><div>b. 4 X BEAMS #1 GRADE</div><div>c. 4 X BEAMS (WHERE NOTED ON PLANS) SEL. STR</div><div>d. 6 X BEAMS #1 GRADE</div><div>e. 6 X BEAMS (WHERE NOTED ON PLANS) SEL. STR</div><div>f. STUDS STANDARD OR BETTER.</div><div>3. PLYWOOD SHEATHING (U.S. PS 1--95) WITH EXTERIOR GLUE AND APA RATED.</div><div>4. ALL WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED</div><div>5. ALL NAILING SHALL BE IN ACCORDANCE WITH UNIFORM BUILDING CODE REQUIREMENTS UNLESS OTHERWISE NOTED ON THE DRAWINGS. USE COMMON WIRE NAILS. NAILING OF ROOF AND FLOOR SHEATHING SHALL BE INSPECTED AND APPROVED BY THE BUILDING DEPARTMENT BEFORE COVERING.</div><div>6. MACHINE APPLIED NAILING SHALL NOT BE USED UNLESS SATISFACTORY INSTALLATION IS DEMONSTRATED ON THE JOB AND ITS USE IS APPROVED BY THE GOVERNING CODE INSPECTORS. APPROVAL IS SUBJECT TO CONTINUED SATISFACTORY PERFORMANCE.</div><div>7. BOLT HOLES IN WOOD SHALL BE 1/32" TO 1/16". LARGER SHALL REQUIRE REPLACEMENT OF LUMBER PIECE.</div><div>8. ALL BOLTS BEARING ON WOOD SHALL HAVE WASHERS.</div><div>9. a.) ALL SILL PLATE BOLTS SHALL BE 5/8" IN DIAMETER, MINIMUM EMBEDMENT 9" LOCATED AT 4'--0" ON CENTER MAXIMUM, UNLESS OTHERWISE NOTED.</div><div>b.) SECURE WOOD LEDGER WITH 1/2" DIAMETER BOLTS AT 2'--0" ON CENTER UNLESS NOTED OTHERWISE.</div><div>c.) THE END STUD OF ALL PARTITIONS ABUTTING MASONRY OR CONCRETE SHALL BE ANCHORED WITH 1/2" DIAMETER BOLTS AT TOP, BOTTOM AND 4'--0" ON CENTER.</div><div>d.) ALL WOOD MEMBERS SHALL HAVE AN ANCHOR BOLT BETWEEN 6 TO 9 INCHES FROM EACH END. LENGTH OF ANCHOR BOLTS SHALL BE SUFFICIENT TO GRIP FULL NUT AND BE ANCHORED AT LEAST 6" PLUS HOOK INTO MASONRY AND CONCRETE.</div><div>10. CONNECTOR DESIGNATIONS REFER TO STRONG--TIE CONNECTORS BY SIMPSON COMPANY, BREA, CALIFORNIA, UNLESS NOTED OTHERWISE. SPECIAL NAILS OF THE SAME DIAMETER AND PENETRATING INTO THE SUPPORT ONE HALF OF THE LENGTH CALLED FOR, MAY BE USED WITH SIMPSON METAL CONNECTORS.</div><div>11. NAIL ALL 2X DOUBLE JOISTS WITH 16D NAILS @ 9" ON CENTER.</div><div>12. PROVIDE DOUBLE JOIST UNDER ALL PARALLEL PARTITIONS.</div><div>13. PROVIDE 2" FIRE BLOCKING IN STUD WALLS AT MAXIMUM VERTICAL SPACING PERMITTED BY GOVERNING CODE AT ALL CEILING LINES.</div><div>14. FOR SIZE AND LOCATION OF ROOF, FLOOR AND WALL OPENING, SEE ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS. FRAME ALL FOUR SIDES OF OPENINGS WITH ADEQUATE MEMBERS AND CONNECTORS.</div><div>15. NON--BEARING WOOD STUD WALLS SHALL BE BRACED ALONG THEIR LENGTH AT LEAST ONCE IN EVERY 25 FEET. THE BRACING SHALL BE A 1 X 4 CONTINUOUS LET--IN BOARD, NAILED TO EVERY STUD AND TO TOP AND BOTTOM PLATES OR SIMPSON 16 GAUGE WEB STRAPS IN EACH DIRECTION (X--BRACING). RUN BRACE DIAGONALLY FROM BOTTOM PLATE TO UPPER TOP PLATE AT AN ANGLE SUFFICIENT TO INCLUDE FOUR NORMAL STUD SPACES FOR EVERY 12 FOOT INCREMENT OF HEIGHT.</div><div>16. PROVIDE DOUBLE STUDS UNDER ALL BEAM ENDS UNLESS NOTED OTHERWISE.</div><div>17. LICENSED FABRICATOR REQUIRED FOR GLU--LAM BEAMS, PARALLEL LAM BEAMS, AND STEEL POSTS, LICENSED BY THE CITY OF L.A.</div><div>18. SOIL TYPE IS SILTY SAND ALLOWABLE SOIL BEARING VALUE IS 1000 P.S.F. @ 24" BELOW GRADE.</div></div></div><div><div>WRITTEN DIMENSIONS ON THESE SHALL HAVE PRECEDENCE OVER SCALED DIMENSION. CONTRACTORS SHALL VERIFY, AND BE RESPONSIBLE FOR ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. THE ABOVE DRAWINGS AND SPECIFICATIONS AND DEAS. DESIGNS SHALL REMAIN THE PROPERTY OF THE ENGINEER, AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY OTHER WORK DEVELOPED WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.</div><div><div><div>PARTNER</div><div>CONSTRUCTION, Inc.</div></div><div><div><div>REGISTERED PROFESSIONAL ENGINEER</div><div>NADIA DOKSHINA</div><div>NO. C 56824</div><div>EXP. 06.30.2025</div><div>CIVIL</div><div>STATE OF CALIFORNIA</div></div></div><div><div>DATE:</div><div>JUL. 11, 2024</div></div><div><div>JOB NO.</div><div></div></div><div><div>DESIGNED BY:</div><div>NADIA DOKSHINA</div></div><div><div>REVISIONS</div><div>BY</div></div><div><div></div><div></div></div><div><div></div><div></div></div><div><div></div><div></div></div><div><div></div><div></div></div><div><div>NEW 1-CAR GARAGE</div><div>21900 PACIFIC COAST HWY , HUNTINGTON BEACH, CA 92646</div></div><div><div>GENERAL NOTES</div><div>SHEET NUMBER:</div><div>A-1.1</div><div>SHEET 2 OF 7</div></div></div></div></div>	



CRRC PROD. ID	MANUFACTURER: BRAND MODEL	PRODUCT TYPE	COLOR	SOLAR REFLECTANCE		THERMAL EMITTANCE		SRI	1	3 year	5 year	MORE INFO
				initial	3 year	initial	3 year					
0676-0043a	GAF: Timberline® Cool Series® Cool Antique Slate	Steep Slope: Asphalt Shingles	Grey	0.28	0.26	0.92	0.91	30	27			+


COOL ROOF RATING COUNCIL 3519 NE 15th Ave, #205 TEL (866) 465-2523 EMAIL: [info@coolroofs.org](mailto:info@coolroofs.org)  
Portland, OR 97212






## ROOF VENTILATION CALCULATIONS

UNDER ROOF AREA (ATTIC SPACE) = 375 SQ.FT.  
TOTAL REQUIRED OPENING  $375/150=2.5$  SQ.FT.  
PROVIDE 4x12"x12" (GALV., NFVA=0.68 SQ.FT.) = 2.72 SQ.FT.  
COPPER GABLE VENTS W/SCREEN BY "FAMCO".  
\*\*\*TOTAL PROVIDED 2.72 SQ. FT.



## ROOF PLAN LEGEND

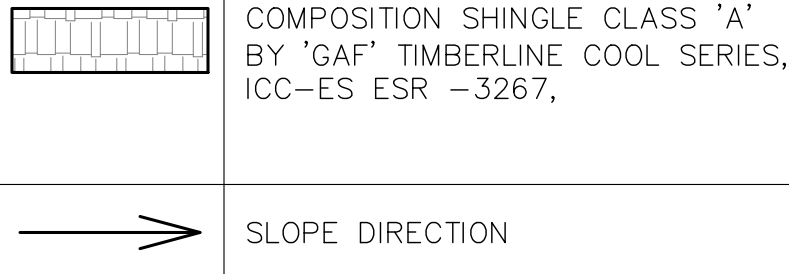


## FLOOR PLAN LEGEND

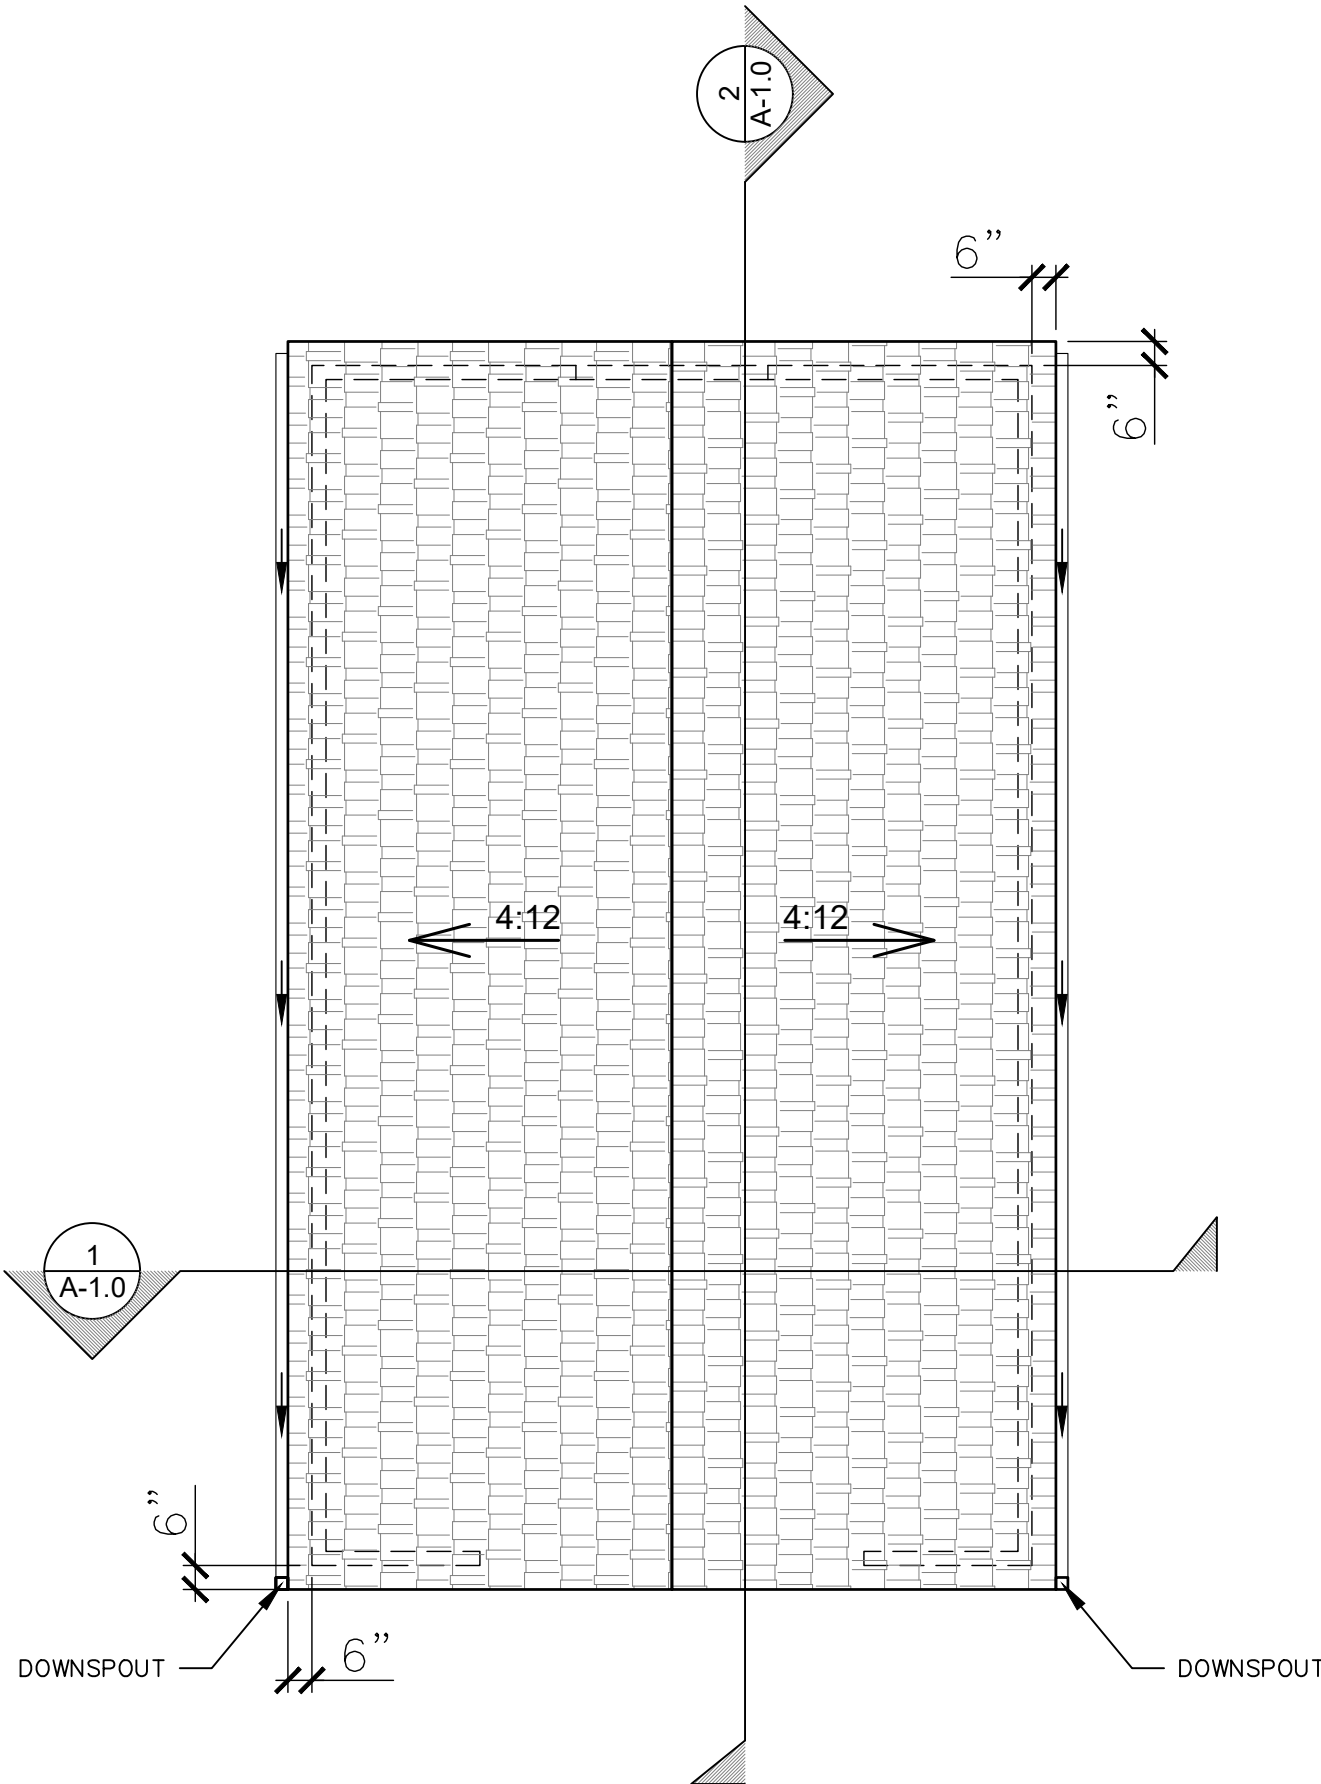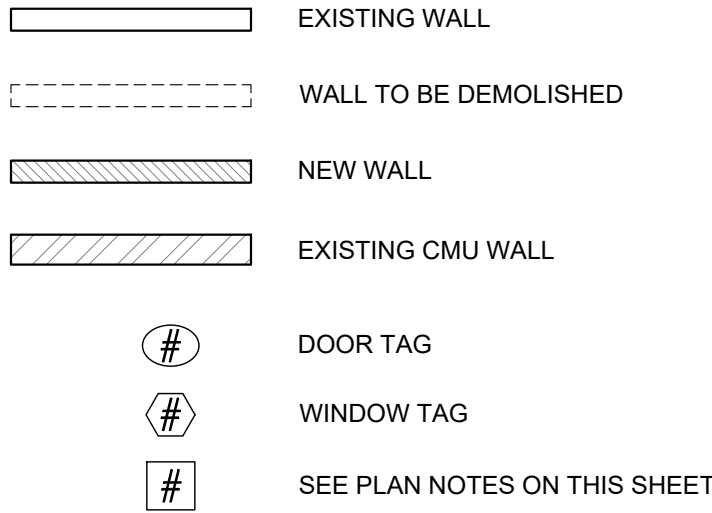

PROPOSED  
ROOF PLAN  
1/4" = 1'-0"

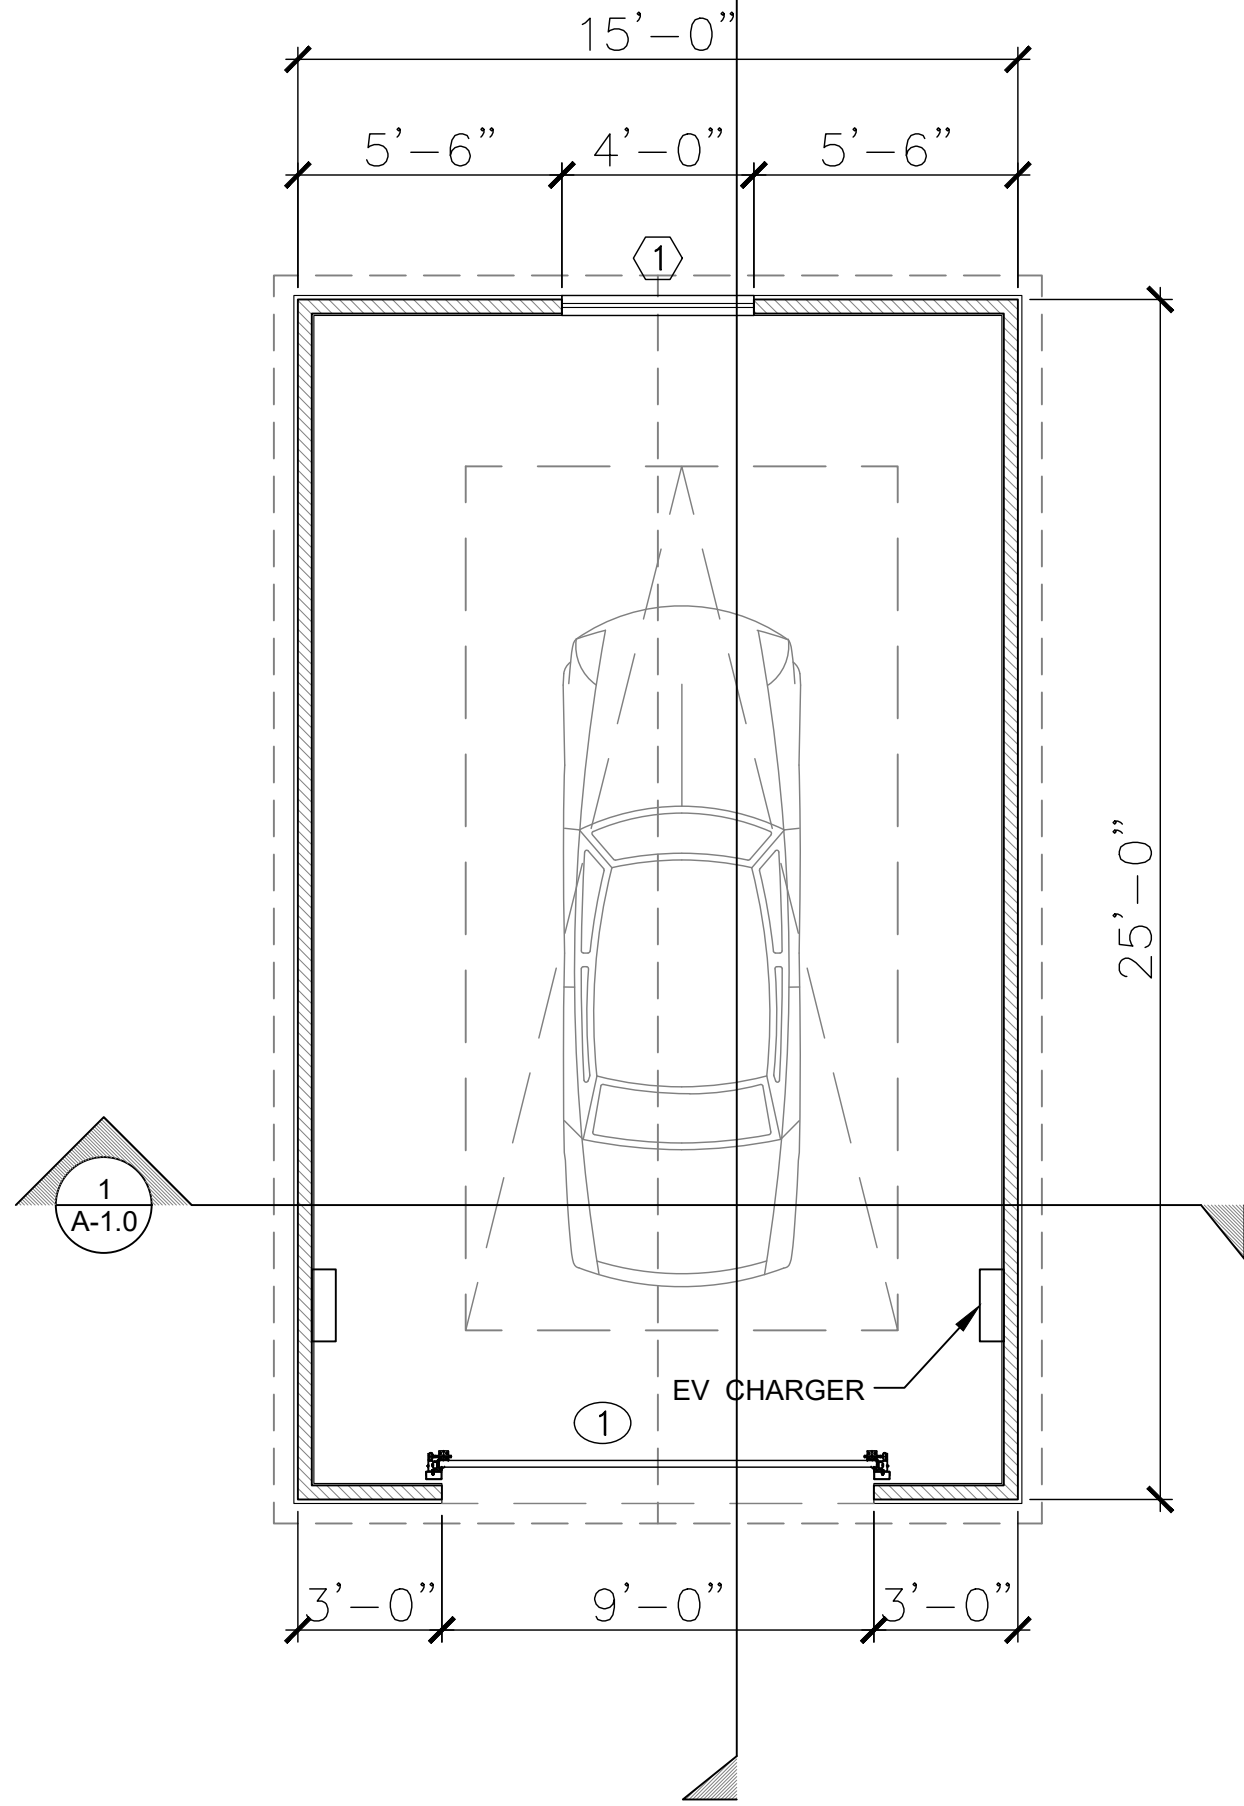


PROPOSED  
FLOOR PLAN  
1/4" = 1'-0"

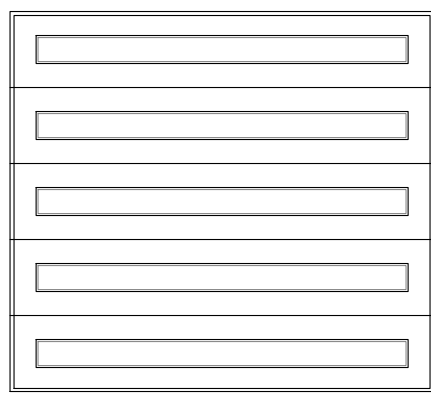


TYPE A

## WINDOW SCHEDULE

WINDOW NO. (1)	TYPE	QUANTITY	WIDE x HEIGHT	COLOR & MATERIAL	TYPE OF OPERATION	VISIBLE FROM STREET ? Y / N	BEDROOM ? Y / N	ENERGY EFFICIENT ? Y / N	TEMPERED GLASS ? Y / N	WINDOW WITHIN 18" OF FLOOR OR 40" OF DOOR ? Y / N
1	A	01	48"x24"	VINYL	SLIDER	NO	NO	NO	YES	NO




TYPE A

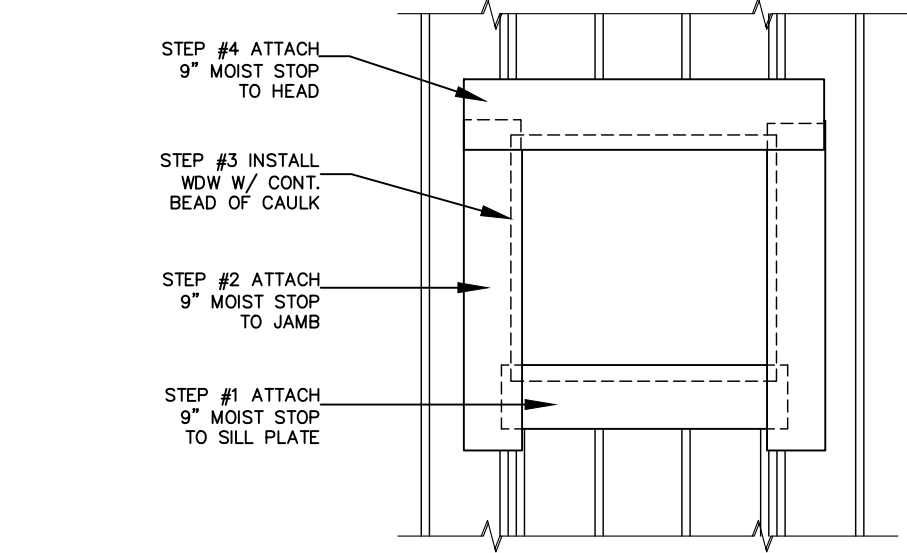


## WINDOW FLASHING DETAIL

1

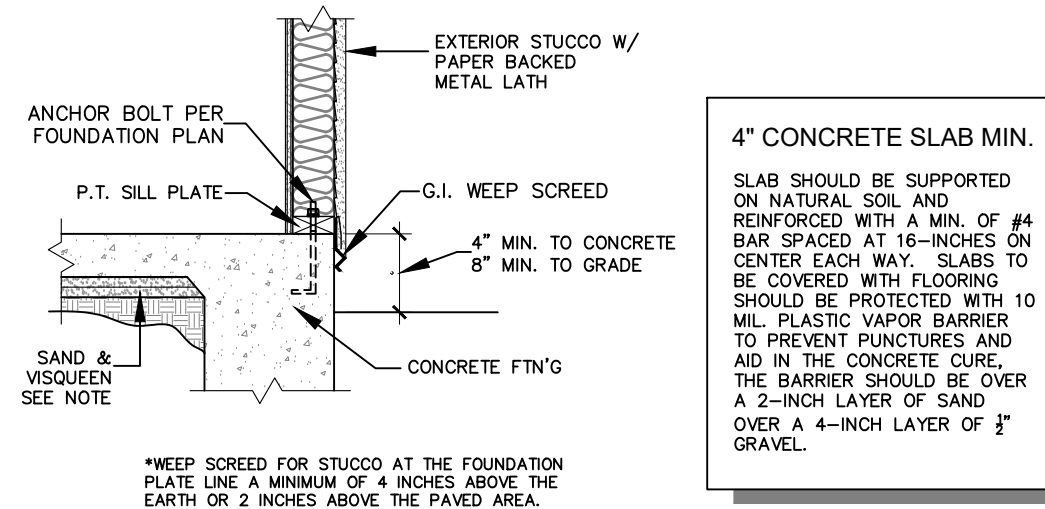


## SLAB ON GRADE DETAIL

2

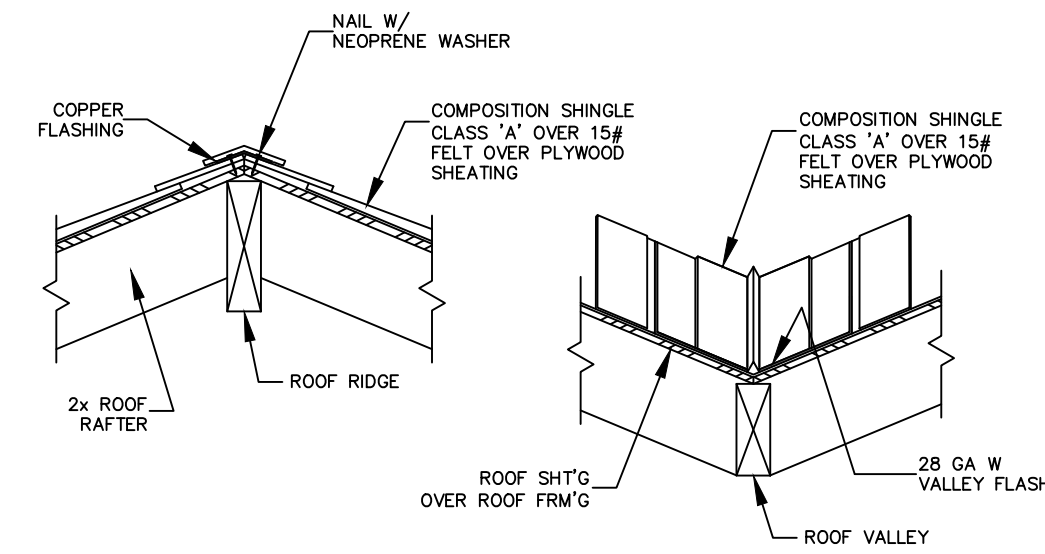

## ROOF RIDGE / VALLEY DETAIL TYP.

3

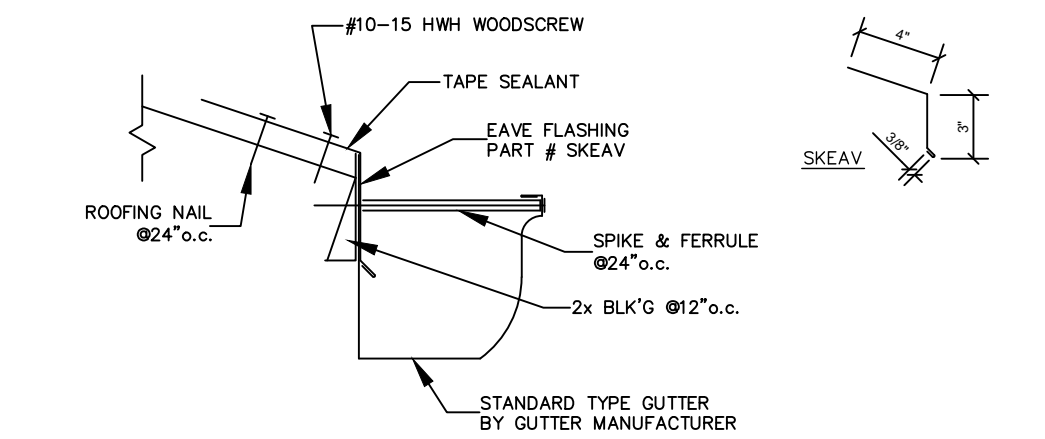


## GUTTER FLASHING DETAIL

4

## DOOR SCHEDULE

DOOR NO. (1)	TYPE	QUANTITY	WIDE X HEIGHT	THICKNESS	COLOR & MATERIAL	TYPE OF OPERATION	ENERGY EFFICIENT ? Y / N	TEMPERED GLASS ? Y / N	REMARKS
1	A	01	108"x96"	1 3/4"	VINYL/GLASS	ROLL-UP	YES	YES	GARAGE DORR WITH TEMPERED GLASS

WRITTEN DIMENSIONS ON THESE SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY, AND BE RESPONSIBLE FOR, THE ACCURACY OF ALL DIMENSIONS. THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS, THE ABOVE DRAWINGS AND SPECIFICATIONS AND DEAS. DESIGNS SHALL REMAIN THE PROPERTY OF THE ENGINEER, AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY OTHER WORK DEVELOPED WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

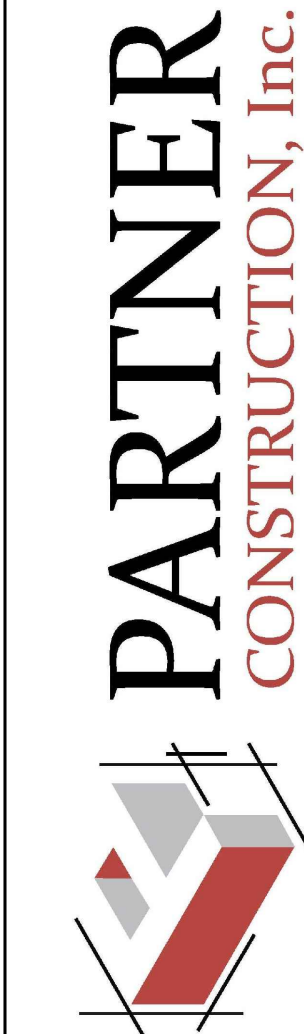

DATE:  
JUL 12, 2024

JOB NO. \_\_\_\_\_

DESIGNED BY:  
NADIA DOKSHINA

REVISIONS BY

NEW 1-CAR GARAGE

21900 PACIFIC COAST HWY,  
HUNTINGTON BEACH, CA 92646

FLOOR &  
ROOF PLANS

SHEET NUMBER:

A-2.0

SHEET 3 OF 7

## ROOF NOTES


INSTALLATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

## ELEVATION NOTES

PROVIDE ANTI-GRAFFITI FINISH WITHIN THE FIRST 9 FEET, MEASURED FROM GRADE, AT EXTERIOR WALLS AND DOORS. EXCEPTION: MAINTENANCE OF BUILDING AFFIDAVIT IS RECORDED BY THE OWNER TO COVENANT AND AGREE WITH THE CITY OF LOS ANGELES TO REMOVE ANY GRAFFITI WITHIN 7-DAYS OF THE GRAFFITI BEING APPLIED. (6306).


## ELEVATIONS KEYNOTES

- |   |   |   |  |
|---|---|---|--|
| 1 | COMPOSITION SHINGLE CLASS 'A'   | 4 | A CORROSION WEEP SCREED, MIN. 26 GA. GALV. SHEET, IS REQUIRED BELOW THE STUCCO AT THE FOUNDATION PLATE LINE A MIN. 4" ABOVE EARTH OR 2" ABOVE PAVED AREA WITH A VERTICAL ATTACHMENT FLANGE OF 3/8-1/2". WEEP SCREEDS SHALL BE OF A TYPE WHICH WILL ALLOW TRAPPED WATER TO DRAIN TO EXTERIOR TO THE BUILDING. |
| 2 | STUCCO FINISH (TO MATCH EXISTING) 7/8" THK. 3-COAT PLASTER W/METAL MESH OVER LAPPED 2-LAYERS OF GRADE "D" BUILDING PAPER. | 5 | LIGHT FIXTURE  |
| 3 | DOORS AND WINDOWS PER SCHEDULE  | 6 | 12x12" COPPER GABLE VENTS W/SCREEN BY "FAMCO".   |

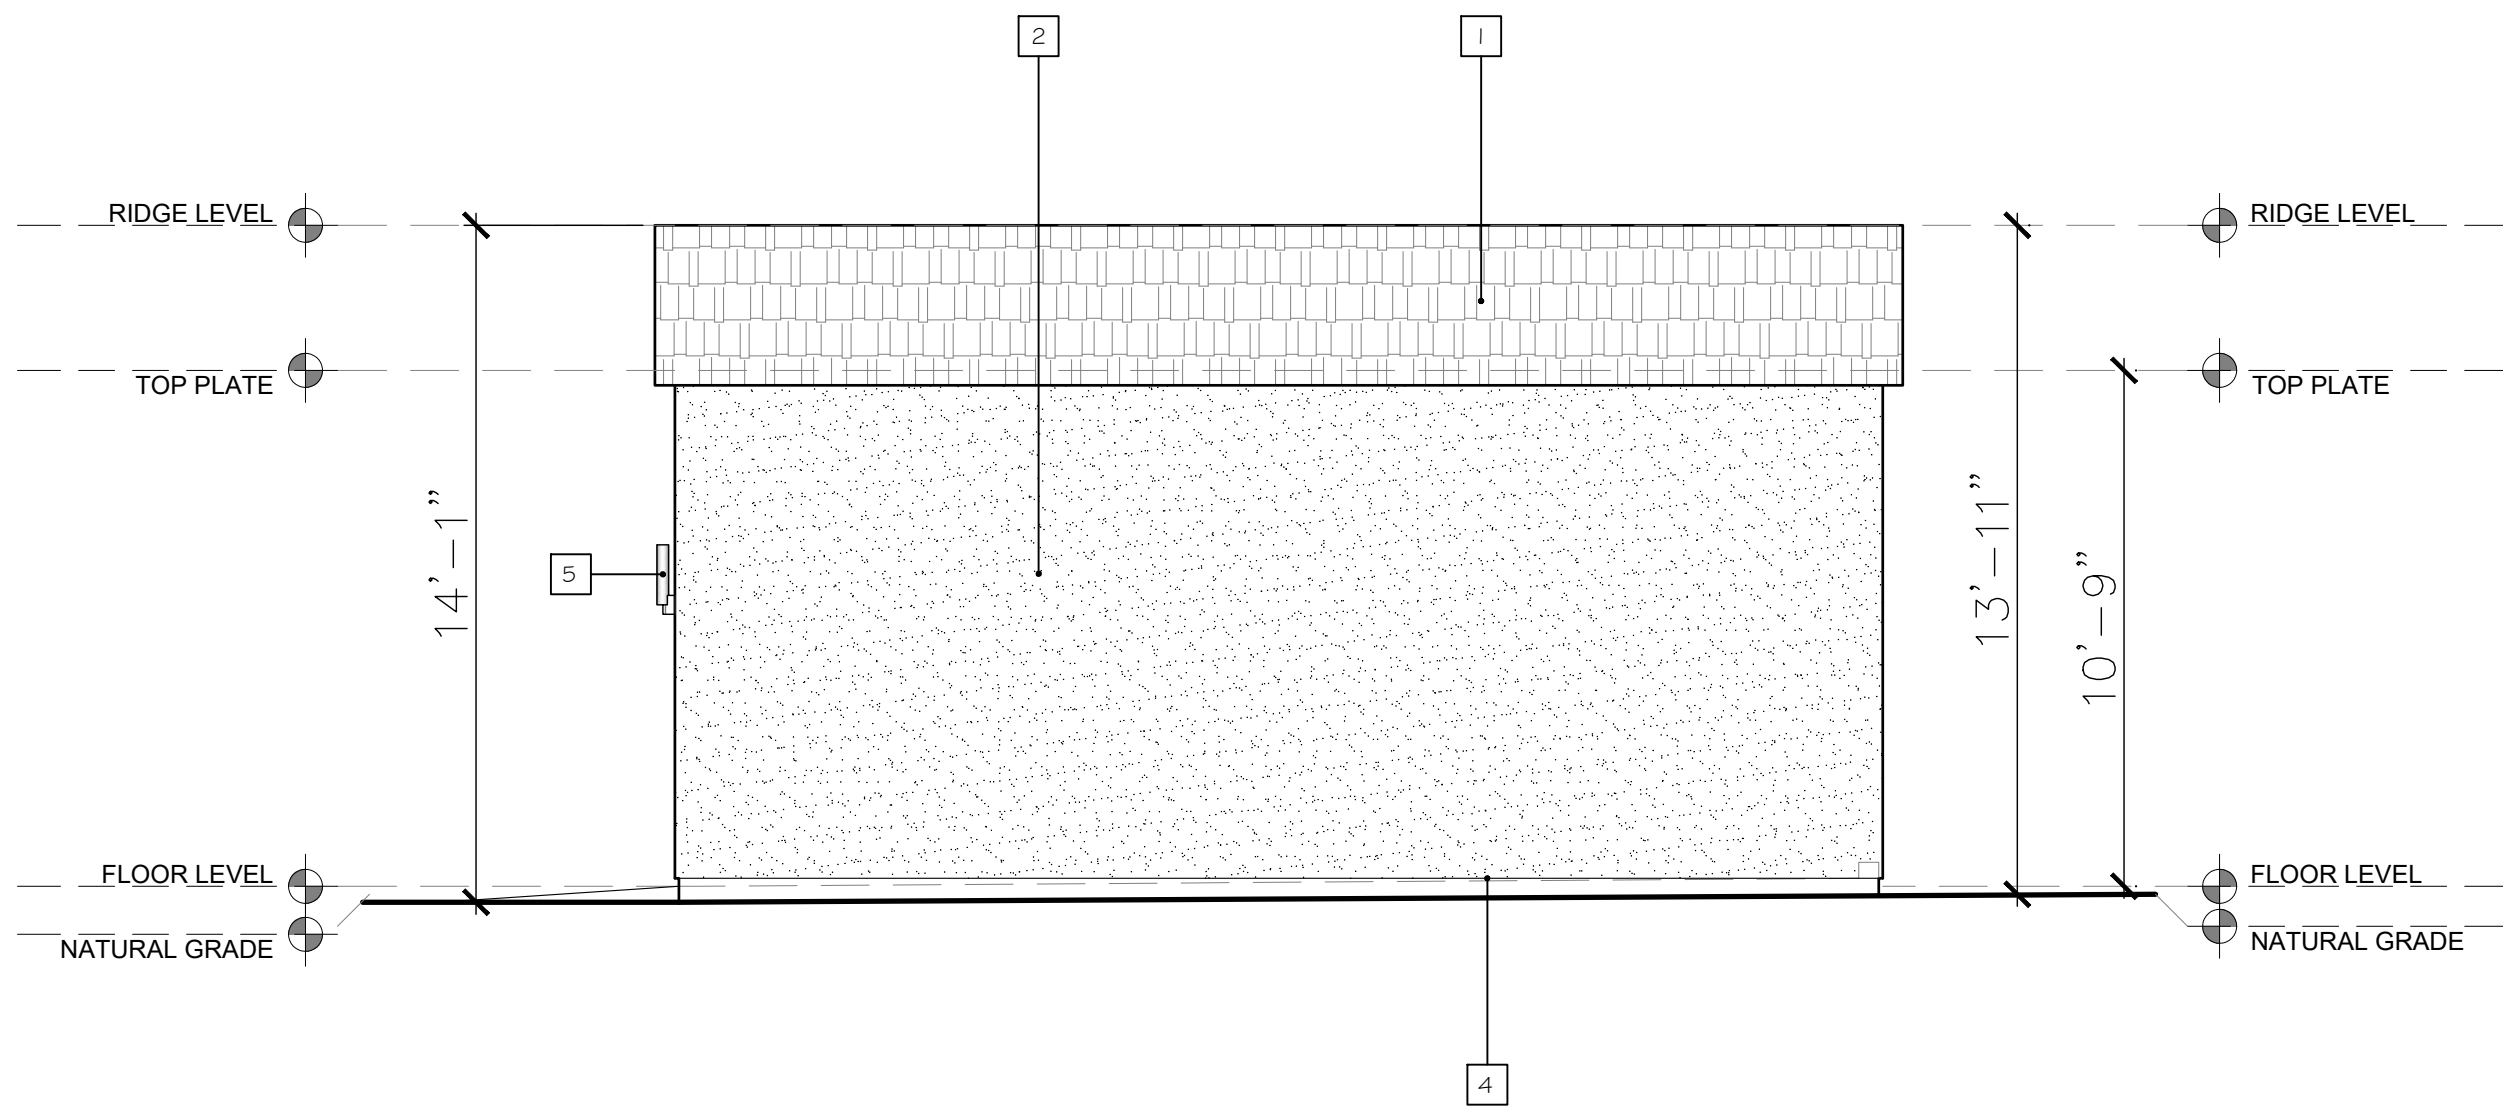

SOUTH-EAST ELEVATION / NORTH-WEST

1/4" = 1'-0"

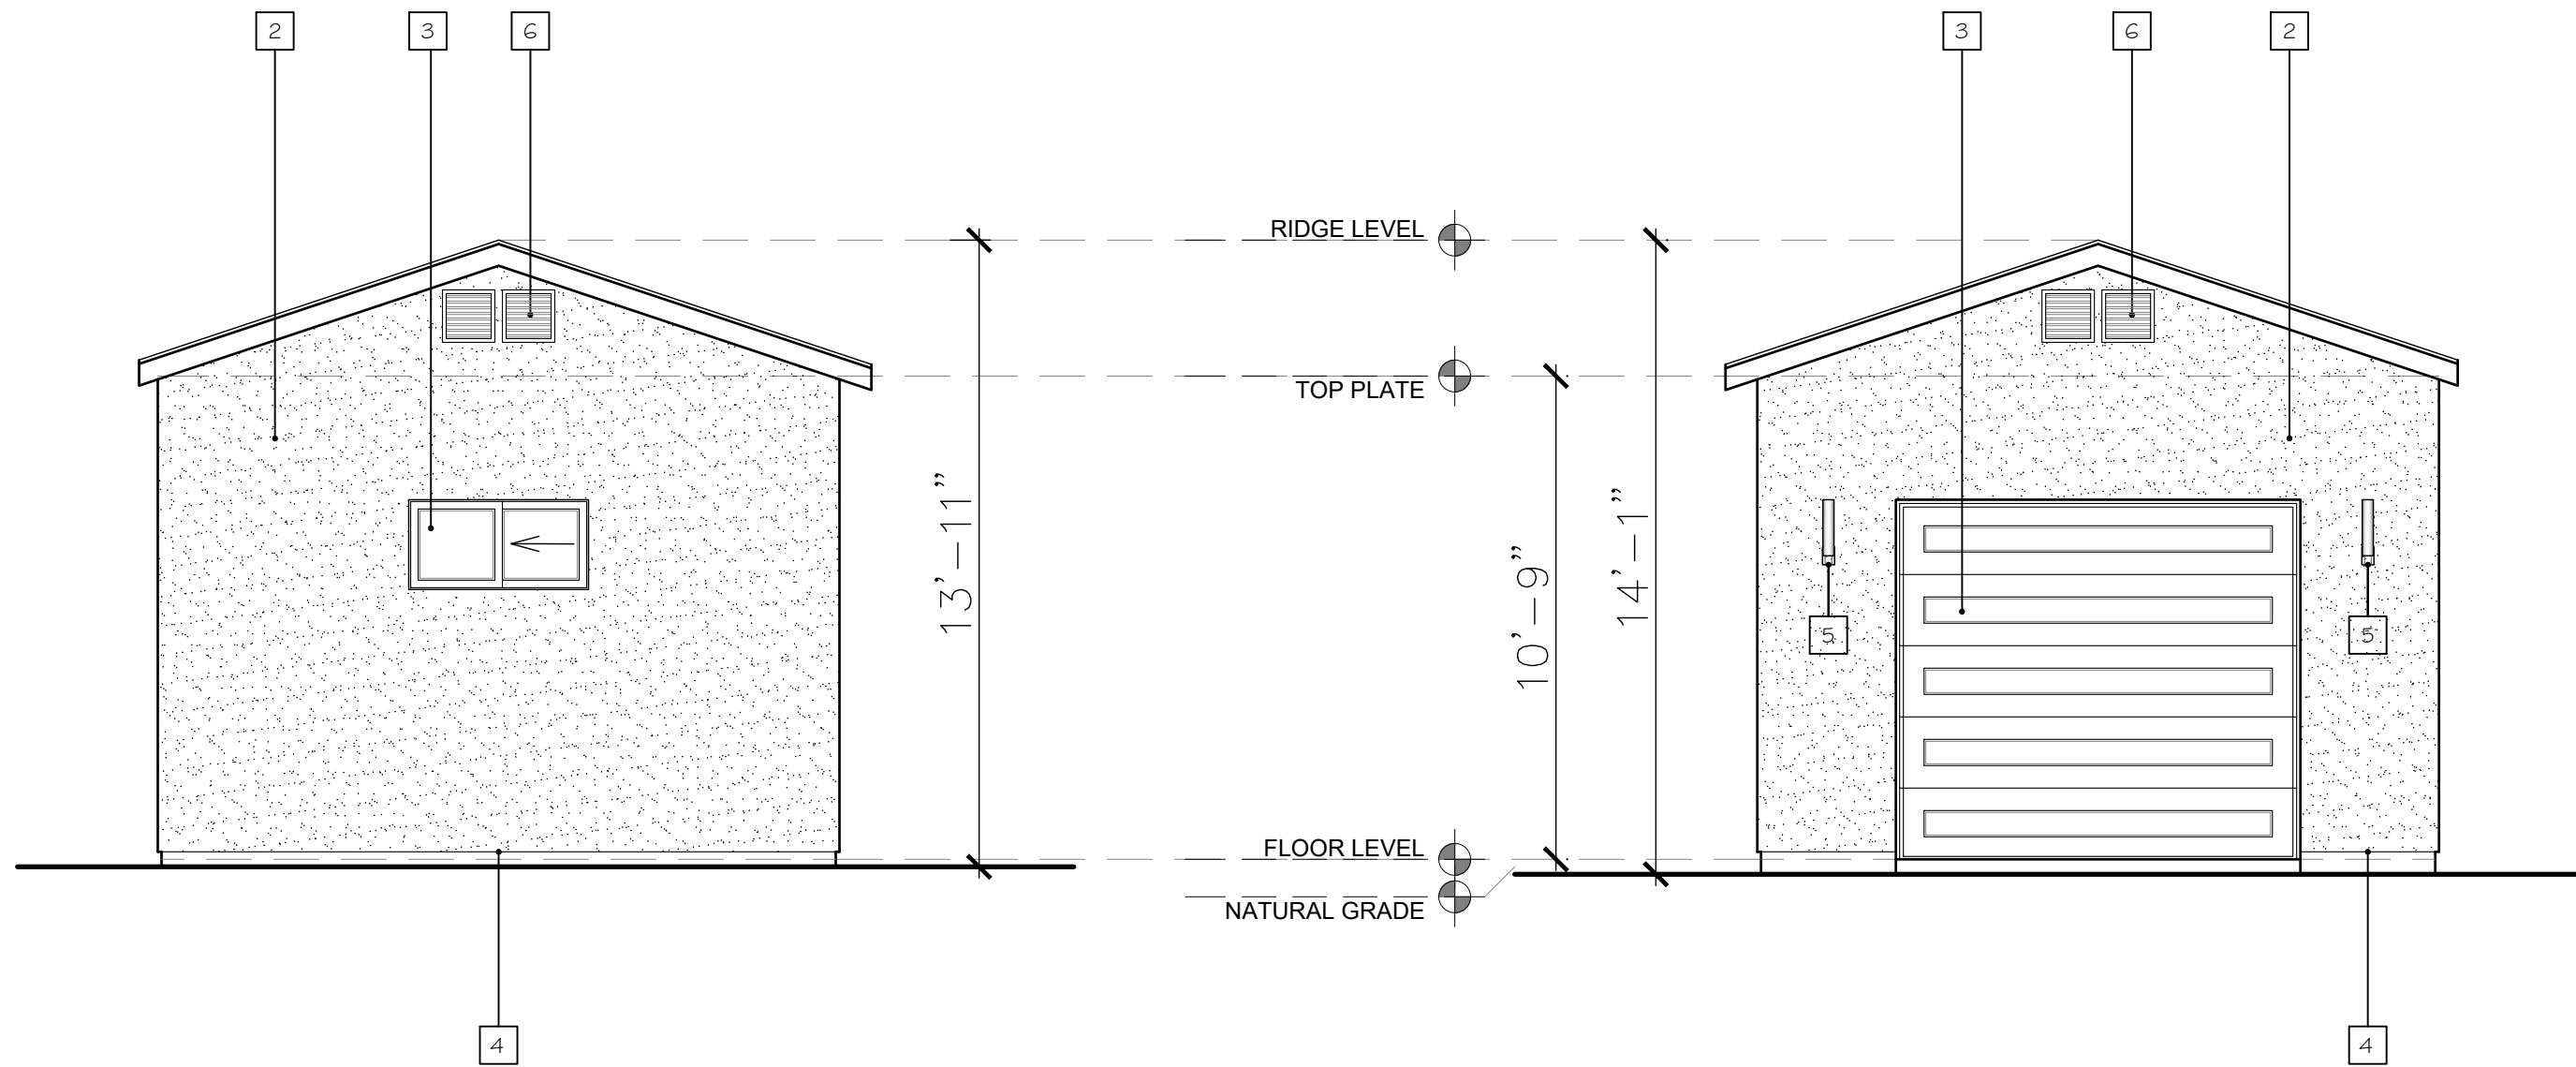


NORTH-EAST ELEVATION

1/4" = 1'-0"


SOUTH-WEST ELEVATION

1/4" = 1'-0"

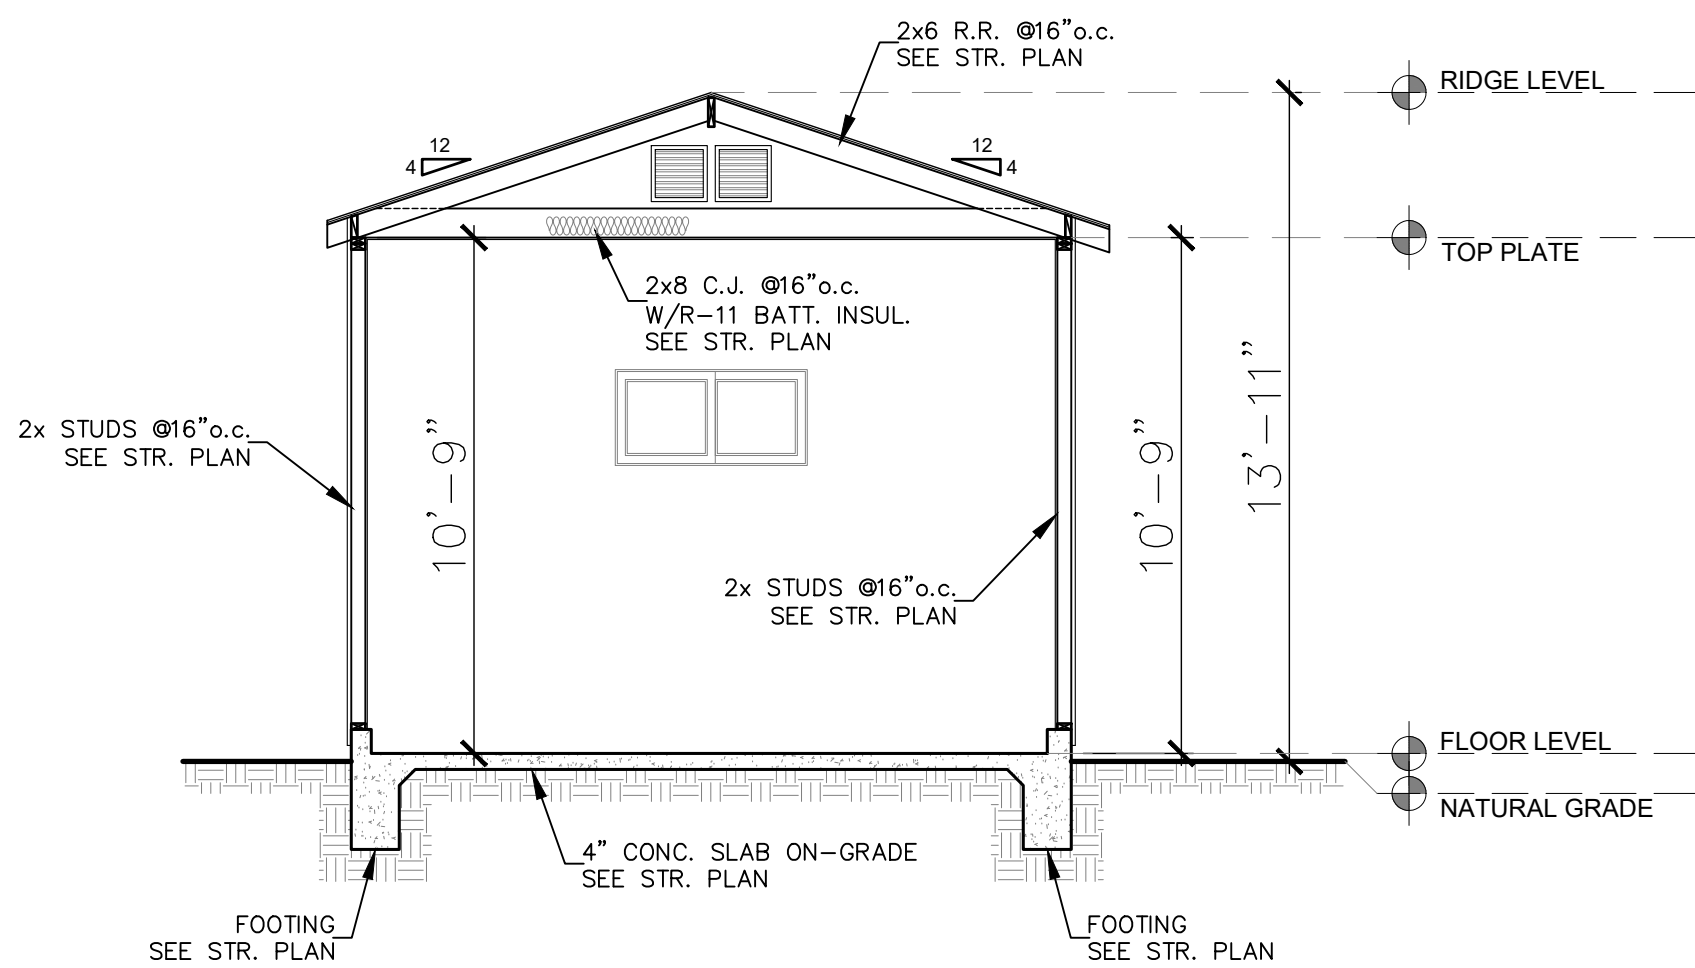

SECTION 1-1


1/4" = 1'-0"

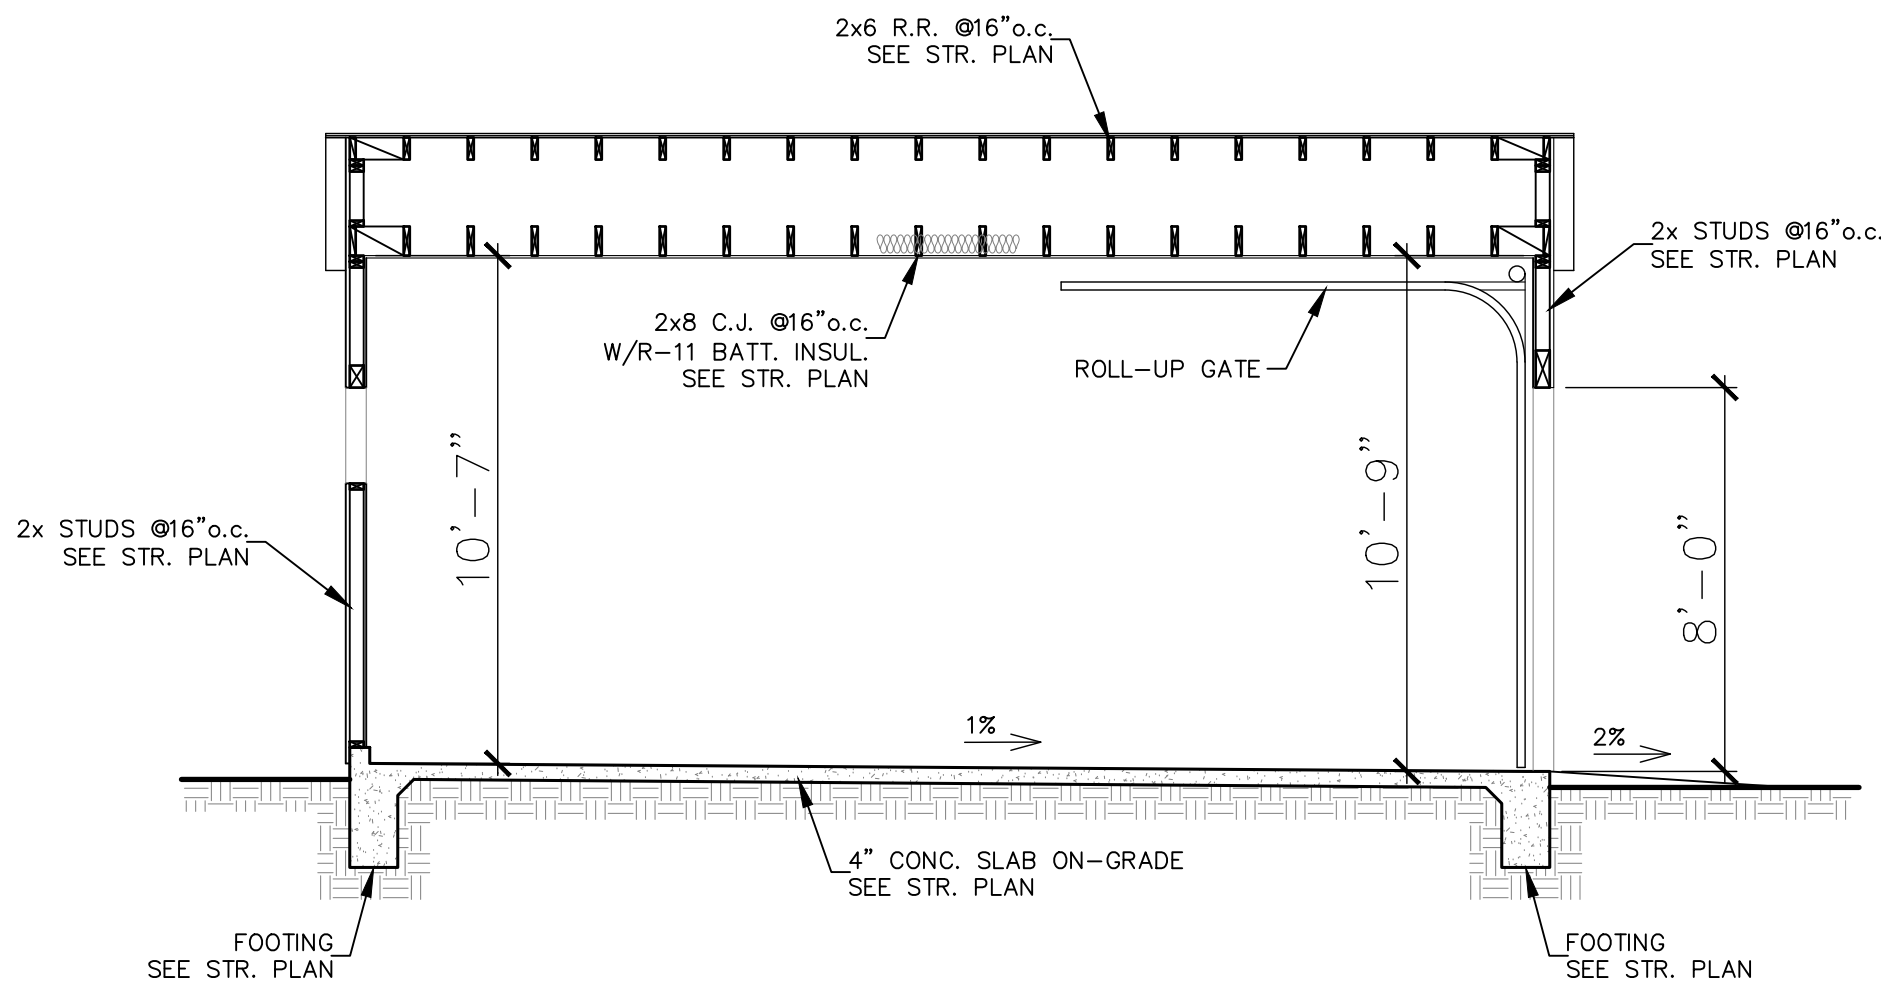

SECTION 2-2

1/4" = 1'-0"

WRITTEN DIMENSIONS ON THESE SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY, AND BE RESPONSIBLE FOR, THE ACCURACY OF ALL DIMENSIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. THE ABOVE DRAWINGS AND SPECIFICATIONS AND IDEAS, DESIGNS, AND CONCEPTS ARE THE PROPERTY OF THE ENGINEER AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY OTHER WORK DEVELOPED WITHOUT THE WRITTEN PERMISSION OF THE ENGINEER. THESE DRAWINGS WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

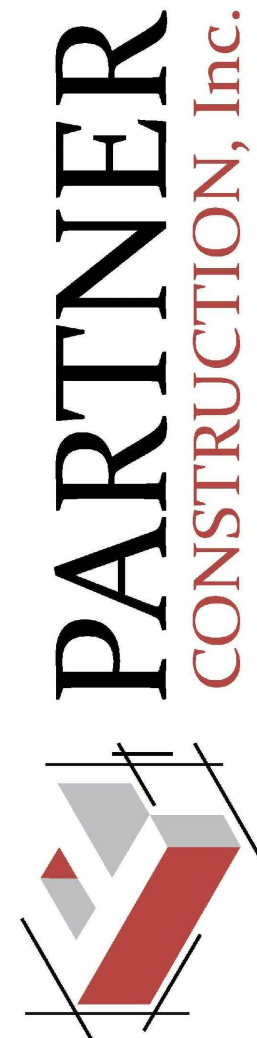DATE:  
JUL. 12, 2024

JOB NO. \_\_\_\_\_

DESIGNED BY:  
NADIA DOKSHINA

REVISIONS	BY

NEW 1-CAR GARAGE

21900 PACIFIC COAST HWY,  
HUNTINGTON BEACH, CA 92646ELEVATIONS  
& SECTIONS

SHEET NUMBER:

A-3.0

SHEET 4 OF 7





	Y	=	YES
	N/A	=	NOT APPLICABLE
	RESPON. PARTY	=	RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

# PARTNER


## CONSTRUCTION, Inc.



\_\_\_\_\_

21900 PACIFIC COAST HWY,  
HUNTINGTON BEACH, CA 92646





California

# 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE


## NONRESIDENTIAL MANDATORY MEASURES, SHEET 2 (January 2023)

Y	N/A	RESPON. PARTY		Y	N/A	RESPON. PARTY		Y	N/A	RESPON. PARTY		Y	N/A	RESPON. PARTY		Y	N/A	RESPON. PARTY	
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<b>SECTION 5.303 INDOOR WATER USE</b> <b>5.303.1 METERS.</b> Separate submeters or metering devices shall be installed for the uses described in Sections 503.1.1 and 503.1.2.  <b>5.303.1.1 Buildings in excess of 50,000 square feet.</b> Separate submeters shall be installed as follows: <ol style="list-style-type: none"><li>For each individual leased, rented or other tenant space within the building projected to consume more than 100 gal/day (380 L/day), including, but not limited to, spaces used for laundry or cleaners, restaurant or food service, medical or dental office, laboratory, or beauty salon or barber shop.</li><li>Where separate submeters for individual building tenants are unfeasible, for water supplied to the following subsystems:<ol style="list-style-type: none"><li>Makeup water for cooling towers where flow through is greater than 500 gpm (30 L/s).</li><li>Makeup water for evaporative coolers greater than 6 gpm (0.04 L/s).</li><li>Steam and hot water boilers with energy input more than 500,000 Btu/h (147 kW).</li></ol></li></ol> <b>5.303.1.2 Excess consumption.</b> A separate submeter or metering device shall be provided for any tenant within a new building or within an addition that is projected to consume more than 1,000 gal/day.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS.</b> Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the following:  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.1 Water Closets.</b> The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-Type toilets.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.2 Urinals.</b> <b>5.303.3.2.1 Wall-mounted Urinals.</b> The effective flush volume of wall-mounted urinals shall not exceed 0.125 gallons per flush.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.2.2 Floor-mounted Urinals.</b> The effective flush volume of floor-mounted or other urinals shall not exceed 0.5 gallons per flush.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.3 Showerheads. [BSC-CG]</b> <b>5.303.3.3.1 Single showerhead.</b> Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.3.2 Multiple showerheads serving one shower.</b> When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to allow only one shower outlet to be in operation at a time. <b>Note:</b> A hand-held shower shall be considered a showerhead.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4 Faucets and fountains.</b>  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.1 Nonresidential Lavatory faucets.</b> Lavatory faucets shall have a maximum flow rate of not more than 0.5 gallons per minute at 60 psi.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.2 Kitchen faucets.</b> Kitchen faucets shall have a maximum flow rate of not more than 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.3 Wash Fountains.</b> Wash fountains shall have a maximum flow rate of not more than 1.8 gallons per minute/20 sqm (square inches) at 60 psi.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.4 Metering faucets.</b> Metering faucets shall not deliver more than 0.20 gallons per cycle.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.5 Metering faucets for wash fountains.</b> Metering faucets for wash fountains shall have a maximum flow rate of not more than 0.20 gallons per minute/20 sqm (square inches) at 60 psi.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.3.4.6 Pre-rinse spray valve</b> When installed, shall meet the requirements in the <i>California Code of Regulations</i> , Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7), and shall be equipped with an integral automatic shutoff.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>FOR REFERENCE ONLY:</b> The following table and code section have been reprinted from the <i>California Code of Regulations</i> , Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A). <table><thead><tr><th colspan="2">TABLE H-2</th></tr><tr><th colspan="2">STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019</th></tr><tr><th>PRODUCT CLASS [spray force in ounce force (ozf)]</th><th>MAXIMUM FLOW RATE (gpm)</th></tr></thead><tbody><tr><td>Product Class 1 (<math>\leq 5.0</math> ozf)</td><td>1.00</td></tr><tr><td>Product Class 2 (<math>&gt; 5.0</math> ozf and <math>\leq 8.0</math> ozf)</td><td>1.20</td></tr><tr><td>Product Class 3 (<math>&gt; 8.0</math> ozf)</td><td>1.28</td></tr></tbody></table> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.4 COMMERCIAL KITCHEN EQUIPMENT.</b>  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.4.1 Food Waste Disposers.</b> Disposers shall either modulate the use of water to no more than 1 gpm when the disposer is not in use (not actively grinding food waste/no-load) or shall automatically shut off after no more than 10 minutes of inactivity. Disposers shall use no more than 8 gpm of water. <b>Note:</b> This code section does not affect local jurisdiction authority to prohibit or require disposer installation.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.5 AREAS OF ADDITION OR ALTERATION.</b> For those occupancies within the authority of the California Building Standards Commission as specified in Section 103, the provisions of Section 5.303.3 and 5.303.4 shall apply to new fixtures in additions or areas of alteration to the building.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.303.6 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS.</b> Plumbing fixtures and fittings shall be installed in accordance with the <i>California Plumbing Code</i> , and shall meet the applicable standards referenced in Table 1701.1 of the <i>California Plumbing Code</i> and in Chapter 6 of this code.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.304 OUTDOOR WATER USE</b> <b>5.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS.</b> Nonresidential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELo), whichever is more stringent.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Notes:</b> <ol style="list-style-type: none"><li>The Model Water Efficient Landscape Ordinance (MWELo) is located in the California Code of Regulations, Title 23, Chapter 2.7, Division 2.</li><li>MWELo and supporting documents, including a water budget calculator, are available at: <a href="https://www.water.ca.gov/">https://www.water.ca.gov/</a>.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.304.6 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS.</b> For public schools and community colleges, landscape projects as described in Sections 5.304.6.1 and 5.304.6.2 shall comply with the California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELo) commencing with Section 460 of Chapter 2.7, Division 2, Title 23, <i>California Code of Regulations</i> , except that the evapotranspiration adjustment factor (ETAF) shall be 0.65 with an additional water allowance for special landscape areas (SLA) of 0.35.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exception:</b> Any project with an aggregate landscape area of 2,500 square feet or less may comply with the prescriptive measures contained in Appendix D of the MWELo.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.304.6.1 Newly constructed landscapes.</b> New construction projects with an aggregate landscape area equal to or greater than 500 square feet.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.304.6.2 Rehabilitated landscapes.</b> Rehabilitated landscape projects with an aggregate landscape area equal to or greater than 1,200 square feet.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>DIVISION 5.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY</b> <b>SECTION 5.401 GENERAL</b> <b>5.401.1 SCOPE.</b> The provisions of this chapter shall outline means of achieving material conservation and resource efficiency through protection of buildings from exterior moisture, construction waste diversion, employment of techniques to reduce pollution through recycling of materials, and building commissioning or testing and adjusting.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.402 DEFINITIONS</b> <b>5.402.1 DEFINITIONS.</b> The following terms are defined in Chapter 2 ( <i>and are included here for reference</i> )  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ADJUST.</b> To regulate fluid flow rate and air patterns at the terminal equipment, such as to reduce fan speed or adjust a damper.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>BALANCE.</b> To proportion flows within the distribution system, including sub-mains, branches and terminals, according to design quantities.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>BUILDING COMMISSIONING.</b> A systematic quality assurance process that spans the entire design and construction process, including verifying and documenting that building systems and components are planned, designed, installed, tested, operated and maintained to meet the owner's project requirements.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ORGANIC WASTE.</b> Food waste, green waste, landscape and pruning waste, nonhazardous wood waste, and food solid paper waste that is mixed in with food waste.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>TEST.</b> A procedure to determine quantitative performance of a system or equipment  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.407 WATER RESISTANCE AND MOISTURE MANAGEMENT</b> <b>5.407.1 WEATHER PROTECTION.</b> Provide a weather-resistant exterior wall and foundation envelope as required by California Building Code Section 1402.2 (Weather Protection), manufacturer's installation instructions or local ordinance, whichever is more stringent.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.407.2 MOISTURE CONTROL.</b> Employ moisture control measures by the following methods.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.407.2.1 Sprinklers.</b> Design and maintain landscape irrigation systems to prevent spray on structures.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.407.2.2 Entries and openings.</b> Design exterior entries and/or openings subject to foot traffic or wind-driven rain to prevent water intrusion into buildings as follows:  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.407.2.2.1 Exterior door protection.</b> Primary exterior entries shall be covered to prevent water intrusion by using nonabsorbent floor and wall finishes within at least 2 feet around and perpendicular to such openings plus at least one of the following: <ol style="list-style-type: none"><li>An installed awning at least 4 feet in depth.</li><li>The door is protected by a roof overhang at least 4 feet in depth.</li><li>The door is recessed at least 4 feet.</li><li>Other methods which provide equivalent protection.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.407.2.2.2 Flashing.</b> Install flashings integrated with a drainage plane.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING</b> <b>5.408.1 CONSTRUCTION WASTE MANAGEMENT.</b> Recycle and/or salvage for reuse a minimum of 65% of the non-hazardous construction and demolition waste in accordance with Section 5.408.1.1, 5.408.1.2 or 5.408.1.3; or meet a local construction and demolition waste management ordinance, whichever is more stringent.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.1.1 Construction waste management plan.</b> Where a local jurisdiction does not have a construction and demolition waste management ordinance, submit a construction waste management plan that: <ol style="list-style-type: none"><li>Identifies the construction and demolition waste materials to be diverted from disposal by efficient usage, recycling, reuse on the project or salvage for future use or sale.</li><li>Determines if construction and demolition waste materials will be sorted on-site (source-separated) or bulk mixed (single stream).</li><li>Identifies diversion facilities where construction and demolition waste material collected will be taken.</li><li>Specifies that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.1.2 Waste Management Company.</b> Utilize a waste management company that can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with this section.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> The owner or contractor shall make the determination if the construction and demolition waste material will be diverted by a waste management company.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exceptions to Sections 5.408.1.1 and 5.408.1.2:</b> <ol style="list-style-type: none"><li>Excavated soil and land-clearing debris.</li><li>Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist.</li><li>Demolition waste meeting local ordinance or calculated in consideration of local recycling facilities and markets.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.1.3 Waste stream reduction alternative.</b> The combined weight of new construction disposal that does not exceed two pounds per square foot of building area may be deemed to meet the 65% minimum requirement as approved by the enforcing agency.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.1.4 Documentation.</b> Documentation shall be provided to the enforcing agency which demonstrates compliance with Sections 5.408.1.1, through 5.408.1.3. The waste management plan shall be updated as necessary and shall be accessible during construction for examination by the enforcing agency.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Notes:</b> <ol style="list-style-type: none"><li>Sample forms found in "A Guide to the California Green Building Standards Code (Nonresidential)" located <a href="http://www.dgs.ca.gov/BSC/Resources/Page-Content/Building-Standards-Commission-Resources-List-Folder/CALGreen">www.dgs.ca.gov/BSC/Resources/Page-Content/Building-Standards-Commission-Resources-List-Folder/CALGreen</a> may be used to assist in documenting compliance with the waste management plan.</li><li>Mixed construction and demolition debris processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.2 UNIVERSAL WASTE. [A]</b> Additions and alterations to a building or tenant space that meet the scoping provisions in Section 301.3 for nonresidential additions and alterations, shall require verification that Universal Waste items such as fluorescent lamps and ballast and mercury containing thermostats as well as other California Prohibited Universal Waste materials are disposed of properly and are diverted from landfills. A list of prohibited Universal Waste materials shall be included in the construction documents.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> Refer to the Universal Waste Rule link at: <a href="http://www.dtsc.ca.gov/universalwaste/">http://www.dtsc.ca.gov/universalwaste/</a>  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.408.3 EXCAVATED SOIL AND LAND CLEARING DEBRIS.</b> 100 percent of trees, stumps, rocks and associated vegetation and soils resulting primarily from land clearing shall be reused or recycled. For a phased project, such material may be stockpiled on site until the storage site is developed.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exception:</b> Reuse, either on or off-site, of vegetation or soil contaminated by disease or pest infestation.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Notes:</b> <ol style="list-style-type: none"><li>If contamination by disease or pest infestation is suspected, contact the County Agricultural Commissioner and follow its direction for recycling or disposal of the material.</li><li>For a map of known pest and/or disease quarantine zones, consult with the California Department of Food and Agriculture. (<a href="http://www.cdffa.gov">www.cdffa.gov</a>)</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.410 BUILDING MAINTENANCE AND OPERATIONS</b> <b>5.410.1 RECYCLING BY OCCUPANTS.</b> Provide readily accessible areas that serve the entire building and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals or meet a lawfully enacted local recycling ordinance, if more restrictive.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exception:</b> Rural jurisdictions that meet and apply for the exemption in Public Resources Code 42649.82 (a)(2)(A) et seq. shall also be exempt from the organic waste portion of this section.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.1.1 Additions.</b> All additions conducted within a 12-month period under single or multiple permits, resulting in an increase of 30% or more in floor area, shall provide recycling areas on site.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exception:</b> Additions within a tenant space resulting in less than a 30% increase in the tenant space floor area.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.1.2 Sample ordinance.</b> Space allocation for recycling areas shall comply with Chapter 18, Part 3, Division 30 of the <i>Public Resources Code</i> . Chapter 18 is known as the California Solid Waste Reuse and Recycling Access Act of 1991 (Act).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> A sample ordinance for use by local agencies may be found in Appendix A of the document at the CalRecycle's web site.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2 COMMISSIONING. [N]</b> New buildings 10,000 square feet and over. For new buildings 10,000 square feet and over, building commissioning shall be included in the design and construction processes of the building project to verify that the building systems and components meet the owner's or owner representative's project requirements. Commissioning shall be performed in accordance with this section by trained personnel with experience on projects of comparable size and complexity. For L-occupancies that are not regulated by OSHPD or for L-occupancies and L-occupancies that are not regulated by the California Energy Code Section 100.0 Scope, all requirements in Sections 5.410.2 through 5.410.2.6 shall apply.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting systems and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> Commissioning requirements shall include: <ol style="list-style-type: none"><li>Owner's or Owner representative's project requirements.</li><li>Basis of design.</li><li>Commissioning measures shown in the construction documents.</li><li>Commissioning plan.</li><li>Functional performance testing.</li><li>Documentation and training.</li><li>Commissioning report.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Exceptions:</b> <ol style="list-style-type: none"><li>Unconditioned warehouses of any size.</li><li>Areas less than 10,000 square feet used for offices or other conditioned accessory spaces within unconditioned warehouses.</li><li>Tenant improvements less than 10,000 square feet as described in Section 303.1.1.</li><li>Open parking garages of any size, or open parking garage areas, of any size, within a structure.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> For the purposes of this section, unconditioned shall mean a building, area, or room which does not provide heating and/or air conditioning.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Informational Notes:</b> <ol style="list-style-type: none"><li>IAS AC 476 is an accreditation criteria for organizations providing training and/or certification of commissioning personnel. AC 476 is available to the Authority Having Jurisdiction as a reference for qualifications of commissioning personnel. AC 476 does not certify individuals to conduct functional performance tests or to adjust and balance systems.</li><li>Functional performance testing for heating, ventilation, air conditioning systems and lighting controls must be performed in compliance with the <i>California Energy Code</i>.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.1 Owner's or Owner Representative's Project Requirements (OPR). [N]</b> The expectations and requirements of the building appropriate to its phase shall be documented before the design phase of the project begins. This documentation shall include the following: <ol style="list-style-type: none"><li>Environmental and sustainability goals.</li><li>Building sustainable goals.</li><li>Indoor environmental quality requirements.</li><li>Project program, including facility functions and hours of operation, and need for after hours operation.</li><li>Equipment and systems expectations.</li><li>Building occupant and operation and maintenance (O&amp;M) personnel expectations.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.2 Basis of Design (BOD). [N]</b> A written explanation of how the design of the building systems meets the OPR shall be completed at the design phase of the building project. The Basis of Design document shall cover the following systems: <ol style="list-style-type: none"><li>Renewable energy systems.</li><li>Landscape irrigation systems.</li><li>Water reuse system.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.3 Commissioning plan. [N]</b> Prior to permit issuance a commissioning plan shall be completed to document how the project will be commissioned. The commissioning plan shall include the following: <ol style="list-style-type: none"><li>General project information.</li><li>Commissioning goals.</li><li>Systems to be commissioned. Plans to test systems and components shall include:<ol style="list-style-type: none"><li>An explanation of the original design intent.</li><li>Equipment and systems to be tested, including the extent of tests.</li><li>Functions to be tested.</li><li>Conditions under which the test shall be performed.</li><li>Measurable criteria for acceptable performance.</li></ol></li><li>Commissioning team information.</li><li>Commissioning process activities, schedules and responsibilities. Plans for the completion of commissioning shall be included.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.4 Functional performance testing. [N]</b> Functional performance tests shall demonstrate the correct installation and operation of each component, system and system-to-system interface in accordance with the approved plans and specifications. Functional performance testing reports shall contain information addressing each of the building components tested, the testing methods utilized, and include any readings and adjustments made.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.5 Documentation and training. [N]</b> A Systems Manual and Systems Operations Training are required, including Occupational Safety and Health Act (OSHA) requirements in <i>California Code of Regulations</i> (CCR), Title 8, Section 5142, and other related regulations.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.5.1 Systems manual. [N]</b> Documentation of the operational aspects of the building shall be completed within the systems manual and delivered to the building owner or representative. The systems manual shall include the following: <ol style="list-style-type: none"><li>Site information, including facility description, history and current requirements.</li><li>Site contact information.</li><li>Basic operations and maintenance, including general site operating procedures, basic troubleshooting, recommended maintenance requirements, site events log.</li><li>Major systems.</li><li>Site equipment inventory and maintenance notes.</li><li>A copy of verifications required by the enforcing agency or this code.</li><li>Other resources and documentation, if applicable.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.5.2 Systems operations training. [N]</b> A program for training of the appropriate maintenance staff for each equipment type and/or system shall be developed and documented in the commissioning report and shall include the following: <ol style="list-style-type: none"><li>System/equipment overview (what it is, what it does and with what other systems and/or equipment it interfaces).</li><li>Review and demonstration of servicing/preventive maintenance.</li><li>Review of the information in the Systems Manual.</li><li>Review of the record drawings on the system/equipment.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.2.6 Commissioning report. [N]</b> A report of commissioning process activities undertaken through the design and construction phases of the building project shall be completed and provided to the owner or representative.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4 TESTING AND ADJUSTING. New buildings less than 10,000 square feet.</b> Testing and adjusting of systems shall be required for new buildings less than 10,000 square feet or new systems to serve an addition or alteration subject to Section 303.1.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.2 (Reserved)</b>  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting system and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements and Sections 120.5, 120.6, 130.4, and 140.9(b)3 for additional testing requirements of specific systems.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.2 Systems.</b> Develop a written plan of procedures for testing and adjusting systems. Systems to be included for testing and adjusting shall include at a minimum, as applicable to the project: <ol style="list-style-type: none"><li>Renewable energy systems.</li><li>Landscape irrigation systems.</li><li>Water reuse systems.</li></ol> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.3 Procedures.</b> Perform testing and adjusting procedures in accordance with manufacturer's specifications and applicable standards on each system.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.3.1 HVAC balancing.</b> In addition to testing and adjusting, before a new space-conditioning system serving a building or space is operated for normal use, the system shall be balanced in accordance with the procedures defined by the Testing Adjusting and Balancing Bureau National Standards, the National Environmental Balancing Bureau Procedural Standards, Associated Air Balance Council National Standards or as approved by the enforcing agency.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.4 Reporting.</b> After completion of testing, adjusting and balancing, provide a final report of testing signed by the individual responsible for performing these services.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.5 Operation and maintenance (O &amp; M) manual.</b> Provide the building owner or representative with detailed operating and maintenance instructions and copies of guarantees/warranties for each system. O & M instructions shall be consistent with OSHA requirements in CCR, Title 8, Section 5142, and other related regulations.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.410.4.5.1 Inspections and reports.</b> Include a copy of all inspection verifications and reports required by the enforcing agency.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>DIVISION 5.5 ENVIRONMENTAL QUALITY</b> <b>SECTION 5.501 GENERAL</b> <b>5.501.1 SCOPE.</b> The provisions of this chapter shall outline means of reducing the quantity of air contaminants that are odorous, irritating, and/or harmful to the comfort and well-being of a building's installers, occupants and neighbors.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.502 DEFINITIONS</b> <b>5.502.1 DEFINITIONS.</b> The following terms are defined in Chapter 2 ( <i>and are included here for reference</i> )  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ARTERIAL HIGHWAY.</b> A general term denoting a highway primarily for through traffic usually on a continuous route.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>A-WEIGHTED SOUND LEVEL (dBA).</b> The sound pressure level in decibels as measured on a sound level meter using the internationally standardized A-weighting filter or as computed from sound spectral data to which A-weighting adjustments have been made.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>1 BTU/HOUR.</b> British thermal units per hour, also referred to as Btu. The amount of heat required to raise one pound of water one degree Fahrenheit per hour, a common measure of heat transfer rate. A ton of refrigeration is 12,000 Btu, the amount of heat required to melt a ton (2,000 pounds) of ice at 32° Fahrenheit.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>COMMUNITY NOISE EQUIVALENT LEVEL (CNEL).</b> A metric similar to the day-night average sound level (Ldn), except that a 5 decibel adjustment is added to the equivalent continuous sound exposure level for evening hours (7pm to 10pm) in addition to the 10 dB nighttime adjustment used in the Ldn.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>COMPOSITE WOOD PRODUCTS.</b> Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, timber, prefabricated wood I-joists or finger-jointed lumber, all as specified in California Code of Regulations (CCR), Title 17, Section 93120.1(a).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> See CCR, Title 17, Section 93120.1.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>DAY-NIGHT AVERAGE SOUND LEVEL (Ldn).</b> The A-weighted equivalent continuous sound exposure level for a 24-hour period with a 10 dB adjustment added to sound levels occurring during nighttime hours (10p.m. to 7 a.m.).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>DECIBEL (dB).</b> A measure on a logarithmic scale of the magnitude of a particular quantity (such as sound pressure, sound power, sound intensity) with respect to a reference quantity.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ELECTRIC VEHICLE (EV).</b> An automotive-type vehicle for on-road use, such as passenger automobiles, buses, trucks, vans, neighborhood electric vehicles, electric motorcycles, and the like, primarily powered by an electric motor that draws current from a rechargeable storage battery, fuel cell, photovoltaic array, or other source of electric current. Plug-in hybrid electric vehicles (PHEV) are considered electric vehicles. For purposes of the <i>California Electrical Code</i> , off-road, self-propelled electric vehicles, such as industrial trucks, hoists, lifts, transports, golf carts, airline ground support equipment, tractors, boats, and the like, are not included.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ELECTRIC VEHICLE CHARGING STATION(S) (EVCS).</b> One or more spaces intended for charging electric vehicles.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE).</b> The conductors, including the ungrounded, grounded, and equipment grounding conductors and the electric vehicle connectors, attachment plugs, and all other fittings, devices, power outlets, or apparatus installed specifically for the purpose of transferring energy between the premises wiring and the electric vehicle.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>ENERGY EQUIVALENT (NOISE) LEVEL (Leq).</b> The level of a steady noise which would have the same energy as the fluctuating noise level integrated over the time of period of interest.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>EXPRESSWAY.</b> An arterial highway for through traffic which may have partial control of access, but which may or may not be divided or have grade separations at intersections.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>FREEWAY.</b> A divided arterial highway with full control of access and with grade separations at intersections.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>GLOBAL WARMING POTENTIAL (GWP).</b> The radiative forcing impact of one mass-based unit of any given greenhouse gas relative to an equivalent unit of carbon dioxide over a given period of time. Carbon dioxide is the reference compound with a GWP of one.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>GLOBAL WARMING POTENTIAL VALUE (GWP VALUE).</b> A 100-year GWP value published by the Intergovernmental Panel on Climate Change (IPCC) in either its Second Assessment Report (SAR) (IPCC, 1995); or its Fourth Assessment A-3 Report (AR4) (IPCC, 2007). The SAR GWP values are found in column "SAR (100-yr)" of Table 2.14.; the AR4 GWP values are found in column "100 yr" of Table 2.14.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>HIGH-GWP REFRIGERANT.</b> A compound used as a heat transfer fluid or gas that is: (a) a chlorofluorocarbon, a hydrochlorofluorocarbon, a hydrofluorocarbon, a perfluorocarbon, or any compound or blend of compounds, with a GWP value equal to or greater than 150, or (B) any ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>LONG RADIUS ELBOW.</b> Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.5 times the pipe diameter.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>LOW-GWP REFRIGERANT.</b> A compound used as a heat transfer fluid or gas that: (A) has a GWP value less than 150, and (B) is not an ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>MERV.</b> Filter minimum efficiency reporting value, based on ASHRAE 52.2-1999.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>MAXIMUM INCREMENTAL REACTIVITY (MIR).</b> The maximum change in weight of ozone formed by adding a compound to the "Base Reactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundredths of a gram (g O <sub>3</sub> /g ROG).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>PRODUCT-WEIGHTED MIR (PWMIR).</b> The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>PSIG.</b> Pounds per square inch, gauge.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>REACTIVE ORGANIC COMPOUND (ROC).</b> Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SCHRADER ACCESS VALVES.</b> Access fittings with a valve core installed.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SHORT RADIUS ELBOW.</b> Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.0 times the pipe diameter.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SUPERMARKET.</b> For the purposes of Section 5.508.2, a supermarket is any retail food facility with 8,000 square feet or more conditioned area and that utilizes either refrigerated display cases, or walk-in coolers or freezers connected to remote compressor units or condensing units.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>VOC.</b> A volatile organic compound broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a)  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>Note:</b> Where specific regulations are cited from different agencies such as SCAQMD, ARB, etc., the VOC definition included in that specific regulation is the one that prevails for the specific measure in question.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.503 FIREPLACES</b> <b>5.503.1 FIREPLACES.</b> Install only a direct-vent sealed-combustion gas or sealed wood-burning fireplace, or a sealed woodstove or pellet stove, and refer to residential requirements in the California Energy Code, Title 24, Part 6, Subchapter 7, Section 150. Woodstoves, pellet stoves and fireplaces shall comply with applicable local ordinances.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.503.1.1 Woodstoves.</b> Woodstoves and pellet stoves shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>SECTION 5.504 POLLUTANT CONTROL</b> <b>5.504.1 TEMPORARY VENTILATION.</b> The permanent HVAC system shall only be used during construction if necessary to condition the building or areas of addition or alteration within the required temperature range for material and equipment installation. If the HVAC system is used during construction, use return air filters with a Minimum Efficiency Reporting Value (MERV) of 8, based on ASHRAE 52.2-1999, or an average efficiency of 30% based on ASHRAE 52.1-1992. Replace all filters immediately prior to occupancy, or, if the building is occupied during alteration, at the conclusion of construction.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <b>5.504.3 Covering of duct openings and protection of mechanical equipment during construction.</b> At the time of rough installation and during storage on the construction site until final startup of the heating, cooling and ventilation equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheetmetal or other methods acceptable to the enforcing agency to reduce the amount of dust, water and debris which may enter the system.  <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	TABLE H-2		STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019		PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)	Product Class 1 ( $\leq 5.0$ ozf)	1.00	Product Class 2 ( $> 5.0$ ozf and $\leq 8.0$ ozf)	1.20	Product Class 3 ( $> 8.0$ ozf)	1.28				
TABLE H-2																			
STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019																			
PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)																		
Product Class 1 ( $\leq 5.0$ ozf)	1.00																		
Product Class 2 ( $> 5.0$ ozf and $\leq 8.0$ ozf)	1.20																		
Product Class 3 ( $> 8.0$ ozf)	1.28																		

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

WRITTEN DIMENSIONS ON THESE SHALL HAVE PRECEDENCE OVER SCALED DIMENSIONS. CONTRACTORS SHALL VERIFY, AND BE RESPONSIBLE FOR, THE ACCURACY OF ALL DIMENSIONS. THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS, THE ABOVE DRAWINGS AND SPECIFICATIONS AND DEAS, DESIGNS, SHALL REMAIN THE PROPERTY OF THE ENGINEER, AND NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS OR USED IN CONNECTION WITH ANY OTHER WORK DEVELOPED WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

PARTNER  
CONSTRUCTION, Inc.



DATE:  
JUL 12, 2024

JOB NO. \_\_\_\_\_  
DESIGNED BY:  
NADIA DOKSHINA

REVISIONS	BY

NEW 1-CAR GARAGE

21900 PACIFIC COAST HWY ,  
HUNTINGTON BEACH, CA 92646

GREEN  
BUILDING  
NOTES  
SHEET NUMBER:

GR-2

SHEET 6 OF 7





Y	=	YES
N/A	=	NOT APPLICABLE
RESPON. PARTY	=	RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC)

**DISCLAIMER:** THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODEBOOK.

# PARTNER

## CONSTRUCTION, Inc.



REVISIONS

21900 PACIFIC COAST HWY,  
HUNTINGTON BEACH, CA 92646

SHEET NUMBER

# GR-3

SHEET 7 OF 7