


GREEN BUILDING CODE NOTES:

Chapter 1 – ADMINISTRATION
101.31 Applies to ALL newly constructed residential buildings: low-rise, high-rise, and hotels/motels.
Chapter 3 – GREEN BUILDING
301.1.1 Additions and alterations
 • Applies to additions or alterations of residential buildings where the addition or alteration increases the building's conditioned area, volume, or size.
 • Requirements only apply within the specific area of the addition or alteration.
 • Note directs code users to Civil Code Section 1101.1 et seq., regarding replacement of non-compliant plumbing fixtures.
301.2 Low-rise and high-rise buildings
 Banners identify provisions applying to low-rise only [LR] or high-rise only [HR].
Division 4.1 – PLANNING AND DESIGN (SITE DEVELOPMENT)
4.106.2 Storm water drainage and retention during construction projects which disturb less than 1 acre of soil and are not part of a larger common plan of development shall manage storm water drainage during construction.
4.106.3 Grading and paving
 Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings. Exception for additions and alterations which do not alter the existing drainage path.
4.106.4 Electric vehicle (EV) charging for new construction
 • Comply with Section 4.106.4.1, 4.106.4.2 or 4.106.4.3 for future installation and use of EV chargers.
 • Electric vehicle supply equipment (EVSE) shall be installed in accordance with the California Electrical Code, Article 625.
 • Exceptions on a case-by-case basis as determined by the Local Enforcing Agency:
 1. Where there is no commercial power supply.
 2. Verification that meeting requirements will alter the local utility infrastructure design requirements on the utility side of the meter increasing costs to the homeowner/developer by more than \$400.00 per dwelling unit.
4.106.4.1 & 4.106.4.1.1 EV charging: 1- & 2-family dwellings/townhouses with attached private garages
 • Install a listed raceway to accommodate a dedicated 208/240-volt branch circuit for each dwelling unit.
 • Raceway shall not be less than trade size 1 (nominal 1-inch inside diameter).
 • Raceway shall originate at the main service or subpanel and terminate into a listed cabinet, box or other enclosure in close proximity to the proposed location of an EV charger.
 • Raceways are required to be continuous at enclosed, inaccessible or concealed areas and spaces.
 • Service panel and/or subpanel shall provide capacity to install a 40-ampere minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device. Service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE".
4.106.4.2 EV charging for multifamily dwellings
 • Apply to building sites with 17 or more multifamily dwelling units constructed on the site.
 • 3% of the total number of parking spaces provided for all types of parking facilities, but in no case less than one, shall be electric vehicle charging spaces (EV spaces) capable of supporting future EVSE. Calculations for the number of EV spaces shall be rounded up to the nearest whole number.
 Note: Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging. There is no requirement for EV spaces to be constructed or available until EV chargers are installed for use.
4.106.4.2.1 EV charging space (EV space) locations
 • Construction documents shall indicate the location of proposed EV spaces. At least 1 EV space shall be located in common use areas and available for use by all residents.
 • When EV chargers are installed, EV spaces required by Section 4.106.4.2.2, item 3, shall comply with at least 1 of the following options:
 1. The EV space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space.
 2. The EV space shall be located on an accessible route to the building, as defined in the California Building Code, Chapter 2.
4.106.4.2.2 EV charging space (EV space) dimensions
 EV spaces shall be designed to comply with the following:
 1. The minimum length of each EV space shall be 18 feet.
 2. The minimum width of each EV space shall be 9 feet.
 3. One in every 25 EV spaces, but not less than 1, shall also have an 8-foot wide minimum aisle. A 5-foot wide minimum aisle shall be permitted provided the minimum width of the EV space is 12 feet.
 a) Surface slope for this EV space and aisle shall not exceed 1 unit vertical in 48 units horizontal (2.083% slope) in any direction.
4.106.4.2.3 Single EV space required
 • Install listed raceway capable of accommodating a 208/240-volt dedicated branch circuit.
 □ The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter).
 □ The raceway shall originate at the main service or subpanel and shall terminate into a listed cabinet, box or enclosure in close proximity to the proposed location of the EV space.
 • Construction documents shall identify the raceway termination point.
 • The service panel and/or subpanel shall provide capacity to install a 40-ampere minimum dedicated branch circuit and space(s) reserved to permit installation of a branch circuit overcurrent protective device.
4.106.4.2.4 Multiple EV spaces required
 • Construction documents shall indicate raceway termination point and proposed location of future EV spaces and EV chargers. Construction documents shall also provide information on amperage of future EVSE, raceway method(s), wiring schematics and electrical load calculations to verify electrical panel service capacity and electrical system, including any on-site distribution transformer(s), have sufficient capacity to simultaneously charge all EVs at all required EV spaces at full rated amperage of the EVSE.
 • Plan design shall be based upon a 40-ampere minimum branch circuit.
 • Raceways and related components planned to be installed underground, enclosed, inaccessible or in concealed areas and spaces shall be installed at the time of original construction.
4.106.4.2.5 Identification
 The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.
Notes:
 1. The California Department of Transportation adopts and publishes the "California Manual on Uniform Traffic Control Devices (California MUTCD)" to provide uniform standards and specifications for all official traffic control devices in California. Zero Emission Vehicle Signs and Pavement Markings can be found in the New Policies Directives Number 12-01. Website: <http://www.dot.ca.gov/hq/traffops/policy/13-01.pdf>
 2. See Vehicle Code Section 22511 for EV charging space signage in off-parking facilities and for use of EV charging spaces.
 3. The Governor's Office of Planning and Research (OPR) published a "Zero Emission Vehicle Community Readiness Guidebook" which provides helpful information for local governments, residents and businesses. Website: http://opr.ca.gov/docs/ZEV_Guidebook.pdf
4.106.4.3.2 Electrical Vehicle (EV) Charging Space Dimensions
 1. Minimum length of each EV space shall be 18'.
 2. Minimum width of each EV space shall be 9'.
4.106.4.3.3 Single EV Space Required.

Division 4.2 – ENERGY EFFICIENCY
4.201.1 & 5.201.1
 Scope
 • Energy efficiency requirements for low-rise residential (Section 4.201.1) and high-rise residential/hotels/motels (Section 5.201.1) are now in both residential and nonresidential chapters of CALGreen.
 • Standards for residential buildings do not require compliance with levels of minimum energy efficiency beyond those required by the 2016 California Energy Code.
Division 4.3 – WATER EFFICIENCY AND CONSERVATION (INDOOR WATER USE)
4.303.1 Water conserving plumbing fixtures and fittings
 Plumbing fixtures and fittings shall comply with the following:
 4.303.1.1 Water Closets: ≤ 1.28 gal/flush
 4.303.1.2 Wall Mounted Urinals: ≤ 0.125 gal/flush; all other urinals ≤ 0.5 gal/flush
 4.303.1.3.1 Single Showerheads: Showerheads shall have a maximum flow rate of not more than 1.8 gpm @ 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.
 4.303.1.3.2 Multiple Showerheads serving one shower: When a shower is served by more than one showerhead, the combined flow rate of all showerheads and/or shower controls controlled by a single valve shall not exceed 1.8 gpm @ 80 psi, or the shower shall be designed to allow only one shower outlet to be in operation at a time
 4.303.1.4.1 Residential Lavatory Faucets: Maximum Flow Rate ≤ 1.2 gpm @ 60 psi; Minimum Flow Rate ≥ 0.8 gpm @ 20 psi
 4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas of Residential Buildings: ≤ 0.5 gpm @ 60 psi
 4.303.1.4.3 Metering Faucets: ≤ 0.25 gallons per cycle
 4.303.1.4.4 Kitchen Faucets: ≤ 1.8 gpm @ 60 psi; temporary increase to 2.2 gpm allowed but shall default to 1.8 gpm
4.303.2 Standards for plumbing fixtures and fittings
 Plumbing fixtures and fittings shall be installed in accordance with the California Plumbing Code, and shall meet applicable standards referenced in Table 1701.1 of the California Plumbing Code.
Division 4.3 – WATER EFFICIENCY AND CONSERVATION (OUTDOOR WATER USE)
4.304.1 Outdoor potable water use in landscape areas
 After December 1, 2015, new residential developments with an aggregate landscape area equal to or greater than 500 square feet shall comply with one of the following:
 1. A local water efficient landscape ordinance or the current California Department of Water Resources Model Water Efficient Landscape Ordinance (MWEL0), whichever is more stringent, or
 2. Projects with aggregate landscape areas less than 2500 square feet may comply with the MWEL0's Appendix D Prescriptive Compliance Option.
4.305.1 Recycled water supply systems. Newly constructed residential developments, where disinfected tertiary recycled water is available from a municipal source to a construction site, may be required to have recycled water supply systems installed, allowing the use of recycled water for residential landscape irrigation systems. See Chapter 15 of the California Plumbing Code.

Division 4.4 – MATERIAL CONSERVATION & RESOURCE EFFICIENCY (ENHANCED DURABILITY & REDUCED MAINTENANCE)
4.406.1 Rodent proofing
 Annual passes around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be closed with cement mortar, concrete masonry or a similar material acceptable to the enforcing agency to prevent passage of rodents.
Division 4.4 – MATERIAL CONSERVATION & RESOURCE EFFICIENCY (CONSTRUCTION WASTE REDUCTION, DISPOSAL & RECYCLING)
4.406.1 Construction waste reduction of at least 65%
 • Recycle and/or salvage for reuse a minimum of 65% of the nonhazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4; OR meet a more stringent local construction and demolition waste management ordinance.
 • Documentation is required per Section 4.408.5.
 Exceptions:
 1. Excavated soil and land-clearing debris.
 2. Alternative waste reduction methods developed by working with local enforcing agencies if diversion or recycling capable compliance with this item do not exist or are not located reasonably close to the jobsite.
 3. The enforcing agency may make exceptions to the requirements of this section when isolated jobsites are located in areas beyond the haul boundaries of the diversion facility.
4.406.2 Construction waste management plan
 Submit a construction waste management plan meeting items 1 through 5 in Section 4.408.2. Plans shall be updated as necessary and shall be available for examination during construction.
4.406.3 Waste management company
 Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that diverted construction and demolition waste materials meet the requirements in Section 4.408.1.
4.408.4 & 4.408.4.1 Waste stream reduction alternative
 • (LR) Projects that generate a total combined weight of construction and demolition waste disposed in landfills, which do not exceed 3.4 pounds per square foot of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.
 • Projects that generate a total combined weight of construction and demolition waste disposed in landfills, which do not exceed 2 pounds per square foot of the building area, shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.
Division 4.4 – MATERIAL CONSERVATION & RESOURCE EFFICIENCY (BUILDING MAINTENANCE & OPERATION)
4.410.1 Operation and maintenance manual
 At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which covers 10 specific subject areas shall be placed in the building.
4.410.2 Recycling by occupants
 Where 5 or more multifamily dwelling units are constructed on a building site, provide readily accessible area(s) that serves all buildings on the site and is identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals or meet a lawfully enacted local recycling ordinance, if more restrictive.
 Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code Section 42649.82 (a)(2)(A) et. seq. are not required to comply with the organic waste portion of this section.
Division 4.5 – ENVIRONMENTAL QUALITY (FIREPLACES)
4.503.1 General
 Any installed gas fireplace shall be a direct-vent sealed-combustion type. Any installed woodstove or pellet stove shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating the method used to meet the emission limits. Woodstoves, pellet stoves and fireplaces shall also comply with all applicable local ordinances.
Division 4.5 – ENVIRONMENTAL QUALITY (POLLUTANT CONTROL)
4.504.1 Protection during construction
 At the time of rough installation, during storage on the construction site and until final startup of the heating, cooling and ventilating equipment, all ducts and other related air intake and distribution component openings shall be covered. Tape, plastic sheeting or other methods acceptable to the enforcing agency to reduce the amount of water, dust and debris entering the system may be used.
4.504.2.1 Adhesives, sealants and caulks
 Adhesives, sealants and caulks used on the project shall meet the requirements of the following standards unless more stringent local or regional air pollution or air quality management district rules apply:
 1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers, and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable, or SCAQMD Rule 1168 VOC limits, as shown in Tables 4.504.1 or 4.504.2, as applicable. Such products shall also comply with Rule 1168 prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products as specified in Subsection 2 below.
 2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than 1 pound and do not consist of more than 16 fluid ounces) shall comply with VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of the California Code of Regulations (CCR), Title 17, commencing with Section 94507.
4.504.2.2 Paints and coatings
 Architectural paints and coatings shall comply with VOC limits in Table 1 of the Air Resources Board Architectural Suggested Control Measure, as shown in Table 4.504.3, unless more stringent local limits apply.
 The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 4.504.3 shall be determined by testing the coating as Flat, Nonflat, or Nonflat-High Gloss coating, based on its gloss, as defined in subsections 4.21, 4.36, and 4.37, of the 2007 California Air Resources Board, Suggested Control Measure, and the corresponding Flat, Nonflat, or Nonflat-High Gloss VOC limit in Table 4.504.3 shall apply.
4.504.2.3 Aerosol paints and coatings
 Aerosol paints and coatings shall meet the Product-Weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Section 94522(e)(1) and (f)(1) of the CCR, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District shall additionally comply with the percent VOC by weight of product limits of Regulation 8, Rule 49.
4.504.3 Carpet systems
 Carpet installed in the building interior shall meet the testing and product requirements of 1 of the following:
 1. Carpet and Rug Institute's Green Label Plus Program
 2. California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.1, February 2010 (also known as Specification 01350)
 3. NSF/ANSI 140 at the Gold level
 4. Scientific Certifications Systems Indoor Advantage™ Gold
4.504.3.1 Carpet cushion
 Carpet cushion installed in the building interior shall meet the requirements of the Carpet and Rug Institute's Green Label Plus Program.
4.504.3.2 Carpet adhesive
 Carpet adhesives shall meet the requirements of Table 4.504.1.
4.504.4 Resilient flooring systems
 Where resilient flooring is installed, at least 80% of floor area receiving resilient flooring shall comply with one or more of the following:
 1. Products compliant with the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.1, February 2010 (also known as specification 01350), certified as a CHPS Low-Emitting Material in the Collaborative for High Performance Schools (CHPS) High Performance Products Database
 2. Products certified under the UL GREENGUARD Gold (formerly the Greenguard Children & Schools Program)
 3. Certification under the Resilient Floor Covering Institute (RFCI) FloorScore program
 4. Meet the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.1, February 2010 (also known as Specification 01350)
4.504.5 Composite wood products
 • Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the building shall meet the requirements for formaldehyde as specified in the Air Resources Board's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et. seq.), as shown in Table 4.504.5. Documentation is required per Section 4.504.5.1.
 • Definition of Composite Wood Products: Composite wood products include hardwood plywood, particleboard, and medium density fiberboard. "Composite wood products" do not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood I-joists, or finger-jointed lumber, all as specified in CCR, Title 17, Section 93120.1(c).
4.504.5.1 Documentation
 Verification of compliance shall be provided as requested by the enforcing agency, and as required in Section 4.504.5.1.
Division 4.5 – ENVIRONMENTAL QUALITY (INTERIOR MOISTURE CONTROL)
4.505.2 Concrete slab foundations
 Concrete slab foundations or concrete slab-on-ground floors required to have a vapor retarder by the California Building Code, Chapter 19, or the California Residential Code, Chapter 5, respectively, shall also comply with this section.
4.505.2.1 Capillary break
 A capillary break shall be installed in compliance with at least 1 of the following:
 1. A 4-inch thick base of 1/2-inch or larger clean aggregate shall be provided with a vapor retarder in direct contact with concrete and a concrete mix design which will address bleeding, shrinkage and curing shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06.
 2. Other equivalent methods approved by the enforcing agency.
 3. A slab design specified by a licensed design professional.
4.505.3 Moisture content of building materials
 Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19% moisture content. Moisture content shall be verified in compliance with the following:
 1. Moisture content shall be determined with either a probe-type or a contact-type moisture meter. Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements in Section 701.8.
 2. Moisture readings shall be taken at a point 2 feet to 4 feet from the grade-stamped end of each piece to be verified.
 3. At least 3 random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing. Insulation

products which are visibly wet or have a high moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Manufacturers' drying recommendations shall be followed for wet-applied insulation products prior to enclosure.
Division 4.5 – ENVIRONMENTAL QUALITY (INDOOR AIR QUALITY & EXHAUST)
4.506.1 Bathroom exhaust fans
 Each bathroom shall be mechanically ventilated and shall comply with the following:
 1. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.
 2. Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity control.
 a) Humidity controls shall be capable of manual or automatic adjustment between a relative humidity range of less than 50% to a maximum of 80%.
 b) A humidity control may be a separate component to the exhaust fan and is not required to be integral or built-in.
 Note: For CALGreen a "bathroom" is a room which contains a bathtub, shower, or tub/shower combination. Fans or mechanical ventilation is required in each bathroom.
Division 4.5 – ENVIRONMENTAL QUALITY (ENVIRONMENTAL COMFORT)
4.507.2 Heating and air conditioning system design
 Heating and air conditioning systems shall be sized, designed, and equipment selected using the following methods:
 1. The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J – 2011 (Residential Load Calculation), ASHRAE handbooks or other equivalent design software or methods.
 2. Duct systems are sized according to ANSI/ACCA 1 Manual D – 2014 (Residential Duct Systems), ASHRAE handbooks or other equivalent design software or methods.
 3. Select heating and cooling equipment according to ANSI/ACCA 3 Manual S – 2014 (Residential Equipment Selection) or other equivalent design software or methods.
 Exception: Use of alternate design temperatures necessary to ensure the systems functions are acceptable.
CHAPTER 7 – INSTALLER & SPECIAL INSPECTOR QUALIFICATION (QUALIFICATIONS VERIFICATIONS)
702.1 Installer training
 HVAC system installers shall be trained and certified in the proper installation of HVAC systems and equipment by a recognized training or certification program. Examples of acceptable HVAC training and certification programs include but are not limited to the following:
 1. State certified apprenticeship programs.
 2. Public utility training programs.
 3. Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.
 4. Programs sponsored by manufacturing organizations.
 5. Other programs acceptable to the enforcing agency.
702.2 Special inspection
 Special inspectors must be qualified and able to demonstrate competence to the enforcing agency in the discipline in which they are inspecting.
703.1 Documentation
 Documentation of compliance shall include, but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the local enforcing agency. Other specific documentation or special inspections necessary to verify compliance are specified in appropriate sections of CALGreen.

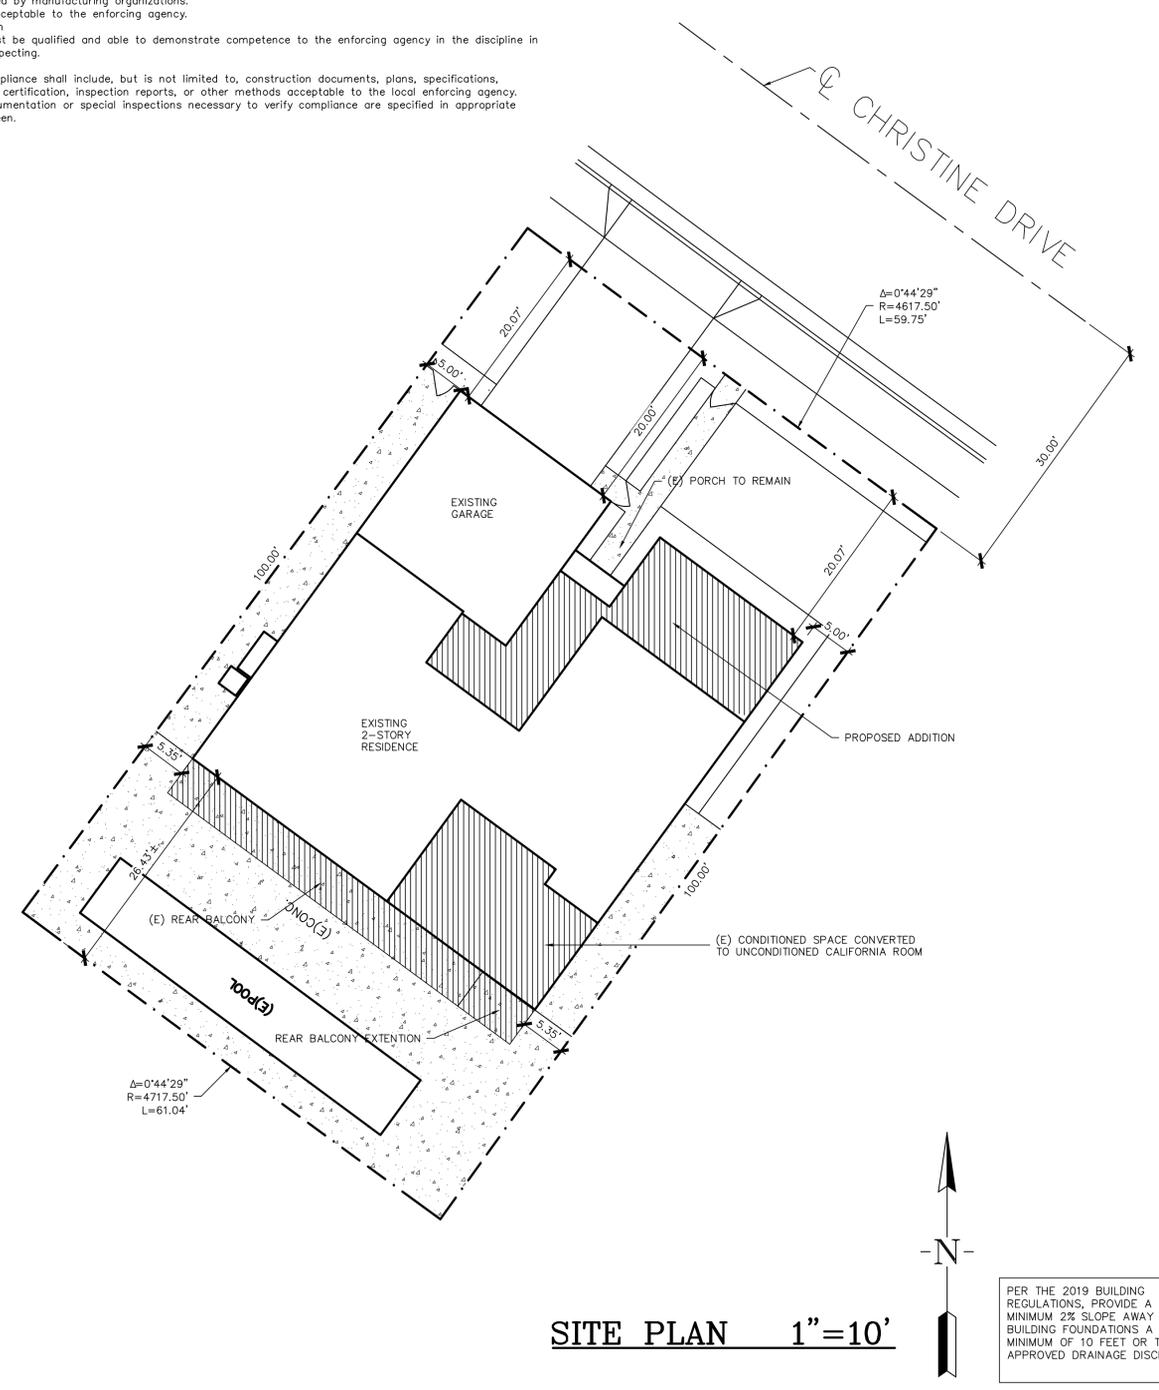

SITE PLAN 1"=10'

PER THE 2019 BUILDING REGULATIONS, PROVIDE A MINIMUM 2% SLOPE AWAY FROM BUILDING FOUNDATIONS A MINIMUM OF 10 FEET OR TO AN APPROVED DRAINAGE DISCHARGE.

BY/CHK.									
REVISIONS									
NO.	DATE								
DES.	S.D.M.	DRW.	S.D.M.	CHK.	S.D.M.				







PROPOSED REMODEL/ADDITION PLANS FOR
MICHAEL HOPKINS & IRENE MORCOS
LESOREW CONSTRUCTION
 9032 CHRISTINE DRIVE
 HUNTINGTON BEACH, CALIFORNIA 92646
 LOT 208, TRACT 3903

AGAPE CIVIL ENGINEERING, INC.
STEPHEN D. MILLER – Registered Civil Engineer
 CIVIL ENGINEERING CONSULTING & ENGINEERING
 P.O. BOX 8088 HUNTINGTON BEACH, CALIFORNIA 92647-8088
 AGAPECIVILENGINEERING@GMAIL.COM
 268-2204_rev1.dwg

January 9, 2023

SHEET 2 OF 17




JOB NO. 268-2204

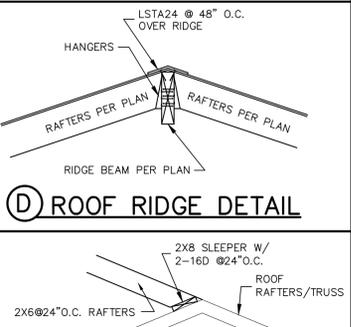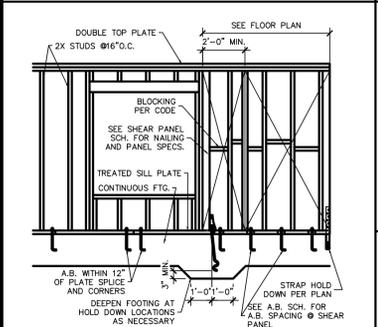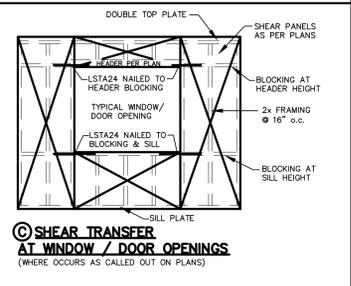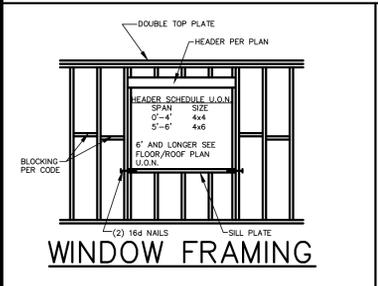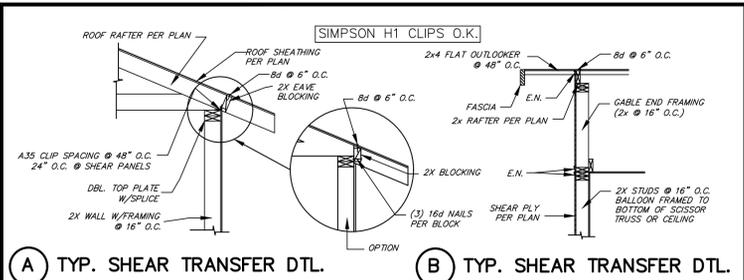

ROOF GENERAL NOTES

- 2x6 R.R. @ 16" o.c. - MAXIMUM UNBRACED SPAN: 13'-0"
- 2x6 R.R. @ 24" o.c. - MAXIMUM UNBRACED SPAN: 11'-1"
- 2x8 R.R. @ 24" o.c. - MAXIMUM UNBRACED SPAN: 14'-0"
- 2x12 R.R. @ 24" o.c. - MAXIMUM UNBRACED SPAN: 17'-6"
- 2x6 C.J. @ 16" o.c. - MAX. SPAN = 14'-9"
- 2x6 C.J. @ 16" o.c. (STUCCO LID) - MAX. SPAN = 12'-7"
- 2x8 C.J. @ 16" o.c. (STUCCO LID) - MAX. SPAN = 16'-6"
- PURLIN BRACING @ 48" o.c. (AS NECESSARY)
- PURLIN BRACES OVER 8' LONG SHALL BE DOUBLE 2x6'S STRONGBACKED WITH 16d @ 12" o.c.
- 1/2" WOOD STRUCTURAL PANEL ROOF SHEATHING (STRUC. I GRADE), UNLOCKED, WITH 8096" O.C. BOUNDARY & EDGES, 12" O.C. FIELD. F.L.=24" MIN. USE SHEATHING CLIPS AT UNSUPPORTED EDGES. OMIT CLIPS FOR P.I. 24/16 OR 3/4" THICK PANELS.
- 24" OVERHANG (MATCH EX.)
- 2x10 FASCIA (MATCH EX.)
- VALLEY, HIP, AND RIDGES SHALL BE AT LEAST THE DEPTH OF THE CUT END OF THE RAFTERS (2x8 TYP.)
- 26 GAUGE FLASHING AS NECESSARY.
- 5:12 PITCH (MATCH EX.)
- CONCRETE ROOF TILES OVER 30# FELT (CLASS B) (MATCH EX.)
- ROOF OVERHANG GUTTERS SHALL BE OPTIONAL. IF USED, DOWNSPOUTS SHALL BE DRAINED TO CONCRETE SPLASH APRONS AND AWAY FROM STRUCTURE. PER CRC SECTION R903.4, ROOF DRAINS SHALL BE SIZED AND INSTALLED PER THE CALIFORNIA PLUMBING CODE.
- PER CRC SECTION R905.2.8.5, A DRIP EDGE SHALL BE PROVIDED AT EAVES AND GABLES OF SHINGLE ROOFS. ADJACENT PIECES OF DRIP EDGE SHALL BE OVERLAPPED A MINIMUM OF 2 INCHES.
- 2x4 @ 16" o.c. CHIMNEY WALLS WITH 2" WOOD STRUCTURAL PANEL WITH 8d @ 6" o.c. EDGES, 12" o.c. FIELD.
- PROVIDE 2x10 F.U. @ 16" o.c. w/ 8" T & G SUBFLOOR FOR ATTIC MOUNTED F.A.U. PROVIDE SECONDARY DRAIN PLAN WITH DRAIN TO VISIBLE LOCATION AS REQUIRED.
- 2 LAYERS OF GRADE "D" PAPER TO BE INSTALLED UNDER CEMENT PLASTER COVERING WHEN APPLIED OVER WOOD SHEATHING PER CBC 2506.6
- ALL POSTS AND BEAMS TO BE DF#2 U.O.N. ALL STUDS TO BE STD. GRADE U.O.N.
- GULNAM BEAMS TO BE GRADE 24F.
- PROVIDE HORIZONTAL FIRE STOPS AT 10'-0" MAXIMUM INTERVALS, AND VERTICAL AT CEILING AND FLOOR LEVELS, AND ELSEWHERE AS REQUIRED.
- PER CRC SECTION R602.7.5, THE NUMBER OF FULL HEIGHT KING STUDS REQUIRED AT EACH END OF HEADERS MUST AGREE WITH CRC TABLE R602.7.5.

TABLE R602.7.5		
Max. Header Span (ft.)	Ultimate Design Wind Speed and Exposure Category	
	<140 mph, Exp. B or <130 mph, Exp. C	≤115 mph, Exp. B
4'	1	1
6'	2	1
8'	2	1
10'	3	2
12'	3	2
14'	3	2
16'	4	2
18'	4	2

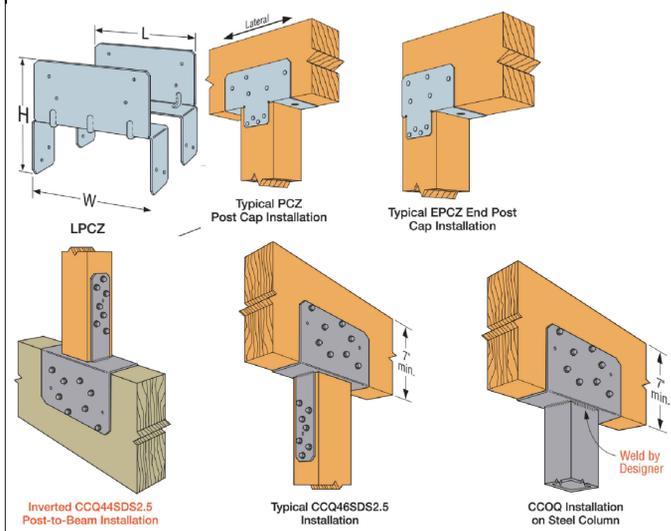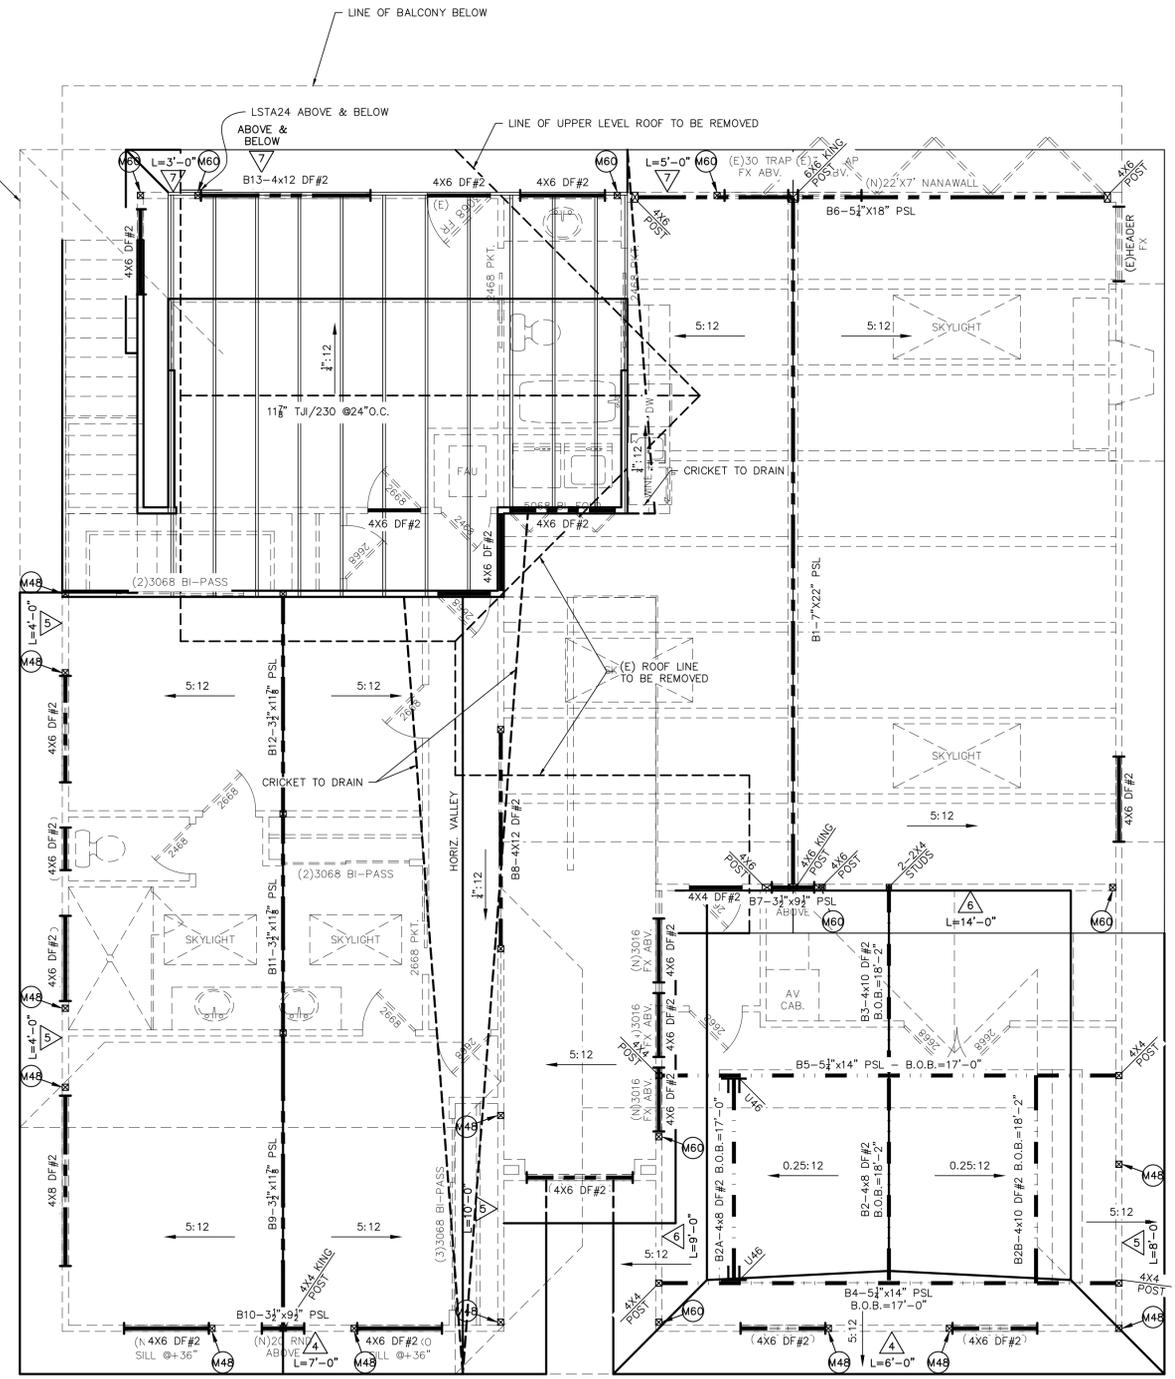

ROOF PLAN 1/4" = 1'-0"

PROPOSED REMODEL/ADDITION PLANS FOR
MICHAEL HOPKINS & IRENE MORCOS
 LESCREW CONSTRUCTION
 9032 CHRISTINE DRIVE
 HUNTINGTON BEACH, CALIFORNIA 92646
 LOT 208, TRACT 3903

AGAPE CIVIL ENGINEERING, INC.
 STEPHEN D. MILLER - Registered Civil Engineer
 CIVIL ENGINEERING CONSULTING RESOURCES & ENGINEERING
 P.O. BOX 908080, HUNTINGTON BEACH, CALIFORNIA 92688
 AGAPECIVILENGINEERING@GMAIL.COM
 268-2204_rev1.dwg

January 9, 2023

SHEET 9 OF 17
 JOB NO. 268-2204

FASTENING SCHEDULE – TABLE R602.3(1)

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER	SPACING AND LOCATION
ROOF		
BLOCKING BETWEEN CEILING JOISTS OR RAFTERS TO TOP PLATE.	4-8d box (2 1/2"x0.113"); or 3-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	Toe nail
CEILING JOISTS TO TOP PLATE.	4-8d box (2 1/2"x0.113"); or 3-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	Per joist, toe nail
CEILING JOIST NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITIONS [SEE SECTIONS R802.3.1, R802.3.2, AND TABLE R802.5.(9)]	4-10d box (3"x0.128"); or 3-16d common (3 1/2"x0.131"); or 4-3"x0.131" nails	Face nail
CEILING JOIST ATTACHED TO PARALLEL RAFTER (HEEL JOINT) [SEE SECTIONS R802.3.1 AND R802.3.2 AND TABLE R802.5.(9)]	Table R802.5.(9)	Face nail
COLLAR TIE TO RAFTER, FACE NAIL OR 1 1/2"x20GA RIDGE STRAP TO RAFTER.	4-10d box (3"x0.128"); or 3-16d common (3 1/2"x0.131"); or 4-3"x0.131" nails	Face nail each rafter
RAFTER OR ROOF TRUSS TO PLATE.	3-16d box nails (3 1/2"x0.135"); or 3-16d common nails (3 1/2"x0.162"); or 4-10d box (3"x0.128"); or 4-3"x0.131" nails	2 toe nails on one side and 1 toe nail on opposite side of each rafter or truss
RAFTERS TO RIDGE, VALLEY OR HIP RAFTERS OR ROOF RAFTER TO MINIMUM 2" RIDGE BEAM.	4-16d (3 1/2"x0.135"); or 3-10d common (3 1/2"x0.148"); or 4-10d box (3"x0.128"); or 4-3"x0.131" nails	Toe nail
	3-16d box (3 1/2"x0.135"); or 2-16d common (3 1/2"x0.162"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	End nail
WALL		
STUD TO STUD (NOT AT BRACED WALL PANELS).	16d common (3 1/2"x0.162") 10d box (3"x0.128"); or 3"x0.131" nails	24" o.c. face nail
STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNERS (AT BRACED WALL PANELS).	16d box (3 1/2"x0.135"); or 3"x0.131" nails	16" o.c. face nail
	16d common (3 1/2"x0.162")	12" o.c. face nail
BUILT-UP HEADER (2" TO 2" HEADER WITH 1/2" SPACER).	16d common (3 1/2"x0.162") 16d box (3 1/2"x0.135")	16" o.c. each edge face nail 12" o.c. each edge face nail
CONTINUOUS HEADER TO STUD.	5-8d box (2 1/2"x0.113"); or 4-8d common (2 1/2"x0.131"); or 4-10d box (3"x0.128")	Toe nail
TOP PLATE TO TOP PLATE	16d common (3 1/2"x0.162") 10d box (3"x0.128"); or 3"x0.131" nails	16" o.c. face nail 12" o.c. face nail
DOUBLE TOP PLATE SPLICE FOR SDC's A-D2 WITH SEISMIC BRACED WALL LINE SPACING < 25".	8-16d common (3 1/2"x0.162"); or 12-16d box (3 1/2"x0.135"); or 12-10d box (3"x0.128"); or 12-3"x0.131" nails	Face nail on each side of end joint (minimum 24" lap splice length each side of end joint)
DOUBLE TOP PLATE SPLICE SDC's D0, D1, D2; AND BRACED WALL LINE SPACING >= 25".	12-16d (3 1/2"x0.135")	
BOTTOM PLATE TO JOIST, RM JOIST, BAND JOIST OR BLOCKING (NOT AT BRACED WALL PANELS)	16d common (3 1/2"x0.162") 16d box (3 1/2"x0.135"); or 3"x0.131" nails	16" o.c. face nail 12" o.c. face nail
BOTTOM PLATE TO JOIST, RM JOIST, BAND JOIST OR BLOCKING (AT BRACED WALL PANELS)	3-16d box (3 1/2"x0.135"); or 2-16d common (3 1/2"x0.162"); or 3"x0.131" nails	3 each 16" o.c. face nail 2 each 16" o.c. face nail 4 each 16" o.c. face nail
TOP OR BOTTOM PLATE TO STUD.	4-8d box (2 1/2"x0.113"); or 3-16d box (3 1/2"x0.135"); or 4-8d common (2 1/2"x0.131"); or 4-10d box (3"x0.128"); or 4-3"x0.131" nails	Toe nail
	3-16d box (3 1/2"x0.135"); or 2-16d common (3 1/2"x0.162"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	End nail
TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS.	3-10d box (3"x0.128"); or 2-16d common (3 1/2"x0.162"); or 3-3"x0.131" nails	Face nail
1" BRACE TO EACH STUD AND PLATE.	3-8d box (2 1/2"x0.113"); or 2-8d common (2 1/2"x0.131"); or 2-10d box (3"x0.128"); or 2 staples 1 1/2"	Face nail
1"x8" SHEATHING TO EACH BEARING.	3-8d box (2 1/2"x0.113"); or 2-8d common (2 1/2"x0.131"); or 2-10d box (3"x0.128"); or 2 staples, 1" crown, 16 ga., 1 1/2" long	Face nail
1"x8" AND WIDER SHEATHING TO EACH BEARING.	3-8d box (2 1/2"x0.113"); or 3-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 3 staples, 1" crown, 16 ga., 1 1/2" long	Face nail
	Wider than 1"x8" 4-8d box (2 1/2"x0.113"); or 3-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 4 staples, 1" crown, 16 ga., 1 1/2" long	Face nail
Floor		
JOIST TO SILL, TOP PLATE OR GIRDER	4-8d box (2 1/2"x0.113"); or 3-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	Toe nail
RM JOIST, BAND JOIST OR BLOCKING TO SILL OR TOP PLATE (ROOF APPLICATIONS ALSO)	8d box (2 1/2"x0.113") 8d common (2 1/2"x0.131"); or 10d box (3"x0.128"); or 3"x0.131" nails	4" o.c. toe nail 6" o.c. toe nail
1"x6" SUBFLOOR OR LESS TO EACH JOIST	3-8d box (2 1/2"x0.113"); or 2-8d common (2 1/2"x0.131"); or 3-10d box (3"x0.128"); or 2 staples, 1" crown, 16 ga., 1 1/2" long	Face nail
2" SUBFLOOR TO JOIST OR GIRDER	3-16d box (3 1/2"x0.135"); or 2-16d common (3 1/2"x0.162")	Blind and face nail
2" PLANKS (PLANK & BEAM-FLOOR & ROOF)	3-16d box (3 1/2"x0.135"); or 2-16d common (3 1/2"x0.162")	At each bearing, face nail
BAND OR RM JOIST TO JOIST	3-16d box (3 1/2"x0.135"); or 4-10d box (3"x0.128"); or 4-3"x0.131" nails; or 4-3"x14 ga. staples, 3/4" crown	End nail
BUILT-UP GIRDERS AND BEAMS, 2-INCH LUMBER LAYERS	20d common (4"x0.192"); or 10d box (3"x0.128"); or 3"x0.131" nails	Nail each layer as follows: 32" o.c. at top and bottom and staggered
	And: 2-20d common (4"x0.192"); or 3-10d box (3"x0.128"); or 3-3"x0.131" nails	Face nail at ends and at each splice
LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	4-16d box (3 1/2"x0.135"); or 3-16d common (3 1/2"x0.162"); or 4-10d box (3"x0.128"); or 4-3"x0.131" nails	At each joist or rafter, face nail
BRIDGING TO JOIST	2-10d (3"x0.128")	Each end, toe nail

DESCRIPTION OF BUILDING ELEMENTS	NUMBER & TYPE OF FASTENER	SPACING OF FASTENERS Edges (inches)	Intermediate supports
Wood structural panels, subfloor, roof and interior wall sheathing to framing and particleboard wall sheathing to framing [see Table R602.3(3) for wood structural panel exterior wall sheathing to wall framing]			
1/2" - 1"	6d common (2"x0.113") nail (subfloor, wall) or 8d common (2"x0.131") nail (roof)	6	12
3/4" - 1"	8d common nail (2"x0.131")	6	12
1 1/4" - 1 1/2"	10d common (3"x0.148") nail; or 8d (2"x0.131) deformed nail	6	12
1/2" structural cellululosic fiberboard sheathing	1 1/2" galvanized roofing nail, 3/4" head diameter, 3" long	3	6
5/8" structural cellululosic fiberboard sheathing	1 1/2" galvanized roofing nail, 3/4" head diameter, or 1" crown staple 16 ga., 1 1/2" long	3	6
1/2" gypsum sheathing	1 1/2" galvanized roofing nail; staple galvanized, 1 1/2" long; 1 1/2" screws, Type W or S	7	7
1/2" gypsum sheathing	1 1/2" galvanized roofing nail; staple galvanized, 1 1/2" long; 1 1/2" screws, Type W or S	7	7
Wood structural panels, combination subfloor underlayment to framing			
1/2" and less	6d deformed (2"x0.120") nail; or 8d common (2"x0.131") nail	6	12
1" - 1"	8d common (2"x0.131") nail; or 8d deformed (2"x0.120") nail	6	12
1 1/4" - 1 1/2"	10d common (3"x0.148") nail; or 8d deformed (2"x0.120") nail	6	12

FOR SI: 1 INCH = 25.4 MM, 1 FOOT = 304.8 MM, 1 MILE PER HOUR = 0.447 M/S; 1KSI = 6.895 MPa.

a. ALL NAILS ARE SMOOTH-COMMON, BOX OR DEFORMED SHANKS EXCEPT WHERE OTHERWISE STATED. NAILS USED FOR FRAMING AND SHEATHING CONNECTIONS SHALL HAVE MINIMUM AVERAGE BENDING YIELD STRENGTHS AS SHOWN: 80 KSI FOR SHANK DIAMETER OF 0.192 INCH (200 COMMON NAIL), 90 KSI FOR SHANK DIAMETERS LARGER THAN 0.142 INCH BUT NOT LARGER THAN 0.177 INCH, AND 100 KSI FOR SHANK DIAMETERS OF 0.142 INCH OR LESS.

b. STAPLES ARE 16 GAGE WIRE AND HAVE A MINIMUM 7/16-INCH ON DIAMETER CROWN WIDTH.

c. NAILS SHALL BE SPACED AT NOT MORE THAN 6 INCHES ON CENTER AT ALL SUPPORTS WHERE SPANLS ARE 48 INCHES OR GREATER.

d. FOUR-FOOT-BY-8-FOOT OR 4-FOOT-BY-9-FOOT PANELS SHALL BE APPLIED VERTICALLY.


e. SPACING OF FASTENERS NOT INCLUDED IN THIS TABLE SHALL BE BASED ON TABLE R602.3(2).

f. FOR REGIONS HAVING BASIC WIND SPEED OF 110 MPH OR GREATER, 8D DEFORMED (2"x0.120) NAILS SHALL BE USED FOR ATTACHING PLYWOOD AND WOOD STRUCTURAL PANEL ROOF SHEATHING TO FRAMING WITHIN MINIMUM 48-INCH DISTANCE FROM GABLE END WALLS, IF MEAN ROOF HEIGHT IS MORE THAN 25 FEET, UP TO 35 FEET MAXIMUM.

g. FOR REGIONS HAVING BASIC WIND SPEED OF 100 MPH OR LESS, NAILS FOR ATTACHING WOOD STRUCTURAL PANEL ROOF SHEATHING TO GABLE END WALL FRAMING SHALL BE SPACED 6 INCHES ON CENTER. WHEN BASIC WIND SPEED IS GREATER THAN 100 MPH, NAILS FOR ATTACHING PANEL ROOF SHEATHING TO INTERMEDIATE SUPPORTS SHALL BE SPACED 6 INCHES ON CENTER FOR MINIMUM 48-INCH.


h. GYPSUM SHEATHING SHALL CONFORM TO ASTM C 1396 AND SHALL BE INSTALLED IN ACCORDANCE WITH GA 253. FIBERBOARD SHEATHING SHALL CONFORM TO ASTM C 208.

i. SPACING OF FASTENERS ON FLOOR SHEATHING PANEL EDGES APPLIES TO PANEL EDGES SUPPORTED BY FRAMING MEMBERS AND REQUIRED BLOCKING AND AT ALL FLOOR PERIMETERS ONLY. SPACING OF FASTENERS ON ROOF SHEATHING PANEL EDGES APPLIES TO PANEL EDGES SUPPORTED BY FRAMING MEMBERS AND REQUIRED BLOCKING. BLOCKING OF ROOF OR FLOOR SHEATHING PANEL EDGES PERPENDICULAR TO THE FRAMING MEMBERS NEED NOT BE PROVIDED EXCEPT AS REQUIRED BY OTHER PROVISIONS OF THIS CODE. FLOOR PERIMETER SHALL BE SUPPORTED BY FRAMING MEMBERS OR SILD WHERE A RAFTER IS FASTENED TO AN ADJACENT PARALLEL CEILING JOIST IN ACCORDANCE WITH THIS SCHEDULE. PROVIDE TWO NAILS ON ONE SIDE OF THE RAFTER AND TWO NAILS FROM THE CEILING JOIST TO TOP PLATE IN ACCORDANCE WITH THIS SCHEDULE. THE TOE NAIL ON THE OPPOSITE SIDE OF THE RAFTER SHALL NOT BE REQUIRED.

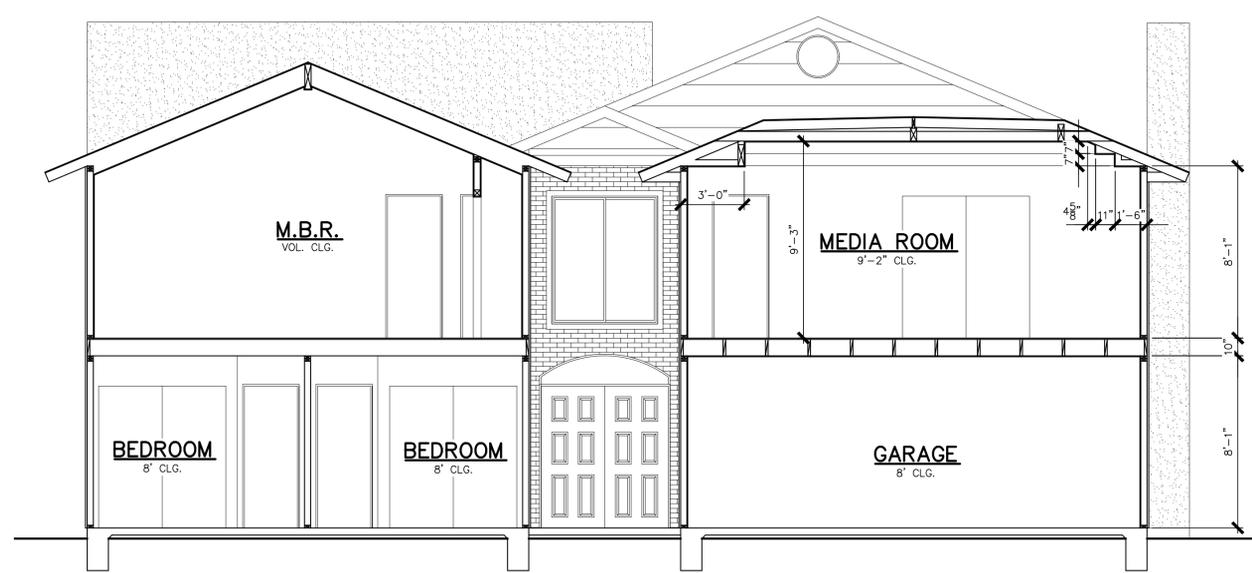


CROSS SECTION 1/4" = 1'-0"


BY/CHK.									
REVISIONS									
NO.									
DATE									
DES.	S.D.M.	D.W.	S.D.M.	CHK.	S.D.M.				
<p>PROPOSED REMODEL/ADDITION PLANS</p> <p>FOR</p> <p>MICHAEL HOPKINS & IRENE MORCOS</p> <p>LESCREW CONSTRUCTION</p> <p>9032 CHRISTINE DRIVE</p> <p>HUNTINGTON BEACH, CALIFORNIA 92646</p> <p>LOT 208, TRACT 3903</p>									
<p>AGAPE CIVIL ENGINEERING, INC.</p> <p>STEPHEN D. MILLER - Registered Civil Engineer</p> <p>CIVIL ENGINEERING CONSULTANTS, ARCHITECTURAL DESIGN & ENGINEERING</p> <p>P.O. BOX 8069 HUNTINGTON BEACH, CALIFORNIA 92648 (656) 472-8575</p> <p>AGAPECIVILENGINEERING@GMAIL.COM</p> <p>268-2204_rev1.dwg</p>									
<p>January 9, 2023</p>									
SHEET 10					OF 17				
JOB NO. 268-2204									

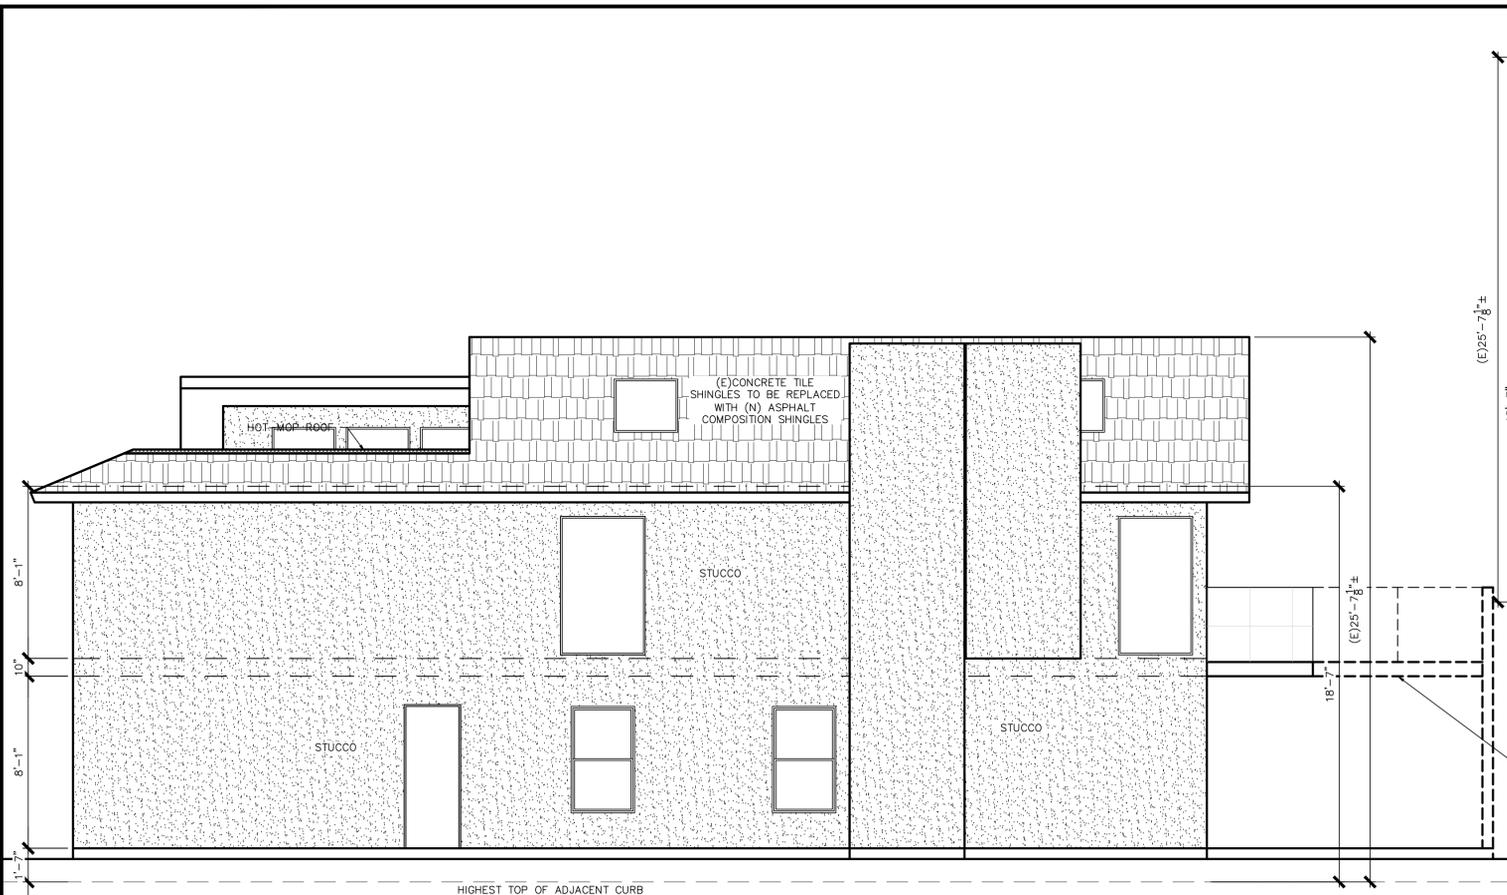


RIGHT ELEVATION $1/4" = 1'-0"$
West Elevation

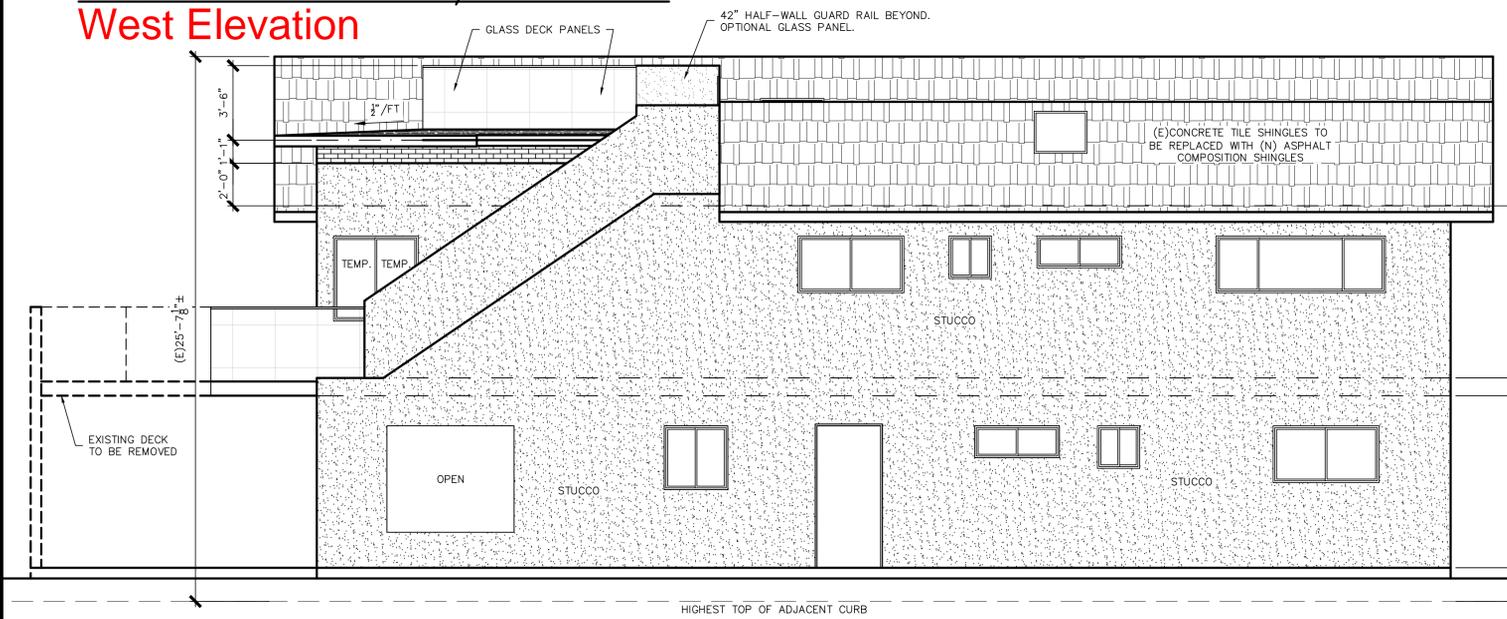

LEFT ELEVATION $1/4" = 1'-0"$
East Elevation

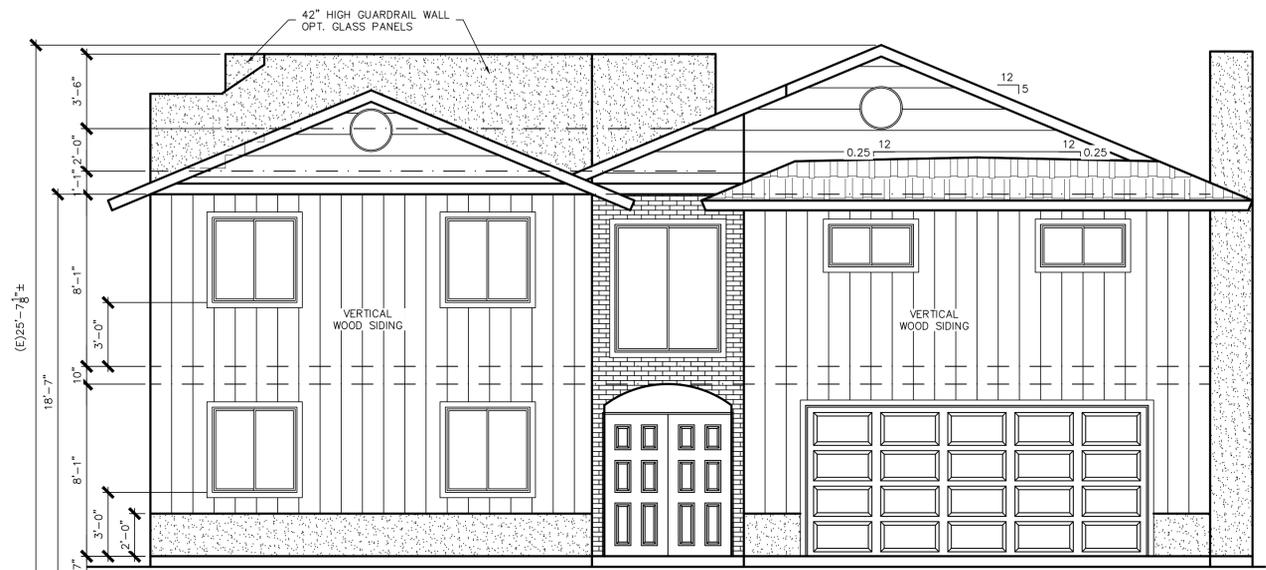

FRONT ELEVATION $1/4" = 1'-0"$
North Elevation

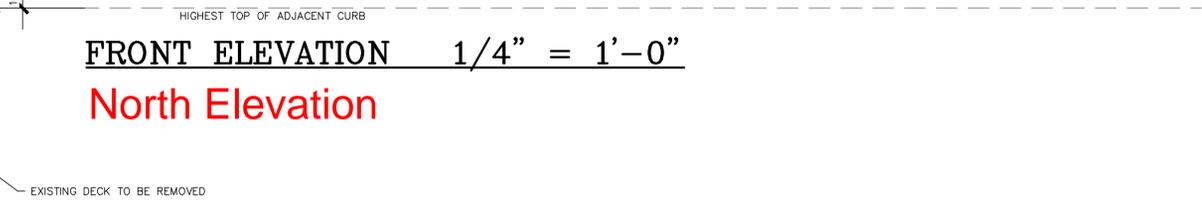

REAR ELEVATION $1/4" = 1'-0"$
South Elevation

STUCCO TO BE 3/8" THICK 3-COAT PER CBC 2512.1.2 OR PROVIDE ICC REPORT FOR ALTERNATIVE APPLICATION.

PER CRC 703.7.3, PROVIDE 2 LAYERS OF GRADE D PAPER WATER-RESISTIVE BARRIER FOR STUCCO EXTERIOR APPLICATION WHEN APPLIED TO WOOD BASED SHEATHING.

BY/CHK.		NO. DATE REVISIONS		DES. S.D.M.		DRW. S.D.M.		CHK. S.D.M.	

PROPOSED REMODEL/ADDITION PLANS FOR
MICHAEL HOPKINS & IRENE MORCOS
LESCREW CONSTRUCTION
 9032 CHRISTINE DRIVE
 HUNTINGTON BEACH, CALIFORNIA 92646
 LOT 208, TRACT 3903

AGAPE CIVIL ENGINEERING, INC.
STEPHEN D. MILLER - Registered Civil Engineer
 CIVIL ENGINEERING CONSULTANTS, ARCHITECTURE & ENGINEERING
 P.O. BOX 80900, HUNTINGTON BEACH, CALIFORNIA 92688 (TEL) 714-967-9575
 AGAPECIVILENGINEERING@GMAIL.COM
 268-2204_rev1.dwg

January 9, 2023


 SHEET 11 OF 17
 JOB NO. 268-2204

ELECTRICAL LEGEND

	DUPLEX RECEPTACLE @ +16" ; HALF SWITCHED
	220v OUTLET
	GROUND FAULT INTERRUPTOR OUTLET
	FLOOR OUTLET
	SURFACE MOUNTED L.E.D./FLUORESCENT FIXTURE
	SURFACE MOUNTED FIXTURE ON MOTION SENSOR
	WALL MOUNTED L.E.D./FLUORESCENT FIXTURE
	RECESSED (CAN) L.E.D./DISK L.E.D./FLUORESCENT FIXTURE
	RECESSED L.E.D./FLUORESCENT EYEBALL
	PHOTO CELL / PHOTO CONTROL SWITCH
	FLUORESCENT LIGHT
	SWITCH/DIMMER SWITCH/OCCUPANCY SENSOR/3 WAY/4 WAY
	WIRE RUN TO FIXTURE
	PENDANT LIGHTS (L.E.D., DIMMER, FLUOR.)
	T.V. OUTLET / TELEPHONE JACK / ETHERNET
	PUSH BUTTON SWITCH
	THERMOSTAT - AUTO SETBACK
	WEATHER RESISTANT / EXTRA DUTY WEATHER RESISTANT
	EXHAUST FAN - 50 CFM MINIMUM
	GAS HOOKUP w/ SHUT OFF
	HOSE
	FLOOD LIGHTS WITH MOTION SENSOR
	S.M.O.K.E. DETECTOR HARD WIRED WITH BATTERY BACKUP
	CO/S.M.O.K.E. DETECTOR COMBO HARD WIRED W/ BATTERY B/U
	J BOX
	VACANCY SENSOR/OCCUPANCY SENSOR/HUMIDITY SENSOR


- ELECTRICAL SERVICE NOTES**
- AT LEAST ONE WALL SWITCH-CONTROLLED LIGHTING OUTLET SHALL BE INSTALLED IN EVERY HABITABLE ROOM AND BATHROOM.
 - AT LEAST ONE WALL SWITCH-CONTROLLED LIGHTING OUTLET SHALL BE INSTALLED TO PROVIDE ILLUMINATION ON THE EXTERIOR SIDE OF OUTDOOR ENTRANCES OR EXITS WITH GRADE LEVEL ACCESS.
 - RECEPTACLES SHALL BE SPACED SO THAT NO POINT ALONG THE FLOOR LINE IS MORE THAN 6' FROM AN OUTLET.
 - RECEPTACLES IN BATHROOMS, GARAGES, LAUNDRY ROOMS, LOCATED OUTDOORS, OR WITHIN 6' OF ANY SINK SHALL BE PROTECTED BY A GROUND FAULT CIRCUIT INTERRUPTION SYSTEM (G.F.C.I.)
 - S.M.O.K.E. DETECTORS SHALL BE PLACED A MINIMUM OF 20' FROM COOKING APPLIANCES, 3 HORIZONTAL FEET FROM BATHROOM DOOR, 3' FROM AIR SUPPLY REGISTERS, 3' FROM THE TIP OF A FAN BLADE, AND NO MORE THAN 12" FROM THE CEILING. S.M.O.K.E. DETECTORS SHALL BE PERMANENTLY WIRED, INTERCONNECTED, AND HAVE A BATTERY BACKUP.
 - CARBON MONOXIDE ALARM SHALL BE INSTALLED IN ALL DWELLING UNITS PER CRC R315.3. ALARM SHALL BE HARD-WIRED WITH BATTERY BACKUP. CO ALARMS SHALL BE INSTALLED IN ROOMS LEADING TO AND IMMEDIATELY ADJACENT TO ALL SLEEPING ROOMS (HALLWAYS). WHERE MORE THAN ONE CO ALARM IS REQUIRED, THE DEVICES SHALL BE INTERCONNECTED (WIRED OR WIRELESS) SUCH THAT ACTIVATION OF ONE ALARM WILL ACTIVATE ALL THE OTHERS.
 - OUTLETS IN WALL BETWEEN GARAGE AND DWELLING SHALL BE METAL OR U.L. APPROVED PLASTIC AND SHALL BE OFFSET MIN. 24" HORIZONTALLY. SWITCH PLATES AT 42" A.F.F. TO CENTER.
 - ALL LIGHTING IN CLOSETS SHALL BE LOCATED MINIMUM 18" FROM ALL SHELVES.
 - PROVIDE A MINIMUM OF (2) 20 AMP SMALL APPLIANCE CIRCUITS FOR THE KITCHEN COUNTER TOPS. SUCH CIRCUIT SHALL HAVE NO OTHER OUTLETS. LOADS SHALL BE BALANCED.
 - ALL KITCHEN COUNTER OUTLETS SHALL BE 42" A.F.F.
 - ALL KITCHEN OUTLETS SHALL BE SPACED SO THAT NO POINT ALONG THE COUNTER IS MORE THAN 24" FROM AN OUTLET.
 - ALL KITCHEN COUNTER OUTLETS MUST BE G.F.C.I. PROTECTED.
 - ALL DWELLING UNIT OUTLET DEVICES INCLUDING KITCHENS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DEN'S, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND LAUNDRY AREAS AND SIMILAR SPACES, SHALL BE LISTED AS TAMPER RESISTANT AND SHALL HAVE A.F.C.I. PROTECTION.
 - ALL INSTALLED LUMINAIRES SHALL BE HIGH EFFICACY LIGHTING.
 - ANY JAB COMPLIANT LAMP/LUMINAIRE SHALL BE CONTROLLED BY A VACANCY SENSOR OR DIMMER.
 - UNDER CABINET LIGHTING MUST BE SWITCHED SEPARATELY FROM OTHER LIGHTING.
 - RECESSED DOWNLIGHTS SHALL BE INSULATION CONTACT RATED, SHALL NOT CONTAIN SCREW BASED SOCKETS, AND ONLY CONTAIN JAB-2016-E (E FOR ELEVATED TEMPERATURE) RATED BULBS.
 - ENCLOSED LUMINAIRES MUST CONTAIN JAB-2016-E (E FOR ELEVATED TEMPERATURE) RATED BULBS.
 - ALL EXHAUST FANS SHALL BE SWITCHED SEPARATELY FROM ANY/ALL LIGHTING.
 - ALL BATHROOMS SHALL BE EQUIPPED WITH 1 EXHAUST FAN, MINIMUM 50 CFM, REGARDLESS OF WINDOWS.
 - KITCHEN SHALL BE EQUIPPED WITH MINIMUM 100 CFM EXHAUST FAN.
 - IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS AT LEAST ONE LUMINAIRE SHALL BE CONTROLLED BY VACANCY SENSORS.
 - A PERMANENT ELECTRICAL OUTLET AND LIGHTING FIXTURE, CONTROLLED BY A SWITCH LOCATED AT THE ATTIC ACCESS SHALL BE PROVIDED AT OR NEAR THE ATTIC FURNACE. EQUIPMENT DISCONNECT SHALL BE PROVIDED ADJACENT TO THE EQUIPMENT.
 - AT LEAST ONE 20-AMP BRANCH CIRCUIT SHALL BE PROVIDED TO SUPPLY BATHROOM RECEPTACLE OUTLETS. OTHER EQUIPMENT WITHIN THE SAME BATHROOM MAY BE SUPPLIED BY THE SAME BRANCH CIRCUIT WHERE THE BRANCH CIRCUIT SUPPLIES A SINGLE BATHROOM ONLY.
 - LIGHT FIXTURES LOCATED IN TUB OR SHOWER ENCLOSURES SHALL BE LABELED "SUITABLE FOR WET LOCATIONS" OR "SUITABLE FOR DAMP LOCATIONS".
 - AT LEAST ONE 20-AMP DEDICATED BRANCH CIRCUIT SHALL BE PROVIDED TO SUPPLY THE LAUNDRY ROOM.
 - CLOTHES DRYERS AND ELECTRIC RANGES SHALL HAVE A 4-WIRE GROUNDING ELECTRICAL OUTLET.
 - PROVIDE EV CHARGING SUPPLY. PROVIDE 1" MIN. I.D. LISTED RACEWAY TO ACCOMMODATE A DEDICATED 208/240V BRANCH CIRCUIT TO THE MAIN ELECTRICAL PANEL. RACEWAY SHALL ORIGINATE AT THE MAIN PANEL AND TERMINATE IN A LISTED BOX AND IDENTIFIED AND LABELED PER 4.106.4.1.1. SERVICE PANEL SHALL PROVIDE CAPACITY TO INSTALL A MINIMUM DEDICATED BRANCH CIRCUIT AND SPACE RESERVED TO PERMIT INSTALLATION OF A BRANCH CIRCUIT OVERCURRENT PROTECTIVE DEVICE.
 - THE NUMBER OF BLANK ELECTRICAL BOXES WHICH ARE MORE THAN 5' ABOVE THE FINISHED FLOOR SHALL BE NO GREATER THAN THE NUMBER OF BEDROOMS. THE ELECTRICAL BOXES MUST BE SERVED BY A DIMMER, VACANCY SENSOR, OR FAN SPEED CONTROL.
 - ALL OUTDOOR LIGHTING SHALL BE CONTROLLED BY A MANUAL ON/OFF SWITCH AND ALSO ONE OF THE FOLLOWING:
 - PHOTOCELL WITH MOTION SENSOR
 - PHOTOCONTROL AND AUTOMATIC TIME SWITCH CONTROL
 - ASTRONOMICAL TIME CLOCK
 - ENERGY MANAGEMENT CONTROL SYSTEM.
 - HVAC EQUIPMENT SHALL BE SUPPLIED BY AN INDIVIDUAL BRANCH CIRCUIT.
 - RANGE HOOD SHALL BE SUPPLIED BY AN INDIVIDUAL BRANCH CIRCUIT.
 - A DEDICATED 125V, 20A ELECTRICAL RECEPTACLE THAT IS CONNECTED TO THE ELECTRIC PANEL WITH A 120V/240V 3-CONDUCTOR, 10AWG COPPER BRANCH CIRCUIT SHALL BE PROVIDED WITHIN 3' FROM THE WATER HEATER AND ACCESSIBLE TO THE WATER HEATER WITH NO OBSTRUCTIONS

- ELECTRICAL GENERAL NOTES**
- ALL BEDROOMS, LIVING ROOM, DEN, PATIO, AND KITCHEN TO BE WIRED FOR CABLE AND TELEPHONE JACKS. GARAGE TO BE WIRED FOR PHONE JACK. HOMEOWNER TO APPROVE ALL LOCATIONS FOR SUCH.
 - PRE-WIRE FOR ALARM SYSTEM AND SURROUND SOUND (OPTIONAL).
 - HOMEOWNER TO APPROVE ALL LIGHT FIXTURES, APPLIANCES, SWITCHES, STYLE, LOCATIONS, ETC. WITH ELECTRICAL CONTRACTOR.
 - SEE OWNER ALSO FOR ANY ADDITIONAL SWITCHES FOR YARD LIGHTING, POOL EQUIPMENT, MOTION DETECTORS, AND IRRIGATION EQUIPMENT.

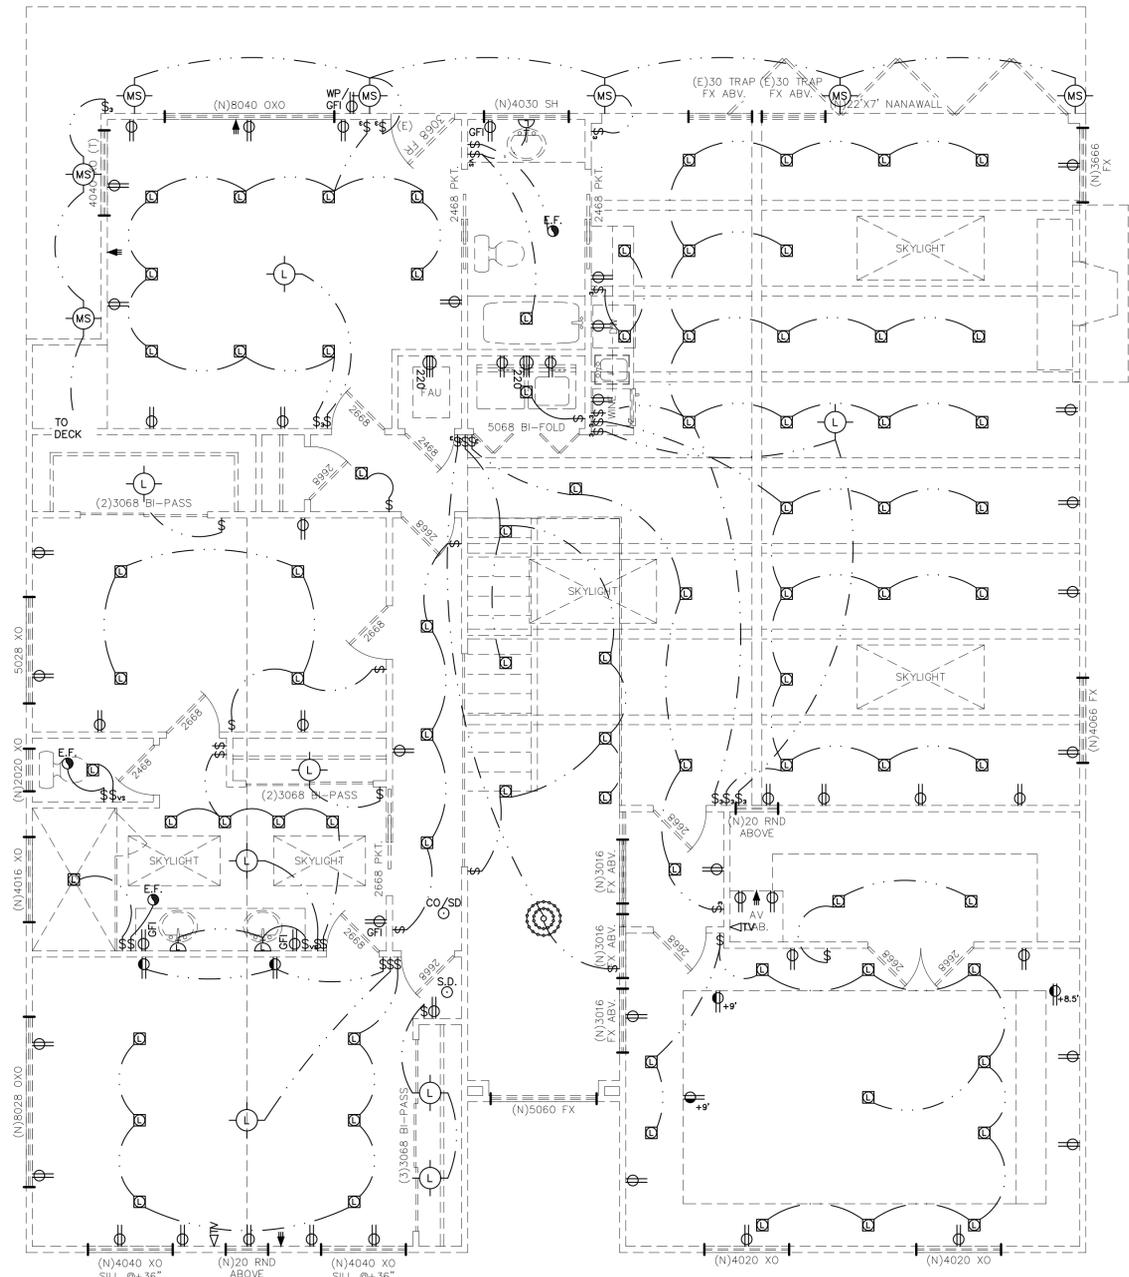

UPPER LEVEL ELECTRICAL PLAN 1/4" = 1'-0"

THE ELECTRICAL PANEL MAY NOT BE LOCATED WITHIN A SHEAR WALL.

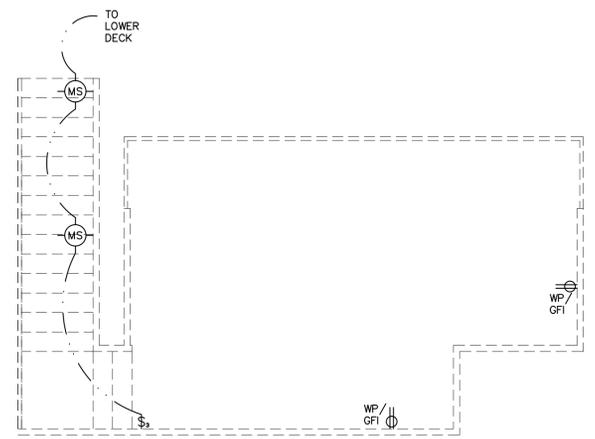

DECK ELECTRICAL PLAN 1/4" = 1'-0"

NO.	DATE	REVISIONS	BY/CHK.	
			DES.	CHK.

PROPOSED REMODEL/ADDITION PLANS FOR
 MICHAEL HOPKINS & IRENE MORCOS
 LESCREW CONSTRUCTION
 9032 CHRISTINE DRIVE
 HUNTINGTON BEACH, CALIFORNIA 92646
 LOT 208, TRACT 3903

AGAPE CIVIL ENGINEERING, INC.
 STEPHEN D. MILLER - Registered Civil Engineer
 CIVIL ENGINEERING CONSULTANTS & ENGINEERING
 P.O. BOX 9888, HUNTINGTON BEACH, CALIFORNIA 92646 (REG. #47-9575)
 AGAPECIVILENGINEERING@GMAIL.COM
 268-2204_rev1.dwg

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 1 of 14

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
01	Run Title	2012 Christina Drive	05	Standards Version	2019										
02	City	Christina Beach	06	Software Version	2019										
03	Zip Code	92546	07	Energy Pro	8.3										
04	Climate Zone	5	08	Front Orientation (Avg. Cardinal)	45										
05	Building Type	Single Family	09	Number of Dwelling Units	1										
06	Project Owner	AGAPE ENGINEERING	10	Number of Bedrooms	2										
07	141 Addition Cond. Floor Area (ft²)	1750	11	Number of Stories	2										
08	Existing Cond. Floor Area (ft²)	1240	12	Fenestration Average U-Factor	0.3										
09	18 Total Cond. Floor Area (ft²)	1410	13	Glazing Percentage (%)	18.23%										
10	ADU Bedroom Count	n/a	14	ADU Conditioned Floor Area	n/a										
11	% Natural Gas Available	n/a	15												

COMPLIANCE RESULTS

01 Building Complies with Computer Performance
 02 This building incorporates features that require field testing and/or verification by a certified HERS Rater under the supervision of a CEC-approved HERS provider.
 03 This building incorporates one or more Special Features shown below

Energy Use (kBtu/ft²-yr)	Standard Design	Proposed Design	Compliance Margin	Percent Improvement
Space Heating	10.68	9.75	0.93	8.7
Space Cooling	5.53	6.26	-0.73	-13.2
IAQ Ventilation	3.29	3.29	0	0
Water Heating	7.08	7.08	0	0
Solar Infiltration/HeatBridging	n/a	0	n/a	n/a
Compliance Energy Total	26.58	26	0.58	2.2

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 1 of 14

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
01	Name	Zone	Construction	Admth	Orientation	Area (ft²)	Skylight Area (ft²)	Roof Rise (in 12)	Roof Slope	Roof Reflectance	Roof Insulation	Roof Cool Roof	Status	Verified Existing Condition	Existing Construction
02	Zone 3 - Existing Upper L	R-30 Roof No Attic	180	n/a	n/a	795	54	5	0.1	0.85	No	Existing	No	n/a	
03	Zone 4 - New Upper Level	R-30 Roof No Attic	0	n/a	n/a	1371	20	5	0.1	0.85	No	New	n/a	n/a	

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
2020	Window	Left Wall	Left	130		1	4	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4016	Window	Left Wall	Left	130		1	6	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3030	Window	Left Wall	Left	135		1	9	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
6008	Window	Rear Wall	Back	225		1	40	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3008	Window	Rear Wall	Back	225		1	20	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
8030	Window	Rear Wall	Back	225		1	24	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
8068	Window	Rear Wall	Back	225		1	53.93	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3040	Window	Right Wall	Right	315		1	12	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3042	Window	Right Wall	Right	315		1	12	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4040	Window	Rear Wall 2	Back	225		1	16	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4042	Window	Front Wall 2	Front	45		1	16	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
5028	Window	Left Wall 2	Left	135		1	13.33	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
2040	Window	Right Wall 2	Right	315		1	8	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
30nd	Window	Rear Wall 3	Rear	45		1	3.44	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 9 of 14

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous Insulation	U-factor	Assembly Layers
R-0 Floor No Crawlspace	Interior Floors	Wood Framed Floor	2x12 @ 16 in. O. C.	R-0	None / None	0.2	Floor Surface: Carpeted Floor Deck: Wood Siding/Sheathing/Insulating Cavity / Frame: no Insul. / 2x12 Ceiling Below Finish: Gypsum Board
Roof of R-0 Floor No Crawlspace	Interior Floors	Wood Framed Floor	2x12 @ 16 in. O. C.	R-0	None / None	0.2	Floor Surface: Carpeted Floor Deck: Wood Siding/Sheathing/Insulating Cavity / Frame: no Insul. / 2x12 Ceiling Below Finish: Gypsum Board
R-0 Roof No Attic	Interior Ceiling	Wood Framed Ceiling	2x6 @ 16 in. O. C.	R-0	None / None	0.202	Floor Surface: Carpeted Floor Deck: Wood Siding/Sheathing/Insulating Cavity / Frame: no Insul. / 2x4 Ceiling Below Finish: Gypsum Board

BUILDING ENVELOPE - HERS VERIFICATION

01	02	03	04
Quality Insulation Installation (QI)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50
Required	Not Required	Not Required	n/a

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 13 of 14

01	02	03	04	05	06	07
Dwelling Unit	IAQ CFM	IAQ W5/CFM	IAQ Fan Type	IAQ Recovery Effectiveness - SRE	IAQ Recovery Effectiveness - ASRE	HERS Verification
5 from IAQventType	166	0.95	Exhaust	n/a	n/a	Yes

HERS RATER VERIFICATION OF EXISTING CONDITIONS

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 2 of 14

REQUIRED SPECIAL FEATURES

The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.

- Ducts with high level of insulation
- Floor has high level of insulation
- Non-standard duct location (any location other than attic)

HERS FEATURE SUMMARY

The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional details are provided in the Building Label below. Registered CFMs and CFMs are required to be completed in the HERS Rater.

BUILDING - FEATURES INFORMATION

01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Residential Building	1419	1	5	4	0	1

ZONE INFORMATION

01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Water Heating System 2
Zone 1 - Existing Lower L	Conditioned	HVAC System1	1335	8	DHW Sys 1	N/A

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 6 of 14

FENESTRATION / GLAZING

01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16
8040	Window	Rear Wall 2	Back	225		1	32	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3042	Window	Rear Wall 2	Back	225		1	20	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4020	Window	Rear Wall 2	Back	225		1	12	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3079a	Window	Rear Wall 2	Back	225		1	15.28	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3079b	Window	Rear Wall 2	Back	225		1	15.28	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
2207a	Window	Rear Wall 2	Back	225		1	154	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
2066	Window	Right Wall 2	Right	315		1	22.75	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4056	Window	Right Wall 2	Right	315		1	26	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4020	Window	Front Wall 4	Front	45		1	8	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4022	Window	Front Wall 4	Front	45		1	8	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
5060	Window	Front Wall 3	Front	45		1	30	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4004	Window	Front Wall 4	Front	45		1	16	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4004	Window	Front Wall 4	Front	45		1	16	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
20nd2	Window	Left Wall 4	Left	45		1	3.44	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
8028	Window	Left Wall 3	Left	135		1	13.33	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4052	Window	Left Wall 3	Left	135		1	4	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
2022	Window	Left Wall 3	Left	135		1	4	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
50B2	Window	Left Wall 3	Left	135		1	13.33	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
4045	Window	Left Wall 3	Left	135		1	16	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3016	Window	Right Wall 4	Right	315		1	4.5	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3012	Window	Right Wall 4	Right	315		1	4.5	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
3013	Window	Right Wall 4	Right	315		1	4.5	0.3	NFRC	0.23	NFRC	Bag Screen	Existing	No	n/a
6010 Skylight	Skylight	Roof	180		1	18	0.3	NFRC	0.23	NFRC	None	Existing	No	n/a	
6025 Skylight 2	Skylight	Roof	180		1	18	0.3	NFRC	0.23	NFRC	None	Existing	No	n/a	
6035 Skylight 3	Skylight	Roof	180		1	18	0.3	NFRC	0.23	NFRC	None	Existing	No	n/a	

Registration Number: 222-P010129800-000-000-000000-0000
 CA Building Energy Efficiency Standards - 2019 Residential Compliance
 Registration Date/Time: 2023-01-09 10:16:34
 Report Version: 2019.2.000
 Schema Version: rev 20200901
 HERS Provider: CalCERTS, Inc.
 Report Generated: 2023-01-09 10:05:59

CERTIFICATE OF COMPLIANCE
 Project Name: Residential Building
 Calculation Date/Time: 2023-01-09T10:05:19-08:00
 Input File Name: 268-2204_rev1.rbd19x
 Page 10 of 14

WATER HEATING SYSTEMS

01	02	03	04	05	06	07	08	09	10
Name	System Type	Distribution Type	Water Heater Name (ft)	Solar Heating System	Compact Distribution	HERS Verification	Status	Verified Existing Condition	Existing Water Heating System
DHW Sys 1	Domestic Hot Water (DHW)	Standard Distribution System	DHW Heater (1)	n/a	None	n/a	New	NA	NA

WATER HEATERS

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Heating Element Type	Bank Type	# of Units	Watt/Element Efficiency	Input Rating or Input (kW/ft²)	Tank Insulation (R-Value)	Standby Loss (Btu/hr-ft²)	1st Fl. Rating or Flow Size	NEA Heat Pump Brand or Model	Tank Location	Status	Verified Existing Condition	
DHW 1	Gas	Consumer Instantaneous	1	10	0.82 UEF	1-300 MBtu/hr	n/a	n/a	n/a	n/a	New	NA	

WATER HEATING - HERS VERIFICATION

01	02	03	04	05	06	07	08
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution	Recirculation Control	Control DHW Distribution	Showers

BUILDING ENERGY ANALYSIS REPORT	
PROJECT: Michael Hopkins & Irene Morcos 9032 Christine Drive Huntington Beach, CA 92646	
Project Designer: Agape Civil Engineering, Inc. P.O. Box 8504 Long Beach, CA 90808 661-472-9575	
Report Prepared by: Stephen Miller Agape Civil Engineering, Inc. P.O. Box 8504 Long Beach, CA 90808 661-472-9575	
Job Number: 268-2204	
Date: 1/9/2023	
<small>The EnergyPro computer program has been used to perform the calculations summarized in this compliance report. This program has approval and is authorized by the California Energy Commission to use with the Residential and Nonresidential 2019 Building Energy Efficiency Standards. This program developed by EnergySoft Software - www.energysoft.com</small>	

RESIDENTIAL MEASURES SUMMARY		RMS-1																																																																																
<small>Project Name: Michael Hopkins & Irene Morcos, Building Type: Single Family, Addition Alone, Date: 1/9/2023, Project Address: 9032 Christine Drive, Huntington Beach, CA, Climate Zone 06, Total Cond. Floor Area: 4,189, Addition: 1,769, # of Units: 1</small>																																																																																		
INSULATION <table border="1"> <thead> <tr> <th>Construction Type</th> <th>Cavity</th> <th>Area (ft²)</th> <th>Special Features</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>125</td><td>Existing</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>141</td><td>Existing</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>263</td><td>Existing</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>307</td><td>Existing</td></tr> <tr><td>Door</td><td>Opaque Door</td><td>R-5</td><td>17</td><td>Existing</td></tr> <tr><td>Slab</td><td>Unheated Slab-on-Grade</td><td>-no insulation</td><td>1,335</td><td>Perim = 0'</td><td>Existing</td></tr> <tr><td>Ceiling</td><td>Wood Framed</td><td>-no insulation</td><td>791</td><td>New</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>1,330</td><td>New</td></tr> </tbody> </table>			Construction Type	Cavity	Area (ft ²)	Special Features	Status	Wall	Wood Framed	R-13	125	Existing	Wall	Wood Framed	R-13	141	Existing	Wall	Wood Framed	R-13	263	Existing	Wall	Wood Framed	R-13	307	Existing	Door	Opaque Door	R-5	17	Existing	Slab	Unheated Slab-on-Grade	-no insulation	1,335	Perim = 0'	Existing	Ceiling	Wood Framed	-no insulation	791	New	Wall	Wood Framed	R-13	1,330	New																																		
Construction Type	Cavity	Area (ft ²)	Special Features	Status																																																																														
Wall	Wood Framed	R-13	125	Existing																																																																														
Wall	Wood Framed	R-13	141	Existing																																																																														
Wall	Wood Framed	R-13	263	Existing																																																																														
Wall	Wood Framed	R-13	307	Existing																																																																														
Door	Opaque Door	R-5	17	Existing																																																																														
Slab	Unheated Slab-on-Grade	-no insulation	1,335	Perim = 0'	Existing																																																																													
Ceiling	Wood Framed	-no insulation	791	New																																																																														
Wall	Wood Framed	R-13	1,330	New																																																																														
FENESTRATION <table border="1"> <thead> <tr> <th>Orientation</th> <th>Area (ft²)</th> <th>U-Fac</th> <th>SHGC</th> <th>Overhang</th> <th>Sidelights</th> <th>Exterior Shades</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Left (SE)</td><td>64.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>New</td></tr> <tr><td>Left (SE)</td><td>9.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>Existing</td></tr> <tr><td>Rear (SW)</td><td>262.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>New</td></tr> <tr><td>Rear (SW)</td><td>103.9</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>Existing</td></tr> <tr><td>Right (NW)</td><td>68.3</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>New</td></tr> <tr><td>Front (NE)</td><td>116.3</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>New</td></tr> <tr><td>Right (NW)</td><td>26.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>Existing</td></tr> <tr><td>Skylight</td><td>54.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>Existing</td></tr> <tr><td>Skylight</td><td>20.0</td><td>0.300</td><td>0.23</td><td>none</td><td>none</td><td>N/A</td><td>New</td></tr> </tbody> </table>			Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status	Left (SE)	64.0	0.300	0.23	none	none	N/A	New	Left (SE)	9.0	0.300	0.23	none	none	N/A	Existing	Rear (SW)	262.0	0.300	0.23	none	none	N/A	New	Rear (SW)	103.9	0.300	0.23	none	none	N/A	Existing	Right (NW)	68.3	0.300	0.23	none	none	N/A	New	Front (NE)	116.3	0.300	0.23	none	none	N/A	New	Right (NW)	26.0	0.300	0.23	none	none	N/A	Existing	Skylight	54.0	0.300	0.23	none	none	N/A	Existing	Skylight	20.0	0.300	0.23	none	none	N/A	New
Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status																																																																											
Left (SE)	64.0	0.300	0.23	none	none	N/A	New																																																																											
Left (SE)	9.0	0.300	0.23	none	none	N/A	Existing																																																																											
Rear (SW)	262.0	0.300	0.23	none	none	N/A	New																																																																											
Rear (SW)	103.9	0.300	0.23	none	none	N/A	Existing																																																																											
Right (NW)	68.3	0.300	0.23	none	none	N/A	New																																																																											
Front (NE)	116.3	0.300	0.23	none	none	N/A	New																																																																											
Right (NW)	26.0	0.300	0.23	none	none	N/A	Existing																																																																											
Skylight	54.0	0.300	0.23	none	none	N/A	Existing																																																																											
Skylight	20.0	0.300	0.23	none	none	N/A	New																																																																											
HVAC SYSTEMS <table border="1"> <thead> <tr> <th>Qty.</th> <th>Heating</th> <th>Min. Eff</th> <th>Cooling</th> <th>Min. Eff</th> <th>Thermostat</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Central Furnace</td> <td>80% AFUE</td> <td>SPR Air Conditioner</td> <td>14 SEER</td> <td>Setback</td> <td>New</td> </tr> </tbody> </table>			Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status	1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New																																																																		
Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status																																																																												
1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New																																																																												
HVAC DISTRIBUTION <table border="1"> <thead> <tr> <th>Location</th> <th>Heating</th> <th>Cooling</th> <th>Duct Location</th> <th>Duct R-Value</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>HVAC System</td> <td>Ducted</td> <td>Ducted</td> <td>Conditioned</td> <td>8.0</td> <td>New</td> </tr> </tbody> </table>			Location	Heating	Cooling	Duct Location	Duct R-Value	Status	HVAC System	Ducted	Ducted	Conditioned	8.0	New																																																																				
Location	Heating	Cooling	Duct Location	Duct R-Value	Status																																																																													
HVAC System	Ducted	Ducted	Conditioned	8.0	New																																																																													
WATER HEATING <table border="1"> <thead> <tr> <th>Qty.</th> <th>Type</th> <th>Gallons</th> <th>Min. Eff</th> <th>Distribution</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Small Instantaneous Gas</td> <td>1</td> <td>0.82</td> <td>Standard</td> <td>New</td> </tr> </tbody> </table>			Qty.	Type	Gallons	Min. Eff	Distribution	Status	1	Small Instantaneous Gas	1	0.82	Standard	New																																																																				
Qty.	Type	Gallons	Min. Eff	Distribution	Status																																																																													
1	Small Instantaneous Gas	1	0.82	Standard	New																																																																													
<small>EnergyPro 8.3 by EnergySoft User Number: 5554 ID: 268-2204 Page: 17 of 24</small>																																																																																		

RESIDENTIAL MEASURES SUMMARY		RMS-1																									
<small>Project Name: Michael Hopkins & Irene Morcos, Building Type: Single Family, Addition Alone, Date: 1/9/2023, Project Address: 9032 Christine Drive, Huntington Beach, CA, Climate Zone 06, Total Cond. Floor Area: 4,189, Addition: 1,769, # of Units: 1</small>																											
INSULATION <table border="1"> <thead> <tr> <th>Construction Type</th> <th>Cavity</th> <th>Area (ft²)</th> <th>Special Features</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Ceiling</td><td>Wood Framed w/Ceiling Space</td><td>-no insulation</td><td>802</td><td>New</td></tr> <tr><td>Roof</td><td>Wood Framed Rafter</td><td>R-38</td><td>1,351</td><td>New</td></tr> <tr><td>Ceiling</td><td>Wood Framed w/Ceiling Space</td><td>-no insulation</td><td>483</td><td>New</td></tr> <tr><td>Floor</td><td>Wood Framed w/Crawl Space</td><td>R-19</td><td>532</td><td>New</td></tr> </tbody> </table>			Construction Type	Cavity	Area (ft ²)	Special Features	Status	Ceiling	Wood Framed w/Ceiling Space	-no insulation	802	New	Roof	Wood Framed Rafter	R-38	1,351	New	Ceiling	Wood Framed w/Ceiling Space	-no insulation	483	New	Floor	Wood Framed w/Crawl Space	R-19	532	New
Construction Type	Cavity	Area (ft ²)	Special Features	Status																							
Ceiling	Wood Framed w/Ceiling Space	-no insulation	802	New																							
Roof	Wood Framed Rafter	R-38	1,351	New																							
Ceiling	Wood Framed w/Ceiling Space	-no insulation	483	New																							
Floor	Wood Framed w/Crawl Space	R-19	532	New																							
FENESTRATION <table border="1"> <thead> <tr> <th>Orientation</th> <th>Area (ft²)</th> <th>U-Fac</th> <th>SHGC</th> <th>Overhang</th> <th>Sidelights</th> <th>Exterior Shades</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Total Area</td><td>763</td><td></td><td></td><td></td><td></td><td></td><td>0.30</td></tr> </tbody> </table>			Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status	Total Area	763						0.30									
Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status																				
Total Area	763						0.30																				
HVAC SYSTEMS <table border="1"> <thead> <tr> <th>Qty.</th> <th>Heating</th> <th>Min. Eff</th> <th>Cooling</th> <th>Min. Eff</th> <th>Thermostat</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Central Furnace</td> <td>80% AFUE</td> <td>SPR Air Conditioner</td> <td>14 SEER</td> <td>Setback</td> <td>New</td> </tr> </tbody> </table>			Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status	1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New											
Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status																					
1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New																					
HVAC DISTRIBUTION <table border="1"> <thead> <tr> <th>Location</th> <th>Heating</th> <th>Cooling</th> <th>Duct Location</th> <th>Duct R-Value</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>HVAC System</td> <td>Ducted</td> <td>Ducted</td> <td>Conditioned</td> <td>8.0</td> <td>New</td> </tr> </tbody> </table>			Location	Heating	Cooling	Duct Location	Duct R-Value	Status	HVAC System	Ducted	Ducted	Conditioned	8.0	New													
Location	Heating	Cooling	Duct Location	Duct R-Value	Status																						
HVAC System	Ducted	Ducted	Conditioned	8.0	New																						
WATER HEATING <table border="1"> <thead> <tr> <th>Qty.</th> <th>Type</th> <th>Gallons</th> <th>Min. Eff</th> <th>Distribution</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Small Instantaneous Gas</td> <td>1</td> <td>0.82</td> <td>Standard</td> <td>New</td> </tr> </tbody> </table>			Qty.	Type	Gallons	Min. Eff	Distribution	Status	1	Small Instantaneous Gas	1	0.82	Standard	New													
Qty.	Type	Gallons	Min. Eff	Distribution	Status																						
1	Small Instantaneous Gas	1	0.82	Standard	New																						
<small>EnergyPro 8.3 by EnergySoft User Number: 5554 ID: 268-2204 Page: 17 of 24</small>																											

TABLE OF CONTENTS	
Cover Page	1
Table of Contents	2
Form CF1R-PRF-01-E Certificate of Compliance	3
Form RMS-1 Residential Measures Summary	17
Form MF-1R Mandatory Measures Summary	20
HVAC System Heating and Cooling Loads Summary	24

RESIDENTIAL MEASURES SUMMARY		RMS-1																																													
<small>Project Name: Michael Hopkins & Irene Morcos, Building Type: Single Family, Addition Alone, Date: 1/9/2023, Project Address: 9032 Christine Drive, Huntington Beach, CA, Climate Zone 06, Total Cond. Floor Area: 4,189, Addition: 1,769, # of Units: 1</small>																																															
INSULATION <table border="1"> <thead> <tr> <th>Construction Type</th> <th>Cavity</th> <th>Area (ft²)</th> <th>Special Features</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Door</td><td>Opaque Door</td><td>R-5</td><td>57</td><td>New</td></tr> <tr><td>Slab</td><td>Unheated Slab-on-Grade</td><td>-no insulation</td><td>241</td><td>New</td></tr> <tr><td>Ceiling</td><td>Wood Framed Rafter</td><td>-no insulation</td><td>241</td><td>New</td></tr> <tr><td>Floor</td><td>Wood Framed w/Crawl Space</td><td>R-22</td><td>287</td><td>New</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>398</td><td>Existing</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>91</td><td>Existing</td></tr> <tr><td>Wall</td><td>Wood Framed</td><td>R-13</td><td>214</td><td>Existing</td></tr> <tr><td>Roof</td><td>Wood Framed Rafter</td><td>R-39</td><td>741</td><td>Existing</td></tr> </tbody> </table>			Construction Type	Cavity	Area (ft ²)	Special Features	Status	Door	Opaque Door	R-5	57	New	Slab	Unheated Slab-on-Grade	-no insulation	241	New	Ceiling	Wood Framed Rafter	-no insulation	241	New	Floor	Wood Framed w/Crawl Space	R-22	287	New	Wall	Wood Framed	R-13	398	Existing	Wall	Wood Framed	R-13	91	Existing	Wall	Wood Framed	R-13	214	Existing	Roof	Wood Framed Rafter	R-39	741	Existing
Construction Type	Cavity	Area (ft ²)	Special Features	Status																																											
Door	Opaque Door	R-5	57	New																																											
Slab	Unheated Slab-on-Grade	-no insulation	241	New																																											
Ceiling	Wood Framed Rafter	-no insulation	241	New																																											
Floor	Wood Framed w/Crawl Space	R-22	287	New																																											
Wall	Wood Framed	R-13	398	Existing																																											
Wall	Wood Framed	R-13	91	Existing																																											
Wall	Wood Framed	R-13	214	Existing																																											
Roof	Wood Framed Rafter	R-39	741	Existing																																											
FENESTRATION <table border="1"> <thead> <tr> <th>Orientation</th> <th>Area (ft²)</th> <th>U-Fac</th> <th>SHGC</th> <th>Overhang</th> <th>Sidelights</th> <th>Exterior Shades</th> <th>Status</th> </tr> </thead> <tbody> <tr><td>Total Area</td><td>1,031</td><td></td><td></td><td></td><td></td><td></td><td>0.30</td></tr> </tbody> </table>			Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status	Total Area	1,031						0.30																													
Orientation	Area (ft ²)	U-Fac	SHGC	Overhang	Sidelights	Exterior Shades	Status																																								
Total Area	1,031						0.30																																								
HVAC SYSTEMS <table border="1"> <thead> <tr> <th>Qty.</th> <th>Heating</th> <th>Min. Eff</th> <th>Cooling</th> <th>Min. Eff</th> <th>Thermostat</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Central Furnace</td> <td>80% AFUE</td> <td>SPR Air Conditioner</td> <td>14 SEER</td> <td>Setback</td> <td>New</td> </tr> </tbody> </table>			Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status	1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New																															
Qty.	Heating	Min. Eff	Cooling	Min. Eff	Thermostat	Status																																									
1	Central Furnace	80% AFUE	SPR Air Conditioner	14 SEER	Setback	New																																									
HVAC DISTRIBUTION <table border="1"> <thead> <tr> <th>Location</th> <th>Heating</th> <th>Cooling</th> <th>Duct Location</th> <th>Duct R-Value</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>HVAC System</td> <td>Ducted</td> <td>Ducted</td> <td>Conditioned</td> <td>8.0</td> <td>New</td> </tr> </tbody> </table>			Location	Heating	Cooling	Duct Location	Duct R-Value	Status	HVAC System	Ducted	Ducted	Conditioned	8.0	New																																	
Location	Heating	Cooling	Duct Location	Duct R-Value	Status																																										
HVAC System	Ducted	Ducted	Conditioned	8.0	New																																										
WATER HEATING <table border="1"> <thead> <tr> <th>Qty.</th> <th>Type</th> <th>Gallons</th> <th>Min. Eff</th> <th>Distribution</th> <th>Status</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Small Instantaneous Gas</td> <td>1</td> <td>0.82</td> <td>Standard</td> <td>New</td> </tr> </tbody> </table>			Qty.	Type	Gallons	Min. Eff	Distribution	Status	1	Small Instantaneous Gas	1	0.82	Standard	New																																	
Qty.	Type	Gallons	Min. Eff	Distribution	Status																																										
1	Small Instantaneous Gas	1	0.82	Standard	New																																										
<small>EnergyPro 8.3 by EnergySoft User Number: 5554 ID: 268-2204 Page: 18 of 24</small>																																															

2019 Low-Rise Residential Mandatory Measures Summary	
<small>NOTE: Low-rise residential buildings subject to the Energy Standards must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective sections for more information. Exceptions may apply.</small>	
Building Envelope Measures:	
§ 110.0(a)(1)	Air Leakage: Manufactured fenestration, exterior doors, and exterior roof doors must limit air leakage to 0.3 CFM per square foot or less in accordance with NFRC-400, ASTM E283 or AIAA/WMA/MSA 1515.5, 2.4.46-2011.
§ 110.0(a)(2)	Labeling: Fenestration products and exterior doors must have a label meeting the requirements of 10-11116.
§ 110.0(a)(3)	Field Insulation: Exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from Tables 110.0.A, 110.0.B, or J4.4.5 for exterior doors. They must be caulked and/or weather-stripped.
§ 110.7	Air Leakage: All joints, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gasketed, or weather-stripped.
§ 110.0(a)(4)	Insulation Certification by Manufacturers: Insulation must be certified by the Department of Consumer Affairs, Bureau of Household Goods and Services (DHSGS).
§ 110.0(a)(5)	Insulation Requirements for Heated Slab Floors: Heated slab floors must be insulated per the requirements of § 110.0(g).
§ 110.0(a)(6)	Roofing Products Solar Reflectance and Thermal Emittance: The thermal emittance and aged solar reflectance values of the roofing material must meet the requirements of § 110.0(i) and be labeled per § 10-110 when the installation of a roof is specified on the CFM.
§ 110.0(a)(7)	Radient Barriers: When required, radient barriers must have an emittance of 0.05 or less and be certified by the Department of Consumer Affairs.
§ 110.0(a)(8)	Ceiling and Rafter Roof Insulation: Minimum R-22 insulation in wood frame ceiling, or the weighted average U-factor must not exceed 0.043. Minimum R-19 weighted average U-factor of 0.044 or less in a rafter roof structure. Also, access doors must have permanently attached insulation using adhesive or mechanical fasteners. The attic access must be gasketed to prevent air leakage. Insulation must be installed in direct contact with a continuous roof or ceiling which is sealed to limit infiltration and exfiltration as specified in § 110.7, including but not limited to blocking insulation either above or below the roof deck or on top of a rafter ceiling.
§ 150.0(a)	Loose-fill Insulation: Loose fill insulation must meet the manufacturer's required density for the labeled R-value.
§ 150.0(b)	Wall Insulation: Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-factor of 0.102 or less, or R-20 in 2x6 inch wood framing or have a U-factor of 0.071 or less. Opaque non-framed assemblies must have an overall assembly U-factor not exceeding 0.102. Masonry walls must meet Tables 150.0.A or B.
§ 150.0(c)	Roof Edge Insulation: Minimum R-19 insulation in rafter wood framing roof or 0.037 maximum U-factor.
§ 150.0(d)	Slab Edge Insulation: Slab edge insulation must be installed in rafter wood framing roof, for the insulation absorption rate, for the insulation absorption rate, no greater than 0.3 percent, have a water vapor permeance no greater than 2 perm per inch, be protected from physical damage and UV light deterioration, and, when installed as part of a heated slab floor, meet the requirements of § 110.0(g).
§ 150.0(e)	Vapor Retarder: In climate zones 1 through 16, the earth floor or unvented crawl space must be covered with a Class I or Class II vapor retarder. This requirement also applies to conditioned ventilation crawl space for buildings complying with the exception to § 150.0(d).
§ 150.0(g)(1)	Vapor Retarder: In climate zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, window walls, and overhead attic with a permeable insulation.
§ 150.0(g)(2)	Fenestration Products: Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-factor of 0.30 or the weighted average U-factor of all fenestration must not exceed 0.30.
§ 150.0(h)	Fluorescent, Decorative Gas Appliances, and Gas Log Measures:
§ 110.0(a)(1)	Pilot Light: Continuously burning pilot lights are not allowed for indoor and outdoor appliances.
§ 150.0(a)(2)	Operable Doors: Masonry or factory-built fireplaces must have a closable metal or glass door covering the entire opening of the firebox.
§ 150.0(a)(3)	Combustion Intake: Masonry or factory-built fireplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a regularly accessible, operable, and light-tight damper or combustion air control device.
§ 150.0(a)(4)	Flue Damper: Masonry or factory-built fireplaces must have a flue damper with a readily accessible control.
Space Conditioning, Water Heating, and Plumbing System Measures:	
§ 110.0(a)(1)	Certification: Heating, ventilation and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the California Energy Commission.
§ 110.0(a)(2)	HVAC Efficiency: Equipment must meet the applicable efficiency requirements in Table 110.2.A through 110.2.K.
§ 110.0(a)(3)	Controls for Heat Pumps and Supplementary Electric Resistance Heaters: Heat pumps with supplementary electric resistance heaters must have controls that prevent supplementary heater operation when the heating alone, and in which the cut-on temperature for compression heating is higher than the cut-on temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.
§ 110.0(a)(4)	Thermostats: All heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setback thermostat.
§ 110.0(a)(5)	Water Heating Recirculation Loops Serving Multiple Dwelling Units: Water heating recirculation loops serving multiple dwelling units must meet the air release valve, backflow prevention, pump, pump isolation valve, and recirculation loop connection requirements of § 110.3(c).
§ 110.3(c)(6)	Isolation Valves: Instantaneous water heaters with an input rating greater than 6.8 kBtu per hour (2 kW) must have isolation valves with hose bibbs or other fittings on both hot and cold water lines in addition to isolating the water heater when the water heater is to be closed.
§ 110.3(c)(7)	Pilot Lights: Continuously burning pilot lights are prohibited for natural gas, fan-type central furnaces, household cooking appliances (except appliances without an electrical voltage control) and pilot lights that consume less than 150 Btu per hour and pool and spa heaters.
§ 110.0(a)(6)	Building Cooling and Heating Loads: Heating and/or cooling loads are calculated in accordance with the ASHRAE Handbook, Equipment Volume, Applications Volume, and Fundamentals Volume, the SMACNA Residential Comfort System Installation Standards Manual, or the ACCA Manual J using design conditions specified in § 150.0(j)(2).

2019 Low-Rise Residential Mandatory Measures Summary	
§ 150.0(a)(3A)	Clearance: Air conditioner and heat pump outdoor condensing units must have a clearance of at least five feet from the eave of any dryer.
§ 150.0(a)(3B)	Liquid Line Drier: Air conditioners and heat pump systems must be equipped with liquid line filter driers (if required), as specified by the manufacturer's instructions.
§ 150.0(a)(4)	Storage Tank Insulation: Unvented hot water tanks, such as storage tanks and backup storage tanks for solar water-heating systems, must have a minimum of R-12 external insulation or R-18 internal insulation where the internal insulation R-value is indicated on the exterior of the tank.
§ 150.0(a)(5)	Water Piping, Solar Water-Heating System Piping, and Space Conditioning System Piping and Insulation: All domestic hot water piping must be insulated as specified in Section 605.11 of the California Plumbing Code. In addition, the following piping conditions must be met: a minimum insulation wall thickness of one inch or a minimum insulation R-value of 7; the first feet of cold water pipes from the storage tank, at hot water piping with a nominal diameter equal to or greater than 3/4 inch shall have no less than 1/2 inch of hot water piping with a nominal diameter less than 3/4 inch that is associated with a domestic hot water recirculation system, from the heating source to storage tank or between tanks, buried below grade; and from the heating source to kitchen fixtures.
§ 150.0(a)(6)	Insulation Protection: Piping insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind as required by Section 120.3(b). Insulation exposed to weather must be water resistant and protected from UV light (no asphalt tapes). Insulation covering chilled water piping and refrigerant suction piping located outside the conditioned space must include, but is not limited to, a Class I or Class II vapor retarder. Piping insulation buried below grade must be installed in a water-tight and non-cracking cast-in-place concrete or masonry.
§ 150.0(a)(7)	Gas or Propane Water Heating Systems: Solar water-heating systems to serve individual dwelling units must include all of the following: A dedicated 10- or 20-amp electrical receptacle connected to the electric panel with a 120/240-volt conductor, 10 AWG copper branch circuit, within three feet of the water heater without obstruction. Both ends of the unshielded conductor must be labeled with the word "panel" and be electrically isolated. Have a mineral single phase circuit breaker placed in the electrical panel adjacent to the circuit breaker for the branch circuit and labeled with the words "Future 240V Line," a Category II or IV vent, or a Type vent with straight pipe between the outside termination and the space where the water heater is installed, a condensate drain that is no more than two inches higher than the base of the water heater, and above natural draining without pump assistance, and a gas supply line with a capacity of at least 500,000 Btu per hour.
§ 150.0(a)(8)	Recirculating Loops: Recirculating loops serving multiple dwelling units must meet the requirements of § 110.3(c)(5).
§ 150.0(a)(9)	Solar Water-Heating Systems: Solar water-heating systems and collectors must be certified and rated by the Solar Rating and Certification Corporation (SRCC), the International Association of Plumbing and Mechanical Contractors, and Research and Testing (APMO RAT), or by a listing agency that is approved by the Executive Director.
Ducts and Fan Measures:	
§ 110.0(a)(10)	Ducts: Insulation installed on an existing space-conditioning duct must comply with § 604.0 of the California Mechanical Code (CMC). If a contractor replaces the insulation, the contractor must certify to the customer, in writing, that the insulation meets the requirement.
§ 110.0(a)(11)	CMC Compliance: All air distribution systems and plenums must meet the requirements of the CMC §§ 601.0, 602.0, 603.0, 604.0, 605.0 and ANSI/SMACNA-2008 HVAC Duct Construction Standards Metal and Flexible 2nd Edition. Portions of the duct system completely repaired and replaced must be installed to a minimum installed level of R-4.0. A minimum installed level of R-4.0 is required for all ductwork in any conditioned space as confirmed through field verification and diagnostic testing (RA3.1 & 3.8). Portions of the duct system completely repaired and replaced by directly conditioned space are not required to be insulated. Connections between ductwork and other ductwork must be mechanically fastened. Openings must be sealed with mastic, tape, or other duct-sealing system that meets the applicable requirements of UL 181, UL 181A, or UL 181B or an equivalent sealant that meets the requirements of UL 723. If mastic or tape is used to seal openings greater than 1/4 inch, the combination of mastic and other material must be used. Building cavities, support platforms for air handlers, and plenums designed or constructed with materials other than sealed sheet metal, duct board or flexible duct must not be used to convey conditioned air. Building cavities and support platforms may contain ducts. Ducts installed in cavities and support platforms must not be compressed to cause reductions in the cross-sectional area.
§ 150.0(a)(12)	Factory-Fabricated Duct Systems: Factory-fabricated duct systems must comply with applicable requirements for duct construction, connections, and closures; joints and seams of duct systems and their components must not be sealed with on-site hand-applied adhesive duct tapes unless such tape is used in combination with mastic and draw bands.
§ 150.0(a)(13)	Field-Fabricated Duct Systems: Field-fabricated duct systems must comply with applicable requirements for pressure-sensitive tapes, mastics, sealants, and other requirements specified for duct construction.
§ 150.0(a)(14)	Backdraft Damper: Fan systems that exchange air between the conditioned space and outdoors must have backdraft or automatic dampers.
§ 150.0(a)(15)	Gravity Ventilation Dampers: Gravity ventilating systems serving conditioned space must have either automatic or readily accessible, manually operated dampers in all openings in the building envelope, except combustion inlet and outlet openings and elevated walkways.
§ 150.0(a)(16)	Protection of Insulation: Insulation must be protected from damage, sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather must be suitable for outdoor use. For example, protected by aluminum, steel, metal, painted canvas, or plastic cover. Cellular foam insulation must be protected as above or painted with a coating that is water resistant and provides shielding from solar radiation.
§ 150.0(a)(17)	Porous Inner Core Fire Duct: Porous inner core fire ducts must have a non-porous liner between the inner core and outer vapor barrier.
§ 150.0(a)(18)	Water Sealing and Leakage Test: When space conditioning systems use forced air duct systems to supply conditioned air to an inaccessible space, the ducts must be sealed and duct leakage tested in accordance with the requirements of § 150.0(m)(1) and § 150.0(m)(2).
§ 150.0(a)(19)	Air Filtration: Space conditioning systems with ducts exceeding 10 feet and the supply side of ventilation systems must have MERV 13 or equivalent filters. Filters for space conditioning systems must have a minimum depth of one inch, tested per Equation 150.0.A. Pressure drops and labeling must meet the requirements in § 150.0(m)(2). Filters must be accessible for regular service.
§ 150.0(a)(20)	Space Conditioning System Airflow Rate and Fan Efficiency: Space conditioning systems that use ducts to supply cooling load have a hole for the placement of a pressure tap. A permanent installed static pressure probe in the supply plenum, airflow must be at least 300 CFM per ton of nominal cooling capacity, and an air handling unit fan efficiency of 0.45 watts per CFM for fan motors and 0.55 watts per CFM for fan motors with a fan efficiency of 0.82 watts per CFM. Field verification testing is required in accordance with Reference Residential RA3.1.*

2019 Low-Rise Residential Mandatory Measures Summary	
<small>NOTE: Low-rise residential buildings subject to the Energy Standards must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective sections for more information. Exceptions may apply.</small>	
Requirements for Ventilation and Indoor Air Quality:	
§ 150.0(a)(1)	Requirement for Ventilation and Indoor Air Quality: All dwelling units must meet the requirements of ASHRAE Standard 62.2, Ventilation and Acceptable Indoor Air Quality in Residential Buildings as subject to the amendments specified in § 150.0(f).
§ 150.0(a)(2)	Single Family Detached Dwelling Units: Single family detached dwelling units, and attached dwelling units not sharing ceilings or floors with other dwelling units, occupiable spaces, pools/garages, or commercial spaces must have mechanical ventilation airflow provided as rates determined by ASHRAE 62.2 Sections 4.1.1 and 4.1.2 and as specified in § 150.0(f)(1).
§ 150.0(a)(3)	Multifamily Attached Dwelling Units: Multifamily attached dwelling units must have mechanical ventilation airflow provided at rates in accordance with ASHRAE 62.2 Sections 4.1.1 and 4.1.2 and as specified in § 150.0(f)(1).
§ 150.0(a)(4)	Multifamily Building Central Ventilation Systems: Central ventilation systems must be designed to provide a minimum of 15 CFM per person of outdoor air for each dwelling unit served at a rate equal to or greater than the rate specified by Equation 150.0.A. All unit airflows must be within 20 percent of the unit with the lowest airflow rate. It relates to the individual unit's minimum required airflow rate needed for compliance.
§ 150.0(a)(5)	Kitchen Range Hoods: Kitchen range hoods must be sealed for leakage in accordance with Section 2.2 of ASHRAE 62.2.
§ 150.0(a)(6)	Field Verification and Diagnostic Testing: Dwelling unit ventilation airflow must be verified in accordance with Reference Residential Appendix RA3.1. A fraction range hood must be verified in accordance with Reference Residential Appendix RA3.1. A 3 to 3 to confirm it is sealed to comply with the airflow rates and speed requirements as specified in Section 2.2 of ASHRAE 62.2.
Pool and Spa Systems and Equipment Measures:	
§ 110.4(a)	Certification by Manufacturer: Any pool or spa heating system or equipment must be certified to have all of the following: a thermal efficiency that complies with the Appliance Efficiency Requirements, an on-off switch mounted outside of the heater that allows shutting off the heater without adjusting the thermostat setting, a permanent weatherproof pilot or gas valve with operating instructions, and a manual air release electrically actuated by the thermostat setting.
§ 110.4(b)(1)	Piping: Any pool or spa heating system or equipment must be installed with at least 36 inches of pipe between the filler and the heater, or between the suction and return lines, or built-in full-up connections to allow for future solar heating.
§ 110.4(b)(2)	Covers: Outdoor pools or spas that have a heat pump or gas heater must have a cover.
§ 110.4(b)(3)	Directional Inlets and Time Switches for Pools: Pools must have directional inlets that adequately mix the pool water, and a time switch that will allow an inlets to be set or programmed to run only during off-peak electric demand periods.
§ 110.5	Pilot Light: Natural gas pool and spa heaters must not have a continuously burning pilot light.
§ 150.0(a)(7)	Pool Systems and Equipment Installation: Residential pool systems or equipment must meet the specified requirements for pump sizing, flow rate, piping, filters, and valves.*
Lighting Measures:	
§ 110.9	Lighting Controls and Components: All lighting control devices and systems, ballasts, and luminaires must meet the applicable requirements of § 110.9.
§ 150.0(a)(1A)	Luminaire Efficiency: All installed luminaires must meet the requirements in Table 150.0.A.
§ 150.0(a)(1B)	Blank Electrical Boxes: The number of electrical boxes that are more than 18 feet above the finished floor and do not contain a luminaire or other device must be no greater than the number of bedrooms. These electrical boxes must be served by a dimmer, vacancy sensor control, or an in-line control.
§ 150.0(a)(1C)	Recessed Downlight Luminaires in Ceilings: Luminaires recessed into ceilings must meet all of the requirements for insulation contact (IC) labeling, air leakage, sealing, maintenance, and socket and light source as described in § 150.0(a)(1).
§ 150.0(a)(1D)	Electronic Ballasts and Fluorescent Lamps: Ballasts for fluorescent lamps rated 15 watts or greater must be electronic and must have an output frequency no less than 20 kHz.
§ 150.0(a)(1E)	Night Lights, Step Lights, and Path Lights: Night lights, night lights and path lights are not required to comply with Table 150.0.A if they are controlled by a vacancy sensor provided they are used to consume no more than 5 watts of power and emit no more than 150 lumens.
§ 150.0(a)(1F)	Lighting Integral to Exhaust Fans: Lighting integral to exhaust fans (except when installed by the manufacturer in kitchen exhaust hoods) must meet the applicable requirements of § 150.0(a)(1).
§ 150.0(a)(1G)	Screen based luminaires: Screen based luminaires must contain fans (except when installed by the manufacturer in kitchen exhaust hoods).
§ 150.0(a)(1H)	Light Sources in Enclosed or Recessed Luminaires: Lamps and other separable light sources that are not compliant with the JAB tested temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires.
§ 150.0(a)(1I)	Light Sources in Drawers, Cabinets, and Linen Closets: Light sources recessed into drawers, cabinets, or linen closets are not required to comply with Table 150.0.A if they are controlled by a vacancy sensor provided they are used to consume no more than 5 watts of power and emit no more than 150 lumens, and are equipped with controls that automatically shut the lighting off when the drawer, cabinet, or linen closet is closed.
§ 150.0(a)(2A)	Interior Switches and Controls: All forward phase out dimmers used with LED light sources must comply with NEMA SS3.7A.
§ 150.0(a)(2B)	Interior Switches and Controls: On-off switches must be controlled separately from lighting systems.
§ 150.0(a)(



Construction and Demolition (C & D) Debris Re-Use and Recycling Program

When a project is covered by the updated Huntington Beach C & D Ordinance Section 8.21, it must recycle 65% of the debris it generates. Please review the table below for our current requirements.

Table with 2 columns: Field (Planned Start Date, Covered projects, Materials required to be recycled, etc.) and Description.

Address, Phone Number, Mailing Address, City, State, Zip Code, Fax Number form fields.

- 1) Project Type: New, Construction, Addition/Alteration, Demolition
2) Building Type: Non-residential, Residential, Low-rise residential/Duplex, Apartment/Multi-Family
3) Tenant Improvement (check one): Yes, No
4) Size of Project: sq. ft., Project Valuation: \$
5) Estimated Start Date, Estimated Completion Date

6) Compliance method (Check one and provide required information)
Green Halo System (Enter tracking number)
Waste Diversion Plan Worksheet (If not using Green Halo)

7) Briefly describe project (i.e.: renovate warehouse, remodel office, etc.)

8) How will scrap or waste material be handled to ensure salvage, re-use or recycling?

9) How will employees and sub-contractors be notified of recycling proposed plan and goals?



CONSTRUCTION & DEMOLITION DEBRIS WASTE WORKSHEET

Table with 2 columns: Material (Asphalt paving, crushed, loose = 1,380 lbs / cubic yard, etc.) and Conversion Factor (Concrete, scraps, loose = 1,855 lbs / cubic yard, etc.)

Please submit three (3) copies of this worksheet with your building permit application and this worksheet shall be electronically placed / made a part of plans. For instructions on how to fill out this form, see "Waste Diversion Worksheet Instructions" located online at the Building Division website under Frequently Requested Forms.

DIVERSION

The categories of recyclable materials are as follows: Construction and Demolition Materials: Brick, concrete, dirt, granite, gravel, pavement/asphalt and sand.

- 1. Register your project either online using Green Halo Systems or by completing the Waste Reduction Recycling Plan (WRRP) form attached.
2. Create waste diversion plan in Green Halo and print out Project Information page.
3. Divert debris as specified on the plan and collect required documentation.
4. Pre-Building Final: show the Building Inspector final Green Halo report demonstrating diversion rate compliance.



Construction and Demolition (C & D) Debris Waste Reduction and Recycling Plan (WRRP)

- This form must be complete for the following types of projects:
- Newly constructed building and demolition projects shall divert from landfills at least 65% of the construction materials generated during project.
- All locally permitted additions and alterations to non-residential buildings or structures shall divert from landfills at least 65% of non-hazardous construction and demolition materials.

WRRP must be submitted and APPROVED prior to issuance of building permits. Incomplete forms will be returned to applicant and may delay issuance of permit(s).

Permit Number, Permit, Contact Name, Company Name, Contact Name, Email Address form fields.



CONSTRUCTION & DEMOLITION DEBRIS WASTE WORKSHEET

Pre-Project Waste Diversion Plan (non-shaded portion). Indicate diversion method with an "X" in appropriate column along with the name of vendor/facility. Calculate anticipated diversion and landfill percentage of each material type.

Table with columns: Material, C & D, Metals, WGreen Waste, Glass, Wood, Recycling Facilities, C & D, Metals, Green Waste, Glass, Wood.

Post-Project Waste Diversion Report (shaded portion). Enter actual weight in pounds for each category. Calculate weight column total and diversion rate. Keep all receipts for final report.

Table with columns: Material, WASTE DIVERSION PLAN (FOR PLAN CHECK ONLY), WASTE DIVERSION REPORT (FOR FINAL INSPECTION ONLY), DIVERSION RATE.



CONSTRUCTION & DEMOLITION DEBRIS WASTE WORKSHEET

Note: Although a company may designate the acceptance of materials in one or more categories, please call to verify the materials and quantities produced on your project are accepted. You may also visit Cal Recycle at http://www.calrecycle.ca.gov/condemo/recyclers/RecyclerSearch.aspx for other local dealers and facilities.

Table with columns: Franchised Waste Hauler, C & D, Metals, WGreen Waste, Glass, Wood, Recycling Facilities, C & D, Metals, Green Waste, Glass, Wood.



CONSTRUCTION & DEMOLITION DEBRIS WASTE WORKSHEET

Table with columns: Material (BRICK, MASONRY, TILE, METALS, PLASTER, SHEETROCK, etc.), C & D, Metals, Green Waste, Glass, Wood, Recycling Facilities, C & D, Metals, Green Waste, Glass, Wood.

DIVERSION

Table with columns: ITEM, USE LOCATION (ON-SITE, OFF-SITE), OFF-SITE BENEFACTOR OR DECONSTRUCTION COMPANY.

WEIGHT CONVERSION FACTORS



CONSTRUCTION & DEMOLITION DEBRIS WASTE WORKSHEET

Table with columns: Recycling Facilities, C & D, Metals, Green Waste, Glass, Wood, Recycling Facilities, C & D, Metals, Green Waste, Glass, Wood.

Vertical sidebar containing: PROPOSED REMODEL/ADDITION PLANS FOR MICHAEL HOPKINS & IRENE MORCOS, AGAPE CIVIL ENGINEERING, INC., January 9, 2023, SHEET 16 OF 17, JOB NO. 268-2204.

